




# FULTON COUNTY

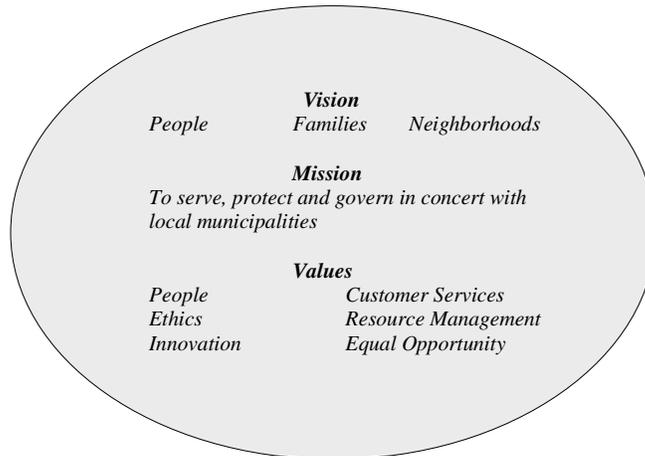

**INVITATION TO BID 11ITB79910K-NH**

**W042-ALPHARETTA WATER TRANSMISSION MAIN  
(GAP ON KIMBALL BRIDGE ROAD)  
For**

**DEPARTMENT OF PUBLIC WORKS**

**BID DUE TIME AND DATE: Monday, September 12, 2011**  
**BID ISSUANCE DATE: August 8, 2011**  
**PRE-BID CONFERENCE DATE: Monday, August 22, 2011**  
**PURCHASING CONTACT: Nancy Harrison, 404-612-4201**  
**E-MAIL: [nancy.harrison@fultoncountyga.gov](mailto:nancy.harrison@fultoncountyga.gov)**

**LOCATION: FULTON COUNTY DEPARTMENT OF PURCHASING &  
CONTRACT COMPLIANCE  
130 PEACHTREE STREET, S.W., SUITE 1168  
ATLANTA, GA 30303**

**Table of Contents****Section      Title****Division 0 – Bidding and Contract Requirements****00020      Invitation to Bid**

Description of Project  
Permits  
Rights of Way/Easements  
Bid Documents  
Term of Contract  
No Contact Provision  
Bid Contact  
Basis of Award  
Pre-Bid Conference

**00100      Instructions to Bidders**

A. Contract Documents  
B. Bid Preparation and Execution  
C. Addenda and Interpretations  
D. Site Examination  
E. Bidder's Modification and Withdrawal of Bonds  
F. Bid and Contract Security  
G. Right to Reject Bids  
H. Applicable Laws  
I. Examination of Contract Documents  
J. Indemnification and Hold Harmless Agreement  
K. Bid Opening  
L. Determination of Successful Bidder  
M. Georgia Utility Contractors License  
N. General Contractors License  
O. Professional Licenses  
P. Wage Clause  
Q. Notice of Award of Contract  
R. Execution of Contract Documents  
S. Joint Venture  
T. Contractors Compliance with Procurement  
U. Georgia Security and Immigration Compliance Act  
V. Bid General Requirements

Required Bid Submittal Checklist for ITB

<b>00300</b>	<b>Bid Form</b>
<b>00410</b>	<b>Bid Bond</b>
<b>00420</b>	<b>Purchasing Forms &amp; Instructions</b>
	Form A- Non-Collusion Affidavit of Prime Bidder/Offeror
	Form B- Certificate of Acceptance of Request for Bid Requirements
	Form C- Contractor's Georgia Utility License Certification
	Form C1 – Georgia Utility License Contractors License
	Form D- Certification Regarding Debarment
	Form E- Disclosure Form & Questionnaire
	Form F – Georgia Security and Immigration Contractor Affidavit and Agreement
	Form G – Georgia Security and Immigration Subcontractor Affidavit
<b>00430</b>	<b>Contract Compliance Requirements</b>
	Non-Discrimination in Contracting and Procurement
	Required Forms and EBO Plan
	Exhibit A – Promise of Non-Discrimination
	Exhibit B – Employment Report
	Exhibit C – Schedule of Intended Subcontractor Utilization
	Exhibit D – Letter of Intent to Perform As a Subcontractor or Provide Materials or Services
	Exhibit E – Declaration Regarding Subcontracting Practices
	Exhibit F – Joint Venture Disclosure Affidavit
	Exhibit G – Prime Contractor/Subcontractor Utilization Report
	Exhibit H -- First Source Jobs Program Information
<b>00490</b>	<b>Insurance and Risk Management Provisions</b>
<b>00500</b>	<b>Contractual Agreement</b>
<b>00610</b>	<b>Performance Bond Requirements</b>
<b>00620</b>	<b>Payment Bond Requirements</b>
<b>00700</b>	<b>General Conditions</b>
<b>Division 1 – General Requirements</b>	
<b>01010</b>	<b>Summary of Work</b>
<b>01011</b>	<b>Unique Requirements</b>
<b>01016</b>	<b>Occupancy</b>
<b>01025</b>	<b>Measurement and Payment</b>
<b>01055</b>	<b>Construction Staking</b>
<b>01060</b>	<b>Regulatory Requirements</b>
<b>01091</b>	<b>Codes and Standards</b>
<b>01200</b>	<b>Project Meetings</b>
<b>01310</b>	<b>Construction Schedules</b>
<b>01320</b>	<b>Construction Videos and Photographs</b>
<b>01340</b>	<b>Shop Drawings, Product Data and Samples</b>
<b>01410</b>	<b>Testing Laboratory Services</b>
<b>01510</b>	<b>Temporary Facilities</b>
<b>01540</b>	<b>Job Site Security</b>
<b>01562</b>	<b>Dust Control</b>
<b>01580</b>	<b>Project Identification and Signs</b>

01630	Substitutions and Product Options
01710	Cleaning
01720	Record Documents
01740	Warranties and Bonds

**Division 2 – Site work**

02110	Clearing and Grubbing
02125	Erosion and Sedimentation Control
02225	Trench Excavation and Backfill
02229	Bore and Jack Casings
02575	Removing and Replacing Pavement
02665	Water Mains and Accessories
02668	Water Service Connections
02930	Grassing
02951	Tree Removal and Protection

**Division 3 – Concrete**

03200	Concrete Reinforcement
03400	Precast Concrete

***Exhibits***

***Project Drawings must be purchased-See Section 00020 of Solicitation***

***Appendices***

**FC Standard Details- See Attachment**

**Subsurface Geotechnical Investigation**

**INVITATION TO BID****W042 - ALPHARETTA WATER TRANSMISSION MAIN**

Sealed Bids for furnishing all materials, labor, tools, equipment and appurtenances necessary for the construction of **W042 – ALPHARETTA WATER TRANSMISSION MAIN** will be received by the Fulton County Department of Purchasing and Contract Compliance at 130 Peachtree Street, S.W. Suite 1168 Atlanta, GA 30303, until 11:00a.m., local time, on Monday, September 12, 2011, and then at said office publicly opened and read aloud.

**Description of Project:**

The Project consists of the following major elements: obtaining all permits, furnishing all materials and equipment, and performing all labor necessary to install approximately 2925 linear feet of 54-inch diameter and 1550 linear feet of 12-inch diameter ductile iron pipe (DIP) water main and appurtenances as shown in the Project Drawings on Kimball Bridge Road.

**Permits:**

The work will be performed within existing County owned easements or rights-of-way. The Contractor is responsible for any temporary construction easements that may be required for the construction.

**Rights of Way/Easements:**

The work will be performed within existing County owned easements or rights-of-way. The Contractor is responsible for any temporary construction easements that may be required for the construction.

**Bid Documents:**

The Instructions to Bidders, Bid and Contract Requirements (Bid Form, Bid Bond, Performance Bond, Payment Bond, Contract Agreement), and other Documents (Drawings and/or Specifications) may be examined at the following locations:

McGraw Hill Construction Dodge  
3200 Riverside Dr  
STE 310  
Macon, Georgia 31210

Fulton County  
Public Works Department  
STE 6001  
141 Pryor ST, S.W., 6<sup>th</sup> Floor  
Atlanta, Georgia 30303

AGC Builders Exchange  
1940 The Exchange  
STE 300  
Atlanta, Georgia 30339

CMD / Construction Market Data  
30 Technology Blvd  
STE 100  
Norcross Georgia 30092

FW Dodge Corporation  
4170 Ashford-Dunwoody Rd  
STE 200  
Atlanta, Georgia 30319

Minority Business Development Agency  
401 West Peachtree St  
Summit Bldg STE 1715  
Atlanta Georgia 30308

This document and supporting documents can be downloaded at the Fulton County Website, <http://www.fultoncountyga.gov> under "Bid Opportunities". However, the drawings **must** be purchased. See below:

Applications for documents/drawings, along with a non-refundable \$50.00 payment must be made to Department of Public Works, 141 Pryor Street, S.W., Suite 3077, Atlanta, Georgia 30303. Payment must be in the form of a company or personal check payable to **Fulton County**. Checks returned for any reason will result in the bid being deemed non-responsive. This amount includes all fees for printing and distribution and will be used to defray a portion of the printing cost that may have been incurred for the tendering of the Project. Partial sets of the bid document will not be issued.

For payment information, contact Maureen Hill, Department of Public Works at 404-612-7434. All other questions should be addressed by the procedures outlined in this ITB to Nancy Harrison, Fulton County Department of Purchasing and Contract Compliance at 404-612-4201, [Nancy.Harrison@fultoncountyga.gov](mailto:Nancy.Harrison@fultoncountyga.gov).

### **Subcontracting Opportunities:**

Potential prime contractors submitting a bid on this project for Fulton County and are seeking subcontractors and/or suppliers can advertise those subcontracting opportunities on the County's website, <http://www.fultoncountyga.gov> under "Subcontracting Bid Opportunities".

### **Term of Contract:**

The Bidder agrees hereby to commence work under this Contract, with adequate personnel and equipment, on a date to be specified in a written order of the Contracting Officer and to fully complete all work under this Contract within **240** consecutive calendar days from and including said date.

The County will make payments, within **45** days, in response to the Contractor's monthly Applications for Payment, which are accompanied by the Engineer's Certificate for Payment, for work performed to date plus cost of stored materials, less retainage. Payments, Applications for Payment, Certificates for Payment, and retainage shall be in accordance with the provisions of the Contract Documents.

### **No Contact Provision**

It is the policy of Fulton County that the evaluation and award process for County contracts shall be free from both actual and perceived impropriety, and that contacts between potential vendors and County officials, elected officials and staff regarding pending awards of County contracts shall be prohibited.

- A. No person, firm, or business entity, however situated or composed, obtaining a copy of or responding to this solicitation, shall initiate or continue any verbal or written communication regarding this solicitation with any County officer, elected official, employee, or designated County representative, between the date of the issuance of this solicitation and the date of the County Manager's recommendation to the Board of Commissioners for award of the subject contract, except as may otherwise be specifically authorized and permitted by the terms and conditions of this solicitation.

- B. All verbal and written communications initiated by such person, firm, or entity regarding this solicitation, if same are authorized and permitted by the terms and conditions of this solicitation, shall be directed to the Purchasing Agent.
- C. Any violation of this prohibition of the initiation or continuation of verbal or written communications with County officers, elected officials, employees, or designated County representatives shall result in a written finding by the Purchasing Agent that the submitted Bid or proposal of the person, firm, or entity in violation is “non-responsive”, and same shall not be considered for award.

### **Bid Contact**

Information regarding the bid or bid requirements, either procedural or technical, may be obtained by submitting questions in writing to:

Fulton County Department of Purchasing and Contract Compliance  
Attn: Nancy Harrison, Assistant Purchasing Agent  
Fulton County Public Safety Building  
130 Peachtree Street, S.W. Suite 1168  
Atlanta, GA 30303  
Phone: (404) 612-4201  
Fax: (404) 893-1744  
Reference Bid # ITB79910K-NH

Or Nancy.Harrison@fultoncountyga.gov

### **Basis of Award**

The Contract, if awarded, will be awarded to the lowest responsive and responsible bidder. No bid may be withdrawn for a period of sixty (60) days after the date of bid opening except as permitted by O.C.G.A., §36-91-41 et seq., as amended. Each Bid must be accompanied by a Bid Bond in accordance with the Bid Bond Requirements provided in the Contract Documents, on a Surety Company's Standard Bid Bond Form acceptable to the County in an amount no less than 5% of the amount bid. The successful bidder will be required to furnish a Performance Bond and Payment Bond, **on or before** the issuance of Notice to Proceed, each in the amount of 100% of the Contract Amount. All other required Contract Documents must be fully completed and executed by the Contractor and his/her Surety, and submitted to the Owner **on or before** the issuance of the Notice to Proceed.

### **Pre-Bid Conference**

Date: **Monday, August 22, 2011**  
Time: 2:00 PM  
Location: Fulton County Department of Purchasing and Contract Compliance,  
Public Safety Building  
130 Peachtree Street, S.W. Suite 1168  
Atlanta, GA 30303

A optional pre-bid conference will be held in the Fulton County Department of Purchasing and Contract Compliance Conference Room, located at 130 Peachtree Street, S.W. Suite 1168, Atlanta, Georgia 30303. ***Inquiries regarding the solicitation either technical or otherwise may be submitted in writing prior to the pre-bid conference and will be addressed at the pre-bid conference.*** Any additional questions asked at the pre-bid conference must be

submitted in written form at the pre-bid conference and will be responded to in the form of an addendum with the County's official responses.

The Pre-bid conference will be conducted for the purpose of explaining the County's bid process, the specifications/technical documents, and to provide non-binding verbal responses to questions concerning these bid specifications and to discuss issues from the bidders perspective. However, no verbal response provided at the pre-bid conference binds the County. Only those responses to written questions that are responded to by the County in written communications will be official.

***END OF SECTION***

## INSTRUCTIONS TO BIDDERS

### A. Contract Documents

The Contract Documents include the Contract Agreement, Contractor's Bid (including all documentation accompanying the Bid and any post-Bid documentation required by the County prior to the Notice of Award), Bonds, all Special Conditions, General Conditions, Supplementary Conditions, Specifications, Drawings and addenda, together with written amendments, change orders, field orders and the Construction Manager's written interpretations and clarifications issued in accordance with the General Conditions on or after the date of the Contract Agreement.

Shop drawing submittals reviewed in accordance with the General Conditions, geotechnical investigations and soils report and drawings of physical conditions in or relating to existing surface structures at or contiguous to the site are not Contract Documents.

The Contract Documents shall define and describe the complete work to which they relate.

### B. Bid Preparation and Execution

All Bids must be made on the Bid forms contained herein. The original signed Bid with three (3) copies shall be submitted in a sealed envelope, addressed to the Department of Purchasing and Contract Compliance, Fulton County Public Safety Building, 130 Peachtree Street, S.W., Suite 1168 Atlanta, Georgia 30303, and labeled "Bid for **ITB79910K-NH W042 ALPHARETTA WATER TRANSMISSION MAIN(GAP ON KIMBALL BRIDGE ROAD)**."

Additionally, ***THE BIDDER IS ALSO REQUIRED TO WRITE THEIR GEORGIA UTILITY CONTRACTOR LICENSE NUMBER ON THE OUTSIDE OF THE SEALED BID ENVELOPE.***

**REQUIRED SUBMITTALS:** The bidder **must complete and execute** the following:

1. Bid Form
2. Acknowledgement of each Addendum
3. Bid Bond
4. Purchasing Forms (See Submittal Check List at end of this Section), fully executed
5. Contract Compliance Forms (See Submittal Check List at end of this Section), fully executed
6. Risk Management Insurance Provisions Form

Any bids received after the stated time and date will not be considered. It shall be the sole responsibility of the bidder to have his/her bid delivered to the Fulton County Department of Purchasing and Contract Compliance for receipt on or before the stated time and date (see Section 00020). If a bid is sent by U.S. Mail, the bidder shall be responsible for its timely delivery to the Purchasing Department. Bids delayed by mail will not be considered, shall not be opened, and arrangements shall be made for their return at the bidder's request and expense.

Bid shall be publicly opened, with only the names and total bid price of the bidders disclosed at the opening.

**C. Addenda and Interpretations**

No interpretations of the meaning of the Drawings, Specifications or other pre-bid documents will be made to any Bidder orally.

Bidders requiring clarification or interpretation of the Contract Documents shall make a request in writing, either by mail, hand delivery, e-mail or fax, to the Purchasing Agent at the address below. To be given consideration, requests must be received no later than 2:00 PM, August 26, 2011. The County will not respond to any requests, oral or written, received after this date. Telephone inquiries will not be accepted.

Fulton County Department of Purchasing and Contract Compliance  
Attn: Nancy Harrison, Assistant Purchasing Agent  
Fulton County Public Safety Building  
130 Peachtree Street, S.W., 1168  
Atlanta, GA 30303  
Fax: (404) 893-1744  
Nancy.Harrison@fultoncountyga.gov  
Reference Bid # ITB79910K-NH W042- Alpharetta Water Transmission Main (GAP on Kimball Bridge Road)

Only communications from firms that are in writing and signed will be recognized by the County as duly authorized expressions on behalf of proposers/bidders. Any and all such interpretations and any supplemental instructions will be in the form of written Addenda to the Contract Documents which, if issued, will be mailed, shipped or faxed to all prospective Bidders (at the respective addresses furnished) prior to the date fixed for the opening of Bids.

Failure of Bidders to receive or acknowledge any Addendum shall not relieve them of any obligation under the Bid. All Addenda shall become part of the Contract Documents.

**D. Site Examination*****Select one of the following:***

There will not be a County supervised site visit for this project.

**E. Bidder's Modification and Withdrawal of Bids**

A Bidder may modify or withdraw its bid by written request, provided that the request is received by the County prior to the bid due date and time at the address to which bids are to be submitted. Provided further, that in case of an electronic request (i.e. facsimile, e-mail, etc.) a written confirmation thereof over the authorized signature of the Bidder must be received by the County at the address to which original Bids are to be submitted within three (3) calendar days after issue of the electronic message. Following withdrawal of its bid, the Bidder may submit a new bid, providing delivery is affected prior to the established bid opening date and time. **No bid may be withdrawn after bid due date for sixty (60) calendar days.**

**F. Bid and Contract Security**

A Bid Bond for an amount equal to five percent (5%) of the bid amount must accompany each Proposal. The bid bond shall be submitted in a separate, sealed envelope marked "Bid Bond".

**Bids must be accompanied by a bid bond or certified check** in an amount of five percent (5%) of the TOTAL AMOUNT of the base bid. The bid bond or certified check shall apply ONLY TO THIS BID. The bid name and contract number must appear on the security instrument. The

bond must remain in full force and effect until the Bidder executes the final Contract. Bids not satisfying the bonding requirements of this project will be declared non-responsive.

Any bid bond, performance bond, payment bond, or security deposit required for public works construction contract shall be approved and filed with purchasing agent. At the option of the County, if the surety named in the bond is other than a surety company authorized by law to do business in this state pursuant to a current certificate of authority to transact surety business by the Commissioner of Insurance, such bond shall not be approved and filed unless such surety is on the United States Department of Treasury's list of approved bond sureties.

A Purchasing Agent shall approve as to form and as to the solvency of the surety any bid bond, performance bond, or payment bond required by this. In the case of a bid bond, such approval shall be obtained prior to acceptance of the bid or proposal. In the case of payment bonds and performance bonds, such approval shall be obtained prior to the execution of the contract.

Whenever, in the judgment of the County:

- (1) Any surety on a bid, performance, or payment bond has become insolvent;
- (2) Any corporation surety is not longer certified or approved by the Commissioner of Insurance to do business in the state; or
- (3) For any cause there are no longer proper or sufficient sureties on any or all the bonds

The County may require the contractor to strengthen any or all of the bonds or to furnish a new or additional bond or bonds within ten days. Thereupon, if so ordered by the County, all work on the contract shall cease unless such new or additional bond or bonds are furnished. If such bond or bonds are not furnished within such time, the County may terminate the contract and complete the same as the agent of and at the expense of the contractor and his or her sureties.

As a condition of responsiveness the bidder must contain a Bid Bond for an amount equal to 5% of the bid amount. The Bid Bond shall be included in a separate envelope marked on the outside "Bid Bond". Checks or letters of credit of any type will not be accepted. A certified cashier's check will be acceptable. Provide a completed and fully executed Bid Bond. When the bidder's package is opened, a purchasing agent will verify the presence of the Bid Bond and remove it from the Proposal Package.

If the bidder withdraws its bid from the competition after the selection of its bid for a reason not authorized by Georgia law, the County will proceed on the Bid Bond, along with any other available remedies.

The Surety of the Bid Bond shall be from a surety company authorized to do business in the State of Georgia, shall be listed in the Department of Treasury Circular 570, and shall have an underwriting limitation in excess of 100% of the bid amount. The Bonds and Surety shall be subject to approval by the County Attorney.

Attorneys-in-fact for bidders who sign bid bonds or contract bonds must file with each bond a certified and effectively dated copy of their power of attorney.

#### **G. Right to Reject Bids**

The County reserves the right to reject any or all bids and to waive informalities. No bids will be received after the time set for opening bids. Any unauthorized conditions, limitations or provisions attached to the Bid, except as provided herein, will render it informal and may cause its rejection. Unbalanced bids will be subject to rejection. Any bidder may withdraw his/her bid,

either personally or by telegraphic or written request, at any time prior to the scheduled closing time for receipt of bids. Telegraphic or written requests for withdrawal must be in the possession of the County prior to the closing time for receipt of bids.

#### **H. Applicable Laws**

All applicable laws and regulations of the State of Georgia and ordinances and regulations of Fulton County shall apply. Protestors shall seek resolution of their complaints in the manner provided in the Fulton County Code of Laws §2-324, which is incorporated by reference herein.

#### **I. Examination of Contract Documents**

Prospective bidders shall examine the contract documents and before submitting a bid, shall make a written request to the County for an interpretation or correction of any ambiguity, in consistency or error therein which could be discovered by a bidder. At the bid opening each bidder shall be presumed to have read and be familiar with the contract documents.

#### **J. Indemnification and Hold Harmless Agreement**

See Section 00490, Insurance and Risk Management Provisions page 3, Indemnification and Hold Harmless Agreement

#### **K. Bid Opening**

Bids will be opened in public and read aloud. All bidders are requested to be present at the opening.

#### **L. Determination of Successful Bidder**

Fulton County desires to complete this work in a timely manner. The Contract will be awarded to the lowest responsive, responsible bidder(s), if awarded.

1. **Responsibility:** The determination of the bidder's responsibility will be made by the County based on whether the bidder meets the following minimum requirements:
  - a. The County reserves the right to reject any bid if the evidence submitted by, or investigation of, the bidder fails to satisfy the County that he/she is properly qualified to carry out the obligations of the Contract.
  - b. Maintains a permanent place of business individually or in conjunction with the prime contractor.
  - c. Has the appropriate and adequate technical experience. Designated Project Manager must be proficient in all aspects of contracted work.
  - d. Has adequate personnel and equipment to do the work expeditiously.
  - e. Has suitable financial means to meet obligations incidental to the work.
2. **Responsiveness:** The determination of responsiveness will be made by the County based on a consideration of whether the bidder has submitted a complete Bid form without irregularities, excisions, special conditions, or alternative bids for any item unless specifically requested in the Bid form.

**M. Georgia Utility Contractors License****GEORGIA UTILITY CONTRACTOR'S LICENSE (APPLICABLE)**

A Utility Contractor's License is required to perform this work in accordance with O.C.G.A. §43-14-8.2(h). ***Bids for utility contracting projects must be from a licensed utility contractor and that licensed contractor must be the prime on this project.*** It is not permissible for an unlicensed individual/firm to subcontract with a licensed utility contractor for this project. Form C1: Georgia Utility License Certification in Section 5, Purchasing Forms must be completed and submitted by the contractor performing the work.

**N. General Contractors License (APPLICABLE)**

Effective July 1, 2008, all general contractors are required to be licensed by the State of Georgia to perform the following work; construction; construction management services; or design-build services as a prime contractor, joint venture partner, or as a subcontractor to a design professional acting as prime contractor as part of a design-build entity or combination, unless exempted from holding such license pursuant to Georgia law (O.C.G.A. 43-41-17). If exempted, Contractor must submit a copy of their Georgia Department of Transportation Certificate of Qualification with their bid submittal.

Bidders must complete Form C2: Georgia General Contractors License Certification in Section 6, Purchasing Forms. Failure to provide the required license shall deem your bid non-responsive.

**O. Professional Licenses (APPLICABLE)**

The State of Georgia requires that the following professions are required by state law to be licensed:

1. Electricians
2. Plumbers
3. Conditioned Air Contractors
4. Low voltage Contractors

Bidders and any sub-contractors performing any of the above described work must provide a copy of their license for the work they will perform on this project. Bidders must complete Form C3: Georgia Professional License Certification in Section 6, Purchasing Forms Failure to provide the required license may deem your bid non-responsive.

**P. Wage Clause**

Pursuant to 102-391, Each Contractor shall agree that in the performance of the Contract he will comply with all lawful agreements, if any, which the Contractor had made with any association, union, or other entity, with respect to wages, salaries, and working conditions, so as not to cause inconvenience, picketing, or work stoppage.

**Q. Notice of Award of Contract**

As soon as possible, and within sixty (60) days after receipt of bids, the County shall notify the successful Bidder of the Award of Contract.

The award shall be made by the Board of Commissioners of Fulton County to the lowest responsive, responsible bidder(s) as soon as possible after receipt of bids, taking into consideration price and the responsiveness to the requirements set forth in the Invitation for Bid. In such case, no claim shall be made by the selected Contractor(s) for loss of profit if the contract is not awarded or awarded for less work than is indicated and for less than the amount of his bid. The total of the awarded contract shall not exceed the available funds allocated for this project.

Should the County require additional time to award the contract, the time may be extended by mutual agreement between the County and the successful bidder. If an Award of Contract has not been made within sixty (60) days from the bid date or within the extension mutually agreed upon, the Bidder may withdraw the Bid without further liability on the part of either party.

Any award made by the Board of Commissioners as a result of this bid will begin from the date of the notice to proceed. The Bidder agrees hereby to commence work under this Contract, with adequate personnel and equipment, on a date to be specified in a written order from the user department. The contract shall become effective on the Contract Date and shall continue in effect until the end of the term of the contract or until the project has been closed-out unless earlier terminated pursuant to the termination provisions of the contract.

#### **R. Execution of Contract Documents**

Upon notification of Award of Contract, the County shall furnish the Contractor the conformed copies of Contract Documents for execution by the Contractor and Contractor's surety.

Within ten (10) days after receipt the Contractor shall return all the documents properly executed by the Contractor and the Contractor's surety. Attached to each document shall be an original power-of-attorney for the person executing the bonds for the surety and certificates of insurance for the required insurance coverage.

After receipt of the documents executed by the Contractor and his surety with the power-of-attorney and certificates of insurance, the County shall complete the execution of the documents. Distribution of the completed documents will be made upon completion.

Should the contractor and/or surety fail to execute the documents within the time specified, the County shall have the right to proceed on the Bid Bond accompanying the bid.

If the County fails to execute the documents within the time limit specified, the Contractor shall have the right to withdraw the Contractor's bid without penalty.

Should an extension of any of the time limits stated above be required, this shall be done only by mutual agreement between both parties.

Any agreement or contract resulting from the acceptance of a bid shall be on a County approved document form. The County reserves the right to reject any agreement that does not conform to the Invitation for Bid and any County requirements for agreements and contracts. The County reserves the right to modify the agreement resulting from this bid upon the recommendation of the County Attorney.

#### **S. Joint Venture**

Any Bidder intending to respond to this solicitation as a joint venture must submit an executed joint venture agreement with its offer. The agreement must designate those persons or entities

authorized to execute documents or otherwise bind the joint venture in all transactions with Fulton County, or be accompanied by a document, binding upon the joint venture and its constituent members, making such designation. Offers from joint ventures that do not include these documents will be rejected as being non-responsive.

**T. Contractors Compliance with All Assurances And/Or Promises Made In Response To Procurement**

Should any Bidder submit a response to the County promising to provide a certain level of service for either the scope of work, MFBE participation, or any other matter, including where such promise or assurance is greater than what is required by the procurement documents, and should this response containing the promise or assurance be accepted by the County and made a part of the Contract Documents, then this degree or level of service promised by the bidder relating to the scope of work, MFBE participation, or other matter shall be considered to be a material part of the Agreement between the bidder and the County, such that the bidder's failure to provide the agreed upon degree or level of service or participation shall be a material breach of the Agreement giving the County just cause to terminate the Agreement for cause, pursuant to the General Conditions of the Agreement.

**U. Georgia Security and Immigration Compliance Act**

This Invitation to Bid is subject to the Georgia Security & Immigration Compliance Act. Pursuant to the Georgia Security & Immigration Compliance Act of 2006, as amended on May 11, 2009, bidders and proposers are notified that all bids/proposals for services that are to be physically performed within the State of Georgia must be accompanied by proof of their registration with and continuing and future participation in the E-Verify program established by the United States Department of Homeland Security. A completed affidavit must be submitted on the top of the bid/proposal at the time of submission, prior to the time for opening bids/proposals. Under state law, the County cannot consider any bid/proposal which does not include a completed affidavit. It is not the intent of this notice to provide detailed information or legal advice concerning the Georgia Security & Immigration Compliance Act. All bidders/proposers intending to do business with the County are responsible for independently apprising themselves and complying with the requirements of that law and its effect on County procurements and their participation in those procurements. For additional information on the E-Verify program or to enroll in the program, go to: <https://e-verify.uscis.gov/enroll>.

See Section 00420, Purchasing Forms & Instructions for declarations and affidavits.

**V. Bid General Requirements**

The following information pertains to the submission of a Bid to Fulton County, and contains instructions on how Bids must be presented in order to be considered. Listed below are the requirements for all Bidders interested in doing business with Fulton County.

1. The Bid sheets included in this Invitation to Bid ("Bid") must be fully completed and returned with the Bid unless otherwise specified in writing by the Purchasing Department. Type or neatly print the date, company name,

and the full legal name and title of the person(s) signing the Bid in the place provided at the bottom of each Bid sheet. Any additional sheets submitted must contain the same signature and Bidder information.

2. All signatures must be executed by person(s) having contracting authority for the Bidder.
3. Absolutely no fax Bids or reproduction Bids will be accepted, except that photocopies may be submitted in addition to the original when multiple copies of the Bid are specifically requested in the solicitation.
4. The envelope in which the Bid response is submitted must be sealed and clearly labeled with the Bid number, project title, due date and time, and the name of the company or individual submitting the proposal. Bids must be received by the opening date and time shown on this Bid in order to be considered. The Purchasing Agent has no obligation to consider Bids which are not in properly marked envelopes. Contract Compliance submittals shall be submitted in a separate sealed envelope or package.
5. The original and the required number of copies of the Bid must be returned to:

Fulton County Purchasing Agent  
Fulton County Department of Purchasing and Contract Compliance  
130 Peachtree Street, S.W., Suite 1168  
Atlanta, Georgia 30303

Any inquiries, questions, clarifications or suggestions regarding this solicitation should be submitted in writing to the Purchasing Contact Person. Contact with any other County personnel in regard to a current solicitation is strictly prohibited in accordance with Fulton County "No Contact Provision" policy outlined in S35 and in Section 00020, Invitation to Bid.

6. Show information and prices in the format requested. Prices are to be quoted F.O.B. Destination, and must include all costs chargeable to the Contractor executing the Contract, including taxes. Unless otherwise provided in the Contract, Fulton County shall have no liability for any cost not included in the price. The Contractor shall provide Fulton County the benefit through a reduction in price of any decrease in the Contractor's costs by reason of any tax exemption based upon Fulton County's status as a tax-exempt entity.
7. All prices Bid must be audited by the Bidder to ensure correctness before the Bid is submitted. The Bidder is solely responsible for the accuracy of information placed on a Bid sheet, including prices. Clerical or mathematical error is insufficient to void a successful Bid but a Bidder may withdraw a sealed Bid prior to opening without a penalty.
8. All prices must be submitted in the format requested and less all trade discounts. When multiple items are being Bid, Bidder must show both the unit price and the total extended price for each item. When applicable, the Bidder must include an additional lump sum Bid for groups or items. In the event a Bidder is offering an additional discount on groups of items, Bidder

- must indicate the total lump sum Bid for the particular group of items before any extra discount, the amount of extra discount, and the net total for the particular group. In the event of an extension error, unit pricing shall prevail.
9. By submitting a signed Bid, Bidder agrees to accept an award made as a result of that Bid under the terms and conditions spelled out in the Bid documents. In the event of a conflict between the different Bid documents, the County's cover Contract (if used) shall have precedence, followed in order by the Invitation to Bid, Purchase Order, Bid, Contractor's Warranty Agreement, Maintenance Agreement, and/or other Contractor provided agreements.
  10. A Bidder may submit only one (1) Bid response for each specific Bid solicitation unless otherwise authorized in the specifications.
  11. All prices submitted by the Bidder to Fulton County must be guaranteed by the authorized person(s) against any price increase for the time period designated in the Bid specifications, and Fulton County must be given the benefit of any price decrease occurring during such designated time period.
  12. All items Bid must be new. Used, rebuilt and refurbished items will not be considered unless specifically authorized by Fulton County in the written specifications.
  13. All Bidders must specify in the Bid response the earliest actual delivery date for each item unless otherwise specified in writing by Fulton County. The delivery date may be a factor in deciding the Bidder's capability to perform.
  14. A successful Bidder's delivery ticket(s) and invoice(s) must list each item separately and must show Fulton County's purchase order number as well as the proper department and address to which delivery was made, as listed on the purchase order or in the Bidder's contract with Fulton County.
  15. Unless clearly shown as "no substitute" or words to that effect, any items in this invitation to Bid which have been identified, described or referenced by a brand name or trade name are for reference only. Such identification is intended to be descriptive but not restrictive, and is to indicate the general quality and characteristics of products that may be offered. Each item Bid must be individually identified as to whether it is a specified item or an equivalent item by typing or printing after the item(s): The brand name; model or manufacturer's number, or identification regularly used in the trade. Deviations from the specifications must be clearly and fully listed on the Bid sheet, including photographs or cuts, specifications, and dimensions of the proposed "alternate". Fulton County is the sole judge of "exact equivalent", or "alternate". The factors to be considered are: function, design, materials, construction, workmanship, finishes, operating features, overall quality, local service facilities, warranty terms and service, and other relevant features of item(s) Bid.
  16. For all Bids, Fulton County reserves the right to request representative samples. If requested, samples must be delivered at the Bidder's cost within three (3) business days. Samples are submitted at the risk of the Bidder and

may be subjected to destructive tests by Fulton County. Samples must be plainly tagged with Fulton County's Bid number, item name, manufacturer, and the name of the Bidder.

17. Item(s) Bid must be complete and ready to operate. No obvious omissions of components or necessary parts shall be made even though the specifications may not detail or mention them. Unit(s) must be furnished with factory installed equipment and must be comparable with the basic form, fit, and functional requirements which are all to be included in the base price as well as any other equipment included as standard by the manufacturer or generally provided to the buying public.
18. All successful Bidders must assume full responsibility for all item(s) damaged prior to F.O.B. Destination delivery and agree to hold harmless Fulton County of all responsibility for prosecuting damage claims.
19. All successful Bidders must assume full responsibility for replacement of all defective or damaged goods within thirty (30) days of notice by Fulton County of such defect or damage.
20. All successful Bidders must assume full responsibility for providing or ensuring warranty service on any and all items including goods, materials, or equipment provided to the County with warranty coverage. If a successful Bidder is not the manufacturer, all manufacturers' warranties must be passed through to Fulton County. The Bidder and not Fulton County is responsible for contacting the manufacturer of the warranty service provided during the warranty period and supervising the completion of the warranty service to the satisfaction of Fulton County.
21. As a successful Bidder providing any equipment which requires fitting and assembly, the Bidder shall be solely responsible for such installation being performed by a manufacturer's authorized or approved servicer or an experienced worker, utilizing workmanship of the highest caliber. The Bidder must verify all dimensions at the site, shall be responsible for their correctness, and shall be responsible for the availability of replacement parts when specified in writing by Fulton County in the specifications, purchase order, or other contract.
22. A successful Bidder is solely responsible for disposing of all wrappings, crating, and other disposable material upon deliver of item(s).
23. All Bidders are required to be authorized distributors or regularly engaged in the sale or distribution of the type of goods, materials, equipment or services for which the Bidder is submitting a Bid response in addition, all Bidders are required to provide Fulton County with three (3) written references documenting the successful completion of Bids or contracts for the types of items including goods, materials, equipment, or services for which the Bidder is submitting a Bid response. In instances where a Bidder has never supplied such goods, material, equipment, or services before, the Bidder must submit with the Bid response a statement and supporting documentation demonstrating such expertise, knowledge, or experience to establish the Bidder as a responsible Bidder, capable of meeting the Bid requirements

should an award be made. No exceptions to this provision will be made unless authorized in the Bid specifications.

24. Bidders may be required to furnish evidence that they maintain permanent places of business of a type and nature compatible with their Bid proposal, and are in all respects competent and eligible vendors to fulfill the terms of the specifications. Fulton County may make such investigations as it deems necessary to determine the ability of the Bidder to perform such work, and reserves the right to reject any Bidder if evidence fails to indicate that the Bidder is qualified to carry out the obligation of the Contract and to complete the work satisfactorily.
25. All Bidders must comply with all Fulton County Purchasing laws, policies, and procedures, non-discrimination in contracting and procurement ordinances, and relevant state and federal laws including but not limited to compliance with EEOC hiring guidelines and requirements under the Americans with Disabilities Act. Successful Bidder must obtain all permits, licenses, and inspections as required and furnish all labor, materials, insurance, equipment, tools, supervision, and incidentals necessary to accomplish the work in these specifications.
26. If a successful Bidder is unable or unwilling to enter into a Contract with Fulton County subsequent to being granted an award, or who fails to perform in accordance with the Bid specifications the Bidder will be subject to damages and all other relief allowed by law.
27. Successful Bidders contract directly with Fulton County and are the party or parties obligated to perform. Contracts may not be assigned and any failure to perform the Contract in accordance with the specifications will constitute a breach of Contract and may result in a Bidder being found to be "non-responsive" in the future.
28. In case of default by the successful Bidder, Fulton County may procure the articles for services from another source and hold the successful Bidder responsible for any resulting excess cost.
29. The County may award any Bid in whole or in part to one or more vendors or reject all Bids and/or waive any technicalities if it is in the best interests of the County to do so. In the event that all Bids are not rejected, Bids for items including goods, materials, equipment, and services will be awarded to the lowest "responsible" Bidder(s) as determined by Fulton County. Submitting the lowest Bid, as published at the Bid opening, does not constitute an award or the mutual expectation of an award of a Contract and purchase order. For purposes of this notice and the attached Bid sheets, a purchase order is a Contract to provide items including goods, materials, equipment, and services and is intended to have the full force and effect of a Contract. A breach of the terms and conditions of a purchase order constitutes a breach of Contract.
30. Bids for projects that are solicited pursuant to the Georgia Local Government Public Works Construction Law (O.C.G.A. § 36-91-1 et seq.) may be withdrawn as follows:

Competitive sealed Bids (“Bid”) may not be revoked or withdrawn until 60 days after the time set by the governmental entity for opening of Bids. At the end of this time period, the Bid will cease to be valid, unless the Bidder provides written notice to the County prior to the scheduled expiration date that the Bid will be extended for a time period specified by the County.

31. In the evaluation of the Bids, any award will be subject to the Bid being:
  - a. Compliant to the specification – meets form, fit, and function requirements stated or implied in the specification.
  - b. Lowest cost to the County over projected useful life.
  - c. Administratively Compliant – Including all required bonds, insurance, established quality of work and general reputation, financial responsibility, relevant experience, and related criteria.
32. All proposals and Bids submitted to Fulton County are subject to the Georgia “Open Records Act”, Official Code of Georgia, Annotated (O.C.G.A.) §50-18-70 et seq.
33. All proposals and Bids submitted to Fulton County involving Utility Contracting are subject to the Georgia law governing licensing of Utility Contractors, O.C.G.A. §43-14-8.2(h). The Utility Contractor License number of the person who will perform the utility work shall be written on the face of the Bid envelope.
34. The apparent silence of this specification, and any supplement thereto, as to details, of the omission from it of a detailed description concerning any point, will be regarded as meaning only the best commercial practices are to prevail. Only materials of the highest quality, correct type, size, and design are to be used. All interpretations of this specification will be made upon the basis of this statement, with Fulton County interpretation to prevail.
35. It is the policy of Fulton County that the evaluation and award process for County contracts shall be free from both actual and perceived impropriety, and that contacts between potential vendors and County officials, elected officials and staff regarding pending awards of County contracts shall be prohibited.
  - a. No person, firm, or business entity, however situated or composed, obtaining a copy of or responding to this solicitation, shall initiate or continue any verbal or written communication regarding this solicitation with any County officer, elected official, employee, or designated County representative, between the date of the issuance of this solicitation and the date of the County Manager’s recommendation to the Board of Commissioners for award of the subject contract, except as may otherwise be specifically authorized and permitted by the terms and conditions of this solicitation.
  - b. All verbal and written communications initiated by such person, firm, or entity regarding this solicitation, if same are authorized and permitted by the terms and conditions of this solicitation, shall be directed to the Purchasing Agent.

- c. Any violation of this prohibition of the initiation or continuation of verbal or written communications with County officers, elected officials, employees, or designated County representatives shall result in a written finding by the Purchasing Agent that the submitted Bid or proposal of the person, firm, or entity in violation is “non-responsive”, and same shall not be considered for award.
36. Any Bidder intending to respond to this solicitation as a Joint Venture must submit an executed Joint Venture Agreement with this Bid. This agreement must designate those persons or entities authorized to execute documents or otherwise bind the Joint Venture in all transactions with Fulton County, or are accompanied by a document, binding upon the Joint Venture and its constituent members, making such designation. Bids from Joint Ventures that do not include these documents will be rejected as being “non-responsive”.
37. Any Bidder intending to respond to this solicitation must complete all of the Procurement Affidavit Forms provided in this solicitation. Bids that do not include these completed documents will be rejected as being “non-responsive”.

**Required Bid Submittal Check List for Invitation To Bid (ITB)**

The following submittals shall be completed and submitted with each bid (see table below "Required Bid Submittal Check List."). Please check to make sure that the required submittals are in the envelope before it is sealed. Failure to submit all required submittals may deem your proposal non-responsive.

Submit one (1) Original bid, signed and dated and three (3) complete copies of the Original Bid including all required documents.

Item #	Required Bid Submittal Check List	Check (✓)
1	Bid Form (Section 00300) – All dollar amounts must be both in writing AND figures and represent prices for the published scope of work without exceptions.	
2	Acknowledgement of each Addendum (acknowledged both on the Bid Form, Section 00300, and on the form included with each addendum).	
3	Bid Bond (Section 00410) (separate envelope if Public Works Construction project)	
4	Purchasing Forms (Section 00420) Form A - Non-Collusion Affidavit of Prime Bidder/Offeror Form B - Certificate of Acceptance of Request for Bid/Proposal Requirements Form C1- Georgia Utility Contractor License Form C2- Georgia General Contractors License Form C3- Georgia Professional Licenses Form D - Certificate Regarding Debarment Form E - Disclosure Form & Questionnaire Form F - Declaration of Employee-Number Categories Form G - Georgia Security and Immigration Contractor Affidavit and Agreement Form H - Georgia Security and Immigration Subcontractor Affidavit	
5	Office of Contract Compliance Requirements (Section 00430) Exhibit A - Promise of Non-Discrimination (for Prime and each Sub) Exhibit B - Employment Record (for Prime and each Sub) Exhibit C - Schedule of Intended Subcontractor Utilization Exhibit D - Letter of Intent to Perform as Subcontractor Exhibit E - Declaration Regarding Subcontractor Practices Exhibit F - Joint Venture Disclosure Affidavit Exhibit G - Prime Contractor/Subcontractor Utilization Report Equal Business Opportunity Plan (EBO Plan)	
6	Risk Management Insurance Provisions Form (Section 00490) and proof of insurance, either letter from insurer or Certificate of Insurance.	
7	<b><u>Any additional requirements that the User Department would like to include should be added to this check list.</u></b>	
8		
9		

**END OF SECTION**

**BID FORM**Submitted To: Fulton County Government

Submitted By: \_\_\_\_\_

For: **W042 - ALPHARETTA WATER TRANSMISSION MAIN**

Submitted on: \_\_\_\_\_.

The undersigned, as Bidder, hereby declares that the only person or persons interested in the Bid as principal or principals is or are named herein and that no other person than herein mentioned has any interest in this Bid or in the Contract to be entered into; that this Bid is made without connection with any other person, company or parties making a Bid; and that it is in all respects fair and in good faith without collusion or fraud.

The Bidder further declares that he has examined the site of the work and informed himself fully in regard to all conditions pertaining to the place where the work is to be done; that he has examined the Drawings and Specifications for the work and contractual documents relative thereto, and has read all instructions to Bidders and General Conditions furnished prior to the openings of bids; that he has satisfied himself relative to the work to be performed.

The Bidder proposes and agrees, if this Bid is accepted, to contract with the Board of Commissioners of Fulton County, Atlanta, Georgia, in the form of contract specified, to furnish all necessary materials, equipment, machinery, tools, apparatus, means of transportation and labor necessary, and to complete the construction of the work in full and complete accordance with the shown, noted, and reasonably intended requirements of the Specifications and Contract Documents to the full and entire satisfaction of the Board of Commissioners of Fulton County, Atlanta, Georgia, with a definite understanding that no money will be allowed for extra work except as set forth in the attached General Conditions and Contract Documents for the following prices.

THE BASE BID TOTAL IS THE AMOUNT UPON WHICH THE BIDDER WILL BE FORMALLY EVALUATED AND WHICH WILL BE USED TO DETERMINE THE LOWEST RESPONSIBLE BIDDER. Please make sure that all line items below are accurately calculated and total up to this inclusive amount.

The base bid may not be withdrawn or modified for a period of sixty (60) days following the receipt of bids.

BASE BID TOTAL: ITEMS B-1 THROUGH B-21 IN THE AMOUNT OF: \_\_\_\_\_ (\$\_\_\_\_\_).

Make sure that all line items below are accurately calculated and total up to the inclusive BASE BID TOTAL amount entered on Page 1.

**Method of Bidding**

The unit or lump sum price for each of the several items in the Bid of each Bidder shall include its pro rata share of overhead and profit so that the sum of the products, obtained by multiplying the quantity shown for each item by the unit price, represents the total Bid. Any Bid not conforming to this requirement may be rejected. Additionally, Unbalanced Bids or conditional Bids will be subject to rejection. The special attention of all Bidders is called to this provision, for should conditions make it necessary to revise the quantities, no limit will be fixed for such increased or decreased quantities nor extra compensation allowed.

**SEGMENT B.1**

## ITEM B-1 - EROSION AND SEDIMENTATION CONTROL

a	6000	L.F.	Reinforced Silt Fence (Type-C)	\$__/LF	\$_____
b	17	Each	Hay Bale Check Dam	\$__/EA	\$__
c	3	Each	Curb Inlet Filter	\$__/EA	\$__
d	7,500	S.Y.	Water Main Grassing	\$__/SY	\$__
e	2,000	S.Y.	Sod	\$__/SY	\$__
f	50	S.Y.	Rip Rap	\$__/SY	\$__

## ITEM B-2 - DUCTILE IRON PIPE WATER MAIN

a	2,820	L.F.	54-Inch DIP, Class 250, RJP	\$__/LF	\$__
b	1,550	L.F.	12-Inch DIP, Class 350,	\$__/LF	\$__
c	30	L.F.	36-Inch DIP, Class 250, RJP	\$__/LF	\$__
d	60	L.F.	24-Inch DIP, Class 250, RJP	\$__/LF	\$__
e	30	L.F.	8-Inch DIP, Class 350, RJP	\$__/LF	\$_____
f	60	L.F.	6-Inch DIP, Class 350, RJP	\$__/LF	\$__
g	30	Eac	Electronic Locator Balls for 12" line	\$_____/EA	\$_____
		h			
h	60	Eac	Electronic Locator Full Range for 54" line	\$_____/EA	\$_____
		h			

## ITEM B-3 - FITTINGS

a	15	Tons	Fittings, DIP, RJ	\$__/TN	\$__
b	1	Each	24" Welded On Outlet (Blow-Off)	\$__/EA	\$__
c	2	Each	8" Welded On Outlet (ARV)	\$__/EA	\$__
d	1	Each	36" Plug Welded (ARV)	\$__/EA	\$__
e	1	Each	36"x36" Tee (ARV)	\$__/EA	\$__
f	1	Each	54"x36" Tee (ARV)	\$__/EA	\$__

## ITEM B-4 - FIRE HYDRANTS

a	2	Each	Fire Hydrant Assembly - Complete	\$__/EA	\$__
b	20	V.F.	Hydrant Extension	\$_____/VF	\$_____

## ITEM B-5 - VALVES

a	3	Each	54" Butterfly Valve, Class 250	\$__/EA	\$__
b	1	Each	36" Butterfly Valve & Box, Class 250	\$_____/EA	\$_____
c	1	Each	24" Gate Valve & Box, Class 350(For ARV)	\$_____/EA	\$_____
d	1	Each	8" Gate Valve & Box, Class 350 (For Blow-OFF)	\$_____/EA	\$__
e	3	Each	6" Gate Valve & Box, Class 350	\$_____/EA	\$__
f	3	Each	Vault, for 54" Butterfly Valve	\$__/EA	\$__

## ITEM B-7 - CONNECT TO EXISTING WATER MAINS

a	2	Each	Remove Existing Plug & tie 12-Inch Water Line	\$__/EA	\$__
b	1	Each	Remove Existing Plug & tie to 54-Inch Water Line	\$__/EA	\$__
c	1	Each	54"-Install Dead-man & Plug (FC.Std.)	\$__/EA	\$__
d	2	Each	12-Inch Tapping Sleeve and Valve	\$__/EA	\$__

## ITEM B-8 - AIR RELEASE / BLOW-OFF VALVE ASSEMBLY

a	1	Each	ARV Assembly Complete (With Vent-O-Mat DN200 8" Size)	\$__/EA	\$__
---	---	------	--	---------	------

b	1	Each	Blow-off Valve Assembly Complete	\$____/EA	\$_____
ITEM B-9 - BORE AND JACK CASING					
a	135	L.F.	72-Inch Steel Casing Pipe	\$____/LF	\$_____
b	185	L.F.	18-Inch Steel Casing Pipe	\$____/LF	\$_____
ITEM B-10 - REMOVE AND REPLACE PAVEMENT					
a	2,000	S.Y.	Asphalt Roadway	\$__/_SY	\$__
b	3,000	S.Y.	Resurface Asphalt Pavement	\$____/_SY	\$_____
c	1000	S.Y.	Asphalt Driveway	\$____/_SY	\$_____
d	500	S.Y.	Concrete Driveway	\$____/_SY	\$_____
e	50	L.F.	Railing ( remove and replace with new)	\$____/LF	\$_____
ITEM B-11 - REMOVE AND REPLACE CURB AND GUTTER					
a	3,000	L.F.	Concrete Curb and Gutter	\$____/LF	\$_____
ITEM B-12 – REMOVE AND REPLACE SIDEWALK					
a	1000	L.F.	Concrete Sidewalk	\$____/LF	\$_____
b	60	L.F.	Temporary 4' Wide Gravel For Greenway	\$____/LF	\$_____
ITEM B-13-WATER SERVICES CHANGE OVER					
a	5	Each	3"/4–2" Copper Service Line Connection	\$____/EA	\$_____
b	5	Each	Remove & Replace with new service meter box	\$____/LF	\$_____
ITEM B-14 – PIPE ENCASEMENT					
a	280	L.F.	Polyethylene Encasement	\$__/_LF	\$
ITEM B-15 – CREEK CROSSING					
a	105	L.F.	54- Inch DIP Class 250 RJP (Including all accessories & erosion control measure)	\$____/LF	\$_____L F
ITEM B-16 – UTILITY RELOCATION					
a	20	L.F.	8" SS Relocation	\$__/_LF	\$__
b	10	V.F.	4' Dia. Manhole (base, cone & cover)	\$____/LF	\$__
***** ADDITIONAL WORK IF ORDERED BY THE OWNER OR ENGINEER *****					
ITEM B-17 – CONCRETE ENCASEMENT					
a	120	C.Y.	Concrete Encasement	\$____/CY	\$_____
ITEM B-18 - TRENCH ROCK EXCAVATION					
a	1000	C.Y.	Trench Rock Excavation	\$__/_CY	\$__
ITEM B-19 - TRENCH STABILIZATION					
a	1,000	C.Y.	Beyond Bedding	\$__/_CY	\$__
ITEM B-20 – TREE PROTECTION					
a	2,500	L.F.	Orange Safety Fence	\$__/_LF	\$__

ITEM B-21 - THRUST RESTRAINT

a 400 C.Y. Thrust Blocking & Collar including Reinf. \$\_\_\_/CY \$\_\_\_

**SEGMENT "B.1" SUBTOTAL – ITEMS B-1 THRU B-21-**

**ITEM B-22 CASH ALLOWNCES:**

a	Soils, Concrete, Asphalt and Materials Testing	\$ <u>50,000</u>
b	Construction Verification Surveying	\$ <u>25,000</u>
c	Blasting Monitoring	\$ <u>25,000</u>
d	Additional Landscaping (Not shown on Drawings)	\$ <u>25,000</u>
e	Utility Conflict Resolution	\$ <u>100,000</u>
f	Unforeseen Conditions	\$ <u>100,000</u>
g	Work to be directed by Owner	\$ <u>225,000</u>

**TOTAL – ITEMS (B-1 THRU B-21) + B-22** \$ \_\_\_\_\_

The Bidder agrees hereby to commence work under this Contract, with adequate personnel and equipment, on a date to be specified in a written order of the Contracting Officer and to fully complete all work under this Contract within 240 consecutive calendar days from and including said date.

The Bidder declares that he understands that the quantities shown for the unit prices items are subject to either increase or decrease, and that should the quantities of any of the items of work be increased, the Bidder proposes to do the additional work at the unit prices stated herein; and should the quantities be decreased, the Bidder also understands that payment will be made on the basis of actual quantities at the unit price bid and will make no claim for anticipated profits for any decrease in quantities; and that actual quantities will be determined upon completion of work, at which time adjustments will be made to the contract amount by direct increase or decrease.

In case of discrepancies between the figures shown in the unit prices and the totals, the unit prices shall apply and the totals shall be corrected to agree with the unit prices. In case of discrepancies between written amounts and figures, written amounts shall take precedence over figures and the sum of all Bid extensions (of unit prices) plus lump sum items shall take precedence over BID TOTAL.

The Bidder furthermore agrees that, in the case of a failure on his part to execute the Contract Agreement and Bonds within ten (10) days after receipt of conformed contract documents for execution, the Bid Bond accompanying his bid and the monies payable thereon shall be paid into the funds of the Owner as liquidated damages for such failure.

Enclosed is a Bid Bond in the approved form, in the sum of: \_\_\_\_\_  
\_\_\_\_\_(\$\_\_\_\_\_) according to the conditions of "Instructions to Bidders" and  
provisions thereof.

The undersigned acknowledges receipt of the following addenda (list by the number and date  
appearing on each addendum) and thereby affirms that its Bid considers and incorporates any  
modifications to the originally issued Bidding Documents included therein.

ADDENDUM # \_\_\_\_\_ DATED \_\_\_\_\_

END OF SECTION

**BID BOND**

No bid for a contract in Fulton County for work to be done shall be valid for any purpose unless the Contractor shall give a Bid Bond with good and sufficient surety payable to, in favor of, and for the protection of Fulton County. The Bid Bond shall not be less than 5% of the total amount payable by the terms of the Contract. No bid shall be read aloud or considered if a proper bid bond has not been submitted.

Surety companies executing Bonds must appear on the Treasury Department's most current list (Circular 570 as amended) and be authorized to transact business in the State of Georgia.

Attestation for the corporation must be by the corporate officer; for a partnership by another partner; for an individual by a notary with the corporate seal.

**BID BOND****W042 – ALPHARETTA WATER TRANSMISSION MAIN****FULTON COUNTY GOVERNMENT**

KNOW ALL MEN BY THESE PRESENTS, THAT WE \_\_\_\_\_  
hereinafter called the PRINCIPAL, and \_\_\_\_\_  
hereinafter call the SURETY, a corporation chartered and existing under the laws of the State of \_\_\_\_\_ and duly authorized to transact Surety business in the State of Georgia, are held and firmly bound unto the Fulton County Government (COUNTY), in the penal sum of \_\_\_\_\_ Dollars and Cents (\$ \_\_\_\_\_) good and lawful money of the United States of America, to be paid upon demand of the COUNTY, to which payment well and truly to be made we bind ourselves, our heirs, executors, and administrators and assigns, jointly and severally and firmly by these presents.

WHEREAS the PRINCIPAL has submitted to the COUNTY, for W042 – ALPHARETTA WATER TRANSMISSION MAIN, a Bid;

WHEREAS the PRINCIPAL desires to file this Bond in accordance with law:

NOW THEREFORE: The conditions of this obligation are such that if the Bid be accepted, the PRINCIPAL shall within ten (10) calendar days after receipt of written notification from the COUNTY of the award of the Contract execute the Contract in accordance with the Bid and upon the terms, conditions and prices set forth therein, in the form and manner required by the COUNTY, and execute sufficient and satisfactory Performance and Payments Bonds payable to the COUNTY, each in the amount of one hundred percent (100%) of the total contract price, in form and with security satisfactory to said COUNTY, then this obligation to be void; otherwise, to be and remain in full force and virtue in law; and the SURETY shall upon failure of the PRINCIPAL to comply with any or all of the foregoing requirements within the time specified above immediately pay to the COUNTY, upon demand the amount hereof in good and lawful money of the United States of America, not as a penalty, but as liquidated damages.

In the event suit is brought upon this Bond by the COUNTY and judgment is recovered, the SURETY shall pay all costs incurred by the COUNTY in such suit, including attorney's fees to be fixed by the Court.

Enclosed is a Bid Bond in the approved form, in the amount of \_\_\_\_\_  
\_\_\_\_\_ Dollars

(\$\_\_\_\_\_) being in the amount of five percent (5%) of the Contract Sum. The money payable on this bond shall be paid to the COUNTY, for the failure of the Bidder to execute a Contract within ten (10) days after receipt of the Contract and at the same time furnish a Payment Bond and Performance Bond.

(SIGNATURES ON NEXT PAGE)

IN TESTIMONY THEREOF, the PRINCIPAL and SURETY have caused these presents to be duly signed and sealed this \_\_\_\_\_ day of \_\_\_\_\_, 2011.

ATTEST:

\_\_\_\_\_  
PRINCIPAL

\_\_\_\_\_ BY \_\_\_\_\_

(SEAL)

**CERTIFICATE AS TO CORPORATE PRINCIPAL**

I, \_\_\_\_\_, certify that I am the Secretary of the Corporation named as principal in the within bond; that \_\_\_\_\_, who signed the said bond of said corporation; that I know this signature, and his/her signature thereto is genuine; and that said bond was duly signed, sealed and attested for in behalf of said Corporation by authority of its governing body.

\_\_\_\_\_  
SECRETARY

(CORPORATE SEAL)

\_\_\_\_\_  
SURETY

\_\_\_\_\_ BY \_\_\_\_\_

(SEAL)

**END OF SECTION**

## PURCHASING FORMS & INSTRUCTIONS

This section contains the procurement forms that are required to be executed and submitted with the bid package. This section does not contain all forms required to be included with the bid package submittal.

To be deemed responsive to this ITB, Bidders must provide the information requested and complete in detail all Purchasing Forms. The appropriate individual(s) authorized to commit the Bidder to the Project must sign the Purchasing Forms. Bidders should reproduce each Purchasing Form, as required, and complete the appropriate portions of the forms provided in this section.

- Form A: Non-Collusion Affidavit of Prime Bidder/Offeror
- Form B: Certificate of Acceptance of Request for Bid/Proposal Requirements
- Form C: Professional License Certifications
  - Form C1 – Georgia Utility License Contractor License
  - Form C2 – Georgia General Contractors License
  - Form C3 – Georgia Professional License
- Form D: Certification Regarding Debarment
- Form E: Disclosure Form and Questionnaire
- Form F: Georgia Security and Immigration Contractor Affidavit and Agreement
- Form G: Georgia Security and Immigration Subcontractor Affidavit

**FORM A: NON-COLLUSION AFFIDAVIT OF BIDDER/OFFEROR**

**STATE OF GEORGIA**

**COUNTY OF FULTON**

I, \_\_\_\_\_ certify that pursuant to Fulton County Code Section 2-320 (11), this bid or proposal is made without prior understanding, agreement or connection with any corporation, firm or person submitting a bid for the same work, labor or service to be done or the supplies, materials or equipment to be furnished and is in all respects fair and without collusion or fraud. I understand collusive bidding is a violation of state and federal law and can result in fines, prison sentences and civil damages awards. I agree to abide by all conditions of this bid or proposal and certify that I am authorized to sign this bid or proposal for the bidder.

Affiant further states that pursuant to O.C.G.A. Section 36-91-21 (d) and (e), \_\_\_\_\_ has not, by itself or with others, directly or indirectly, prevented or attempted to prevent competition in such bidding or proposals by any means whatsoever. Affiant further states that (s)he has not prevented or endeavored to prevent anyone from making a bid or offer on the project by any means whatever, nor has Affiant caused or induced another to withdraw a bid or offer for the work.

Affiant further states that the said offer of \_\_\_\_\_ is bona fide, and that no one has gone to any supplier and attempted to get such person or company to furnish the materials to the bidder only, or if furnished to any other bidder, that the material shall be at a higher price.

\_\_\_\_\_  
(COMPANY NAME)

\_\_\_\_\_  
(PRESIDENT/VICE PRESIDENT)

Sworn to and subscribed before me this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_.

\_\_\_\_\_  
(SECRETARY/ASSISTANT SECRETARY)

(Affix corporate seal here, if a corporation)

Notary Public: \_\_\_\_\_

County: \_\_\_\_\_

Commission Expires: \_\_\_\_\_

**NOTE:**

**IF THE OFFEROR IS A PARTNERSHIP, ALL OF THE PARTNERS AND ANY OFFICER, AGENT, OR OTHER PERSON WHO MAY HAVE REPRESENTED OR ACTED FOR THEM IN BIDDING FOR OR PROCURING THE CONTRACT SHALL ALSO MAKE THIS OATH.**

**IF THE OFFEROR IS A CORPORATION, ALL OFFICERS, AGENTS, OR OTHER PERSONS WHO MAY HAVE ACTED FOR OR REPRESENTED THE CORPORATION IN BIDDING FOR OR PROCURING THE CONTRACT SHALL MAKE THE OATH.**

**FORM B: FULTON COUNTY CERTIFICATE OF ACCEPTANCE OF BID/PROPOSAL REQUIREMENTS**

This Is To Certify That On This Day Bidder/Proposer Acknowledges That He/She Has Read This Bid Document, Pages \_\_\_\_\_ To \_\_\_\_\_ Inclusive, Including Addendum(s) \_\_\_\_ To \_\_\_\_, And/Or Appendices \_\_\_\_ To \_\_\_\_, In Its Entirety, And Agrees That No Pages Or Parts Of The Document Have Been Omitted, That He/She Understands, Accepts And Agrees To Fully Comply With The Requirements Therein, And That The Undersigned Is Authorized By The Bidding/Proposing Company To Submit The Bid/Proposal Herein And To Legally Obligate The Bidder/Proposer Thereto.

Company: \_\_\_\_\_

Signature: \_\_\_\_\_

Name: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

(Corporate Seal)

---

**FORM C1: CONTRACTOR'S GEORGIA UTILITY LICENSE CERTIFICATION**

Contractor's Name: \_\_\_\_\_

Utility Contractor's Name: \_\_\_\_\_

Expiration Date of License: \_\_\_\_\_

I certify that the above information is true and correct and that the classification noted is applicable to the Bid for this Project.

Signed: \_\_\_\_\_

Date: \_\_\_\_\_

**(ATTACH COPY OF LICENSE)**

**FORM C2: CONTRACTOR'S GEORGIA GENERAL CONTRACTOR'S LICENSE  
CERTIFICATION**

Contractor's Name: \_\_\_\_\_

General Contractor's License Number: \_\_\_\_\_

Expiration Date of License: \_\_\_\_\_

I certify that the above information is true and correct and that the classification noted is applicable to the Bid for this Project.

Signed:

\_\_\_\_\_

Date: \_\_\_\_\_

**(ATTACH COPY OF LICENSE)**

**FORM C3: GEORGIA PROFESSIONAL LICENSE CERTIFICATION**

**NOTE: Please complete this form for the work your firm will perform on this project.**

Contractor's Name: \_\_\_\_\_

Performing work as: Prime Contractor \_\_\_\_\_ Sub-Contractor \_\_\_\_\_

Professional License Type: \_\_\_\_\_

Professional License Number:  
\_\_\_\_\_

Expiration Date of License: \_\_\_\_\_

I certify that the above information is true and correct and that the classification noted is applicable to the Bid for this Project.

Signed:  
\_\_\_\_\_

Date: \_\_\_\_\_

**(ATTACH COPY OF LICENSE)**

**FORM D: CERTIFICATION REGARDING DEBARMENT**

- (1) The Offeror certifies that neither it or its subcontractors is presently debarred, suspended, proposed for debarment, declared ineligible, or otherwise excluded from doing business with any government agency. Any such exclusion may cause prohibition of your firm from participating in any procurement by the Fulton County Government.
- (2) If the Offeror is unable to certify to any of the statements in this certification, such Offeror or subcontractor shall attach an explanation to this bid or proposal.

***INSTRUCTIONS FOR CERTIFICATION***

By signing and submitting this certification, the Offeror is providing the certification set out below:

- (1) The certification in this clause is a material representation of fact upon which reliance will be placed. If it is later determined that the prospective vendor knowingly rendered a false certification, the Purchasing Agent may pursue all available remedies, including suspension and/or debarment, for withdrawal of award or termination of a contract.
- (2) The prospective Offeror shall provide immediate written notice to the Purchasing Agent if at anytime the Offeror learns that its certification was erroneous when submitted or has become erroneous by reason of changed circumstances.
- (3) Offeror shall be under a continuing duty to immediately inform the Purchasing Agent in writing of any changes, if as a result of such changes, the Offeror certification regarding debarment is affected.

***DEBARMENT ORDINANCE***

The following Section 2-322 of Fulton County Code of Laws establishes the procedure for the debarment of contractors.

**Authority to suspend.**

After reasonable notice to the entity involved and reasonable opportunity for that entity to be heard, the Purchasing Agent, after consultation with user department, the County Manager and the County Attorney shall have the authority to suspend an entity for cause from consideration for award of county contracts. As used in this section, the term entity means any business entity, individual, firm, contractor, subcontractor or business corporation, partnership, limited liability corporation, firm, contractor, subcontractor or business structured; provided, further, that any such entity shall also be subject to suspension under this section if any of its constituents, members, subcontractors at any tier of such entity's and the entity, or any constituent or member, knew or should have known of the commission of the act. The suspension shall be for a period not to exceed three (3) years unless cause is based on a felony conviction for an offense related or

associated with fraudulent contracting or misappropriation of funds wherein the suspension shall not exceed seven (7) years.

**Causes for Suspension. The causes for suspension include:**

- (1) Conviction for commission of a criminal offense as an incident to obtain or attempting to obtain a public or private contract or subcontract, or in performance of such contract or subcontract;
- (2) Conviction of state or federal statutes of embezzlement, theft, forgery, bribery, falsification or destruction of records, receiving stolen property or other offense indicating a lack of business integrity or business honesty which currently, seriously and directly affects responsibility as a county contractor.
- (3) Conviction of state or federal anti-trust statutes arising out of the solicitation and submission of bids and proposals;
- (4) Violation of contract provisions, as set forth below, of a character which is regarded by the Purchasing Agent to be so serious as to justify suspension action:
  - a. Failure to perform in accordance with the specifications within a time limit provided in a county contract;
  - b. A recent record of failure to perform or unsatisfactory performance in accordance with the terms of one or more contracts; provided, that failure to perform or unsatisfactory performance caused by acts beyond the control of the contractor shall not be considered to be a basis for suspension;
  - c. Material representation of the composition of the ownership or workforce or business entity certified to the county as a minority business enterprise; or
  - d. Falsification of any documents.
- (5) For violation of the ethical standards set forth in Fulton County Code Chapter 9, Code of Ethics.
- (6) Knowing misrepresentation to the county, of the use which a majority owned contractor intends to make a minority business enterprise (a business entity at least 51 percent of which is owned and controlled by minority persons, as defined in Fulton County Code Chapter 6, Article B, Minority Business Enterprise Affirmative Action Program and certified as such by the County) as a subcontractor or a joint venture partner, in performing work under contract with the County.

Failure to fully and truthfully provide the information required, may result in the disqualification of your bid/proposal from consideration or termination of the Contract, once awarded. This document must be completed and included as a part of the bid/proposal package along with other required documents.

[SIGNATURES ON NEXT PAGE]

Under penalty of perjury, I declare that I have examined this certification and all attachments hereto, if applicable, to the best of my knowledge and belief, and all statements contained hereto are true, correct, and complete.

On this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_

\_\_\_\_\_  
(Legal Name of Offeror) (Date)

\_\_\_\_\_  
(Signature of Authorized Representative) (Date)

\_\_\_\_\_  
(Title)

**FORM E: DISCLOSURE FORM AND QUESTIONNAIRE**

1. Please provide the names and business addresses of each of the Offeror's firm's officers and directors.

For the purposes of this form, the term "Offeror" means an entity that responds to a solicitation for a County contract by either submitting a proposal in response to a Request for Proposal or a Request for Qualification or a Bid in response to an Invitation to Bid.

Describe accurately, fully and completely, their respective relationships with said Offeror, including their ownership interests and their anticipated role in the management and operations of said Offeror.

2. Please describe the general development of said Offeror's business during the past five (5) years, or such shorter period of time that said Offeror has been in business.
3. Please state whether any employee, agent or representative of said Offeror who is or will be directly involved in the subject project has or had within the last five (5) years: (i) directly or indirectly had a business relationship with Fulton County; (ii) directly or indirectly received revenues from Fulton County; or (iii) directly or indirectly receives revenues from the result of conducting business on Fulton County property or pursuant to any contract with Fulton County. Please describe in detail any such relationship.

**LITIGATION DISCLOSURE:**

Failure to fully and truthfully disclose the information required, may result in the disqualification of your bid or proposal from consideration or termination of the Contract, once awarded.

1. Please state whether any of the following events have occurred in the last five (5) years with respect to said Offeror. If any answer is yes, explain fully the following:
  - (a) whether a petition under the federal bankruptcy laws or state insolvency laws was filed by or against said Offeror, or a receiver fiscal agent or similar officer was appointed by a court for the business or property of said Offeror;
  - (b) whether Offeror was subject of any order, judgment, or decree not subsequently reversed, suspended or vacated by any court of competent jurisdiction, permanently enjoining said Offeror from engaging in any type of business practice, or otherwise eliminating any type of business practice; and
  - (c) whether said Offeror's business was the subject of any civil or criminal proceeding in which there was a final adjudication adverse to said Offeror, which directly arose from activities conducted by the business unit or corporate division of said Offeror which submitted a bid or proposal for the subject project. If so please explain.
2. Have you or any member of your firm or team to be assigned to this engagement been indicted or convicted of a criminal offense within the last five (5) years?

Circle One:            YES                            NO

3. Have you or any member of your firm or team ever been terminated (for cause or otherwise) from any work being performed for Fulton County or any other Federal, State or Local Government?

Circle One:            YES                            NO

4. Have you or any member of your firm or team been involved in any claim or litigation adverse to Fulton County or any other Federal, State or Local Government, or private entity during the last three (3) years?

Circle One:            YES                            NO

5. Has any offeror, member of offeror's team, or officer of any of them (with respect to any matter involving the business practices or activities of his or her employer), been notified within the five (5) years preceding the date of this offer that any of them are the target of a criminal investigation, grand jury investigation, or civil enforcement proceeding?

Circle One:            YES                            NO

If you have answered "YES" to any of the above questions, please indicate the name(s) of the person(s), the nature, and the status and/or outcome of the information, indictment, conviction, termination, claim or litigation, the name of the court and the file or reference number of the case, as applicable. Any such information should be provided on a separate page, attached to this form and submitted with your proposal.

**NOTE: If any response to any question set forth in this questionnaire has been disclosed in any other document, a response may be made by attaching a copy of such disclosure. (For example, said Offeror's most recent filings with the Securities and Exchange Commission ("SEC") may be provided if they are responsive to certain items within the questionnaire.) However, for purposes of clarity, Offeror should correlate its responses with the exhibits by identifying the exhibit and its relevant text.**

Disclosures must specifically address, completely respond and comply with all information requested and fully answer all questions requested by Fulton County. Such disclosure must be submitted at the time of the bid or proposal submission and included as a part of the bid/proposal submitted for this project. Disclosure is required for Offerors, joint venture partners and first-tier subcontractors.

Failure to provide required disclosure, submit officially signed and notarized documents or respond to any and all information requested/required by Fulton County can result in the bid/proposal declared as non-responsive. This document must be completed and included as a part of the bid/proposal package along with other required documents.

[SIGNATURES ON NEXT PAGE]

Under penalty of perjury, I declare that I have examined this questionnaire and all attachments hereto, if applicable, to the best of my knowledge and belief, and all statements contained hereto are true, correct, and complete.

On this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_

\_\_\_\_\_  
(Legal Name of Proponent) (Date)

\_\_\_\_\_  
(Signature of Authorized Representative) (Date)

\_\_\_\_\_  
(Title)

**Sworn to and subscribed before me,**

this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_

\_\_\_\_\_  
(Notary Public) (Seal)

Commission Expires \_\_\_\_\_  
(Date)

**FORM F: GEORGIA SECURITY AND IMMIGRATION CONTRACTOR AFFIDAVIT AND AGREEMENT****Instructions:**

Contractors must attest to compliance with the requirements of O.C.G.A 13-10-91 and the Georgia Department of Labor Rule 300-10-01-.02 by executing the Contractor Affidavit provided. The affidavit should be executed by Contractors who have indicated on Form F, Declaration of Employee-Number Categories, that they have 100 or more employees.

STATE OF GEORGIA

COUNTY OF FULTON

**FORM F: GEORGIA SECURITY AND IMMIGRATION CONTRACTOR AFFIDAVIT AND AGREEMENT**

By executing this affidavit, the undersigned contractor verifies its compliance with O.C.G.A. 13-10-91, stating affirmatively that the individual, firm or corporation which is engaged in the physical performance of services under a contract with **[insert name of prime contractor]** \_\_\_\_\_ on behalf of **Fulton County Government** has registered with and is participating in a federal work authorization program\* [any of the electronic verification of work authorization programs operated by the United States Department of Homeland Security or any equivalent federal work authorization program operated by the United States Department of Homeland Security to verify information of newly hired employees, pursuant to the Immigration Reform and Control Act of 1986 (IRCA), P.L. 99-603], in accordance with the applicability provisions and deadlines established in O.C.G.A. 13-10-91.

The undersigned further agrees that, should it employ or contract with any subcontractor(s) in connection with the physical performance of services to this contract with **Fulton County Government**, contractor will secure from such subcontractor(s) similar verification of compliance with O.C.G.A/ 13-10-91 on the Subcontractor Affidavit provided in Rule 300-10-01-.08 or a substantially similar form. Contractor further agrees to maintain records of such compliance and provide a copy of each such verification to the **Fulton County Government** at the time the subcontractor(s) is retained to perform such service.

\_\_\_\_\_  
EEV/Basic Pilot Program\* User Identification Number

\_\_\_\_\_  
BY: Authorized Officer of Agent  
(Insert Subcontract Name)

\_\_\_\_\_  
Title of Authorized Officer or Agent of Subcontractor

\_\_\_\_\_  
Printed Name of Authorized Officer or Agent

Sworn to and subscribed before me this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_.

Notary Public: \_\_\_\_\_

County: \_\_\_\_\_

Commission Expires: \_\_\_\_\_

**NOTE:**

\* As of the effective date of O.C.G.A. 13-10-91, the applicable federal work authorization program is the "EEV/Basic Pilot Program" operated by the U.S. Citizenship and Immigration Services Bureau of the U.S. Department of Homeland Security, in conjunction with the Social Security Administration (SSA).

**FORM G: GEORGIA SECURITY AND IMMIGRATION SUBCONTRACTOR AFFIDAVIT****Instructions:**

In the event that your company is awarded the contract for this project, and will be utilizing the services of any subcontractor(s) in connection with the physical performance of services pursuant to this contract, the following affidavit must be completed by such subcontractor(s). Your company must provide a copy of each such affidavit to Fulton County Government, Department of Purchasing & Contract Compliance with the proposal submittal.

All subcontractor affidavit(s) shall become a part of the contract and all subcontractor(s) affidavits shall be maintained by your company and available for inspection by Fulton County Government at any time during the term of the contract. All subcontractor(s) affidavit(s) shall become a part of any contractor/subcontractor agreement(s) entered into by your company.

STATE OF GEORGIA

COUNTY OF FULTON

**FORM G: GEORGIA SECURITY AND IMMIGRATION SUBCONTRACTOR  
AFFIDAVIT**

By executing this affidavit, the undersigned subcontractor verifies its compliance with O.C.G.A. 13-10-91, stating affirmatively that the individual, firm or corporation which is engaged in the physical performance of services under a contract with **[insert name of prime contractor]** \_\_\_\_\_ behalf of **Fulton County Government** has registered with and is participating in a federal work authorization program\* [any of the electronic verification of work authorization programs operated by the United States Department of Homeland Security or any equivalent federal work authorization program operated by the United States Department of Homeland Security to verify information of newly hired employees, pursuant to the Immigration Reform and Control Act of 1986 (IRCA), P.L. 99-603], in accordance with the applicability provisions and deadlines established in O.C.G.A. 13-10-91.

\_\_\_\_\_  
EEV/Basic Pilot Program\* User Identification Number

\_\_\_\_\_  
BY: Authorized Officer of Agent  
(Insert Subcontract Name)

\_\_\_\_\_  
Title of Authorized Officer or Agent of Subcontractor

\_\_\_\_\_  
Printed Name of Authorized Officer or Agent

Sworn to and subscribed before me this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_.

Notary Public: \_\_\_\_\_

County: \_\_\_\_\_

Commission Expires: \_\_\_\_\_

**NOTE:**

\* As of the effective date of O.C.G.A. 13-10-91, the applicable federal work authorization program is the "EEV/Basic Pilot Program" operated by the U.S. Citizenship and Immigration Services Bureau of the U.S. Department of Homeland Security, in conjunction with the Social Security Administration (SSA).

**END OF SECTION**

## CONTRACT COMPLIANCE REQUIREMENTS

### ***NON-DISCRIMINATION IN CONTRACTING AND PROCUREMENT***

**Policy Statement:** It is the policy of Fulton County Government that discrimination against businesses by reason of the race, color, gender or national origin of the ownership of any such business is prohibited. Furthermore, it is the policy of the Board of Commissioners (“Board”) that Fulton County and all vendors and contractors doing business with Fulton County shall provide to all businesses the opportunity to participate in contracting and procurement paid, in whole or in part, with monetary appropriations of the Board. Similarly, it is the policy of the Board that the contracting and procurement practices of Fulton County should not implicate Fulton County as either an active or passive participant in the discriminatory practices engaged in by private contractors seeking to obtain contracts with Fulton County.

**Equal Business Opportunity Plan (EBO Plan):** In addition to the proposal submission requirements, each vendor **must** submit an Equal Business Opportunity Plan (EBO Plan) with their bid/proposal. The EBO Plan is designed to enhance the utilization of a particular racial, gender or ethnic group by a bidder/proposer, contractor, or vendor or by Fulton County. The respondent **must** outline a plan of action to encourage and achieve diversity and equality in the available procurement and contracting opportunities with *this solicitation*.

The EBO Plan **must** identify and include:

1. Potential opportunities within the scope of work of *this solicitation* that will allow for participation of racial, gender or ethnic groups.
2. Efforts that will be made by the bidder/proposer to encourage and solicit minority and female business utilization in this solicitation.

Fulton County encourages joint ventures, teaming, partnering and mentor-protégé relationships with minority and female businesses in an effort to achieve contracting and procurement diversity.

**Prompt Payment:** The prime contractor must certify in writing and must document on the Exhibit G Form (Prime Contractor/Subcontractor Utilization Report) that all subcontractors, sub-consultants and suppliers have been promptly paid for work and materials, (less any retainage by the prime contractor prior to receipt of any further progress payments). In the event the prime contractor is unable to pay subcontractors, sub-consultants or suppliers until it has received a progress payment from Fulton County, the prime contractor shall pay all subcontractors, sub-consultants or suppliers funds due from said progress payments within forty-eight (48) hours of receipt of payment from Fulton County. In no event shall a subcontractor, sub-consultant or supplier be paid later than fifteen (15) days as provided for by state law.

**REQUIRED FORMS AND EBO PLAN:**

In order to be compliant with the intent and provisions of the Fulton County Non-Discrimination in Purchasing and Contracting Ordinance (99-0960), bidders/proposers must submit the following completed documents. Failure to provide this information shall result in the bid/proposal being deemed non-responsive:

- **Exhibit A** - Promise of Non-Discrimination (for Prime and each Sub-contractor)
- **Exhibit B** - Employment Report (for Prime and each Sub-contractor)
- **Exhibit C** - Schedule of Intended Subcontractor Utilization
- **Exhibit D** - Letter of Intent to Perform As a Subcontractor or Provide Materials or Services
- **Exhibit E** - Declaration Regarding Subcontractor Practices
- **Exhibit F** - Joint Venture Disclosure Affidavit
- **Equal Business Opportunity Plan (EBO Plan)** – This document is not a form. It is a statement created by the bidder/proposer on its company letter head addressing the EBO Plan requirements.
- **Exhibit H** – First Source Jobs Program Information, Form 2

All Contract Compliance documents (Exhibits A – F and EBO Plan) are to be placed in a **separate sealed envelope** clearly marked “Contract Compliance”. The EBO Plan must be submitted on company letterhead. These documents are considered part of and should be submitted with the Technical Proposal.

The following document must be completed as instructed if awarded the bid:

- **Exhibit G** - Prime Contractor’s Subcontractor Utilization Report
- **Exhibit H** – First Source Jobs Program Agreement, Form 3

**EXHIBIT A – PROMISE OF NON-DISCRIMINATION**

“Know all persons by these presents, that I/WE ( \_\_\_\_\_ ),  
Name

\_\_\_\_\_  
Title

\_\_\_\_\_  
Firm Name

Hereinafter “Company”), in consideration of the privilege to bid on or obtain contracts funded, in whole or in part, by Fulton County, hereby consent, covenant and agree as follows:

- (1) No person shall be excluded from participation in, denied the benefit of, or otherwise discriminated against on the basis of race, color, national origin or gender in connection with any bid submitted to Fulton County for the performance of any resulting there from,
- (2) That it is and shall be the policy of this Company to provide equal opportunity to all businesses seeking to contract or otherwise interested in contracting with this Company without regard to the race, color, gender or national origin of the ownership of this business,
- (3) That the promises of non-discrimination as made and set forth herein shall be continuing in nature and shall remain in full force and effect without interruption,
- (4) That the promise of non-discrimination as made and set forth herein shall be made a part of, and incorporated by reference into, any contract or portion thereof which this Company may hereafter obtain,
- (5) That the failure of this Company to satisfactorily discharge any of the promises of non-discrimination as made and set forth herein shall constitute a material breach of contract entitling the Board to declare the contract in default and to exercise any and all applicable rights and remedies, including but not limited to cancellation of the contract, termination of the contract, suspension and debarment from future contracting opportunities, and withholding and/or forfeiture of compensation due and owing on a contract; and
- (6) That the bidder shall provide such information as may be required by the Director of Contract Compliance pursuant to Section 4.4 of the Fulton County Non-Discrimination in Purchasing and Contracting Ordinance.

SIGNATURE: \_\_\_\_\_

ADDRESS: \_\_\_\_\_

\_\_\_\_\_

TELEPHONE NUMBER: \_\_\_\_\_

**BLANK PAGE**

<b>EXHIBIT B - EMPLOYMENT REPORT</b>																		
The demographic employment make-up for the bidder <b>must</b> be identified and submitted with this bid/proposal. In addition, if subcontractors will be utilized by the bidder/proposer to complete this project, then the demographic employment make-up of the subcontractor(s) must be identified and submitted with this bid.																		
JOB CATEGORIES	TOTAL EMPLOYED		TOTAL MINORITIES		WHITE (Not of Hispanic Origin)		BLACK or AFRICAN AMERICAN (Not of Hispanic Origin)		HISPANIC or LATINO		AMERICAN INDIAN or ALASKAN NATIVE (AIAN)		ASIAN		NATIVE HAWAIIAN or OTHER PACIFIC ISLANDER (NHOP)		TWO or MORE RACES	
	M	F	M	F	M	F	M	F	M	F	M	F	M	F	M	F	M	F
EXECUTIVE/SENIOR LEVEL OFFICIALS and MANAGERS																		
FIRST/MID LEVEL OFFICIALS and MANAGERS																		
PROFESSIONALS																		
TECHNICIANS																		
SALES WORKERS																		
ADMINISTRATIVE SUPPORT WORKERS																		
CRAFT WORKERS																		
OPERATIVES																		
LABORERS & HELPERS																		
SERVICE WORKERS																		
<b>TOTAL</b>																		

FIRM'S NAME: \_\_\_\_\_

ADDRESS: \_\_\_\_\_

TELEPHONE NUMBER: \_\_\_\_\_

This completed form is for (Check one) \_\_\_\_\_ Bidder/Proposer \_\_\_\_\_ Subcontractor

Submitted by: \_\_\_\_\_ Date Completed: \_\_\_\_\_

**BLANK PAGE**

**EXHIBIT C – SCHEDULE OF INTENDED SUBCONTRACTOR UTILIZATION**

If the bidder/proposer intends to subcontract any portion of this scope of work/service(s), this form **must be** completed and **submitted with the bid/proposal**. All prime bidders/proposers **must** include Letter(s) of Intent (Exhibit D) in the bid document for all subcontractors who will be utilized under the scope of work/services.

**Prime Bidder/Proposer:** \_\_\_\_\_

**ITB/RFP NUMBER:** \_\_\_\_\_

**Project Name or Description of Work/Service(s):** \_\_\_\_\_

\_\_\_\_\_  
\_\_\_\_\_

1. My firm, as Prime Bidder/Proposer on this scope of work/service(s) is \_\_\_\_\_ is not a minority or female owned and controlled business. (Please indicate below the portion of work, including, percentage of bid amount that your firm will carry out directly):

\_\_\_\_\_  
\_\_\_\_\_

If the Prime Bidder/Proposer is a Joint Venture, please complete Exhibit F: Joint Venture Disclosure Affidavit and attach a copy of the executed Joint Venture Agreement.

2. Sub-Contractors (Including suppliers) to be utilized in the performance of this scope of work/service(s), if awarded, are:

**SUBCONTRACTOR NAME:** \_\_\_\_\_

**ADDRESS:** \_\_\_\_\_

\_\_\_\_\_

**PHONE:** \_\_\_\_\_

**CONTACT PERSON:** \_\_\_\_\_

**ETHNIC GROUP\*:** \_\_\_\_\_ **COUNTY CERTIFIED\*\*** \_\_\_\_\_

**WORK TO BE PERFORMED:** \_\_\_\_\_

\_\_\_\_\_

**DOLLAR VALUE OF WORK: \$** \_\_\_\_\_

**PERCENTAGE VALUE:** \_\_\_\_\_ %

**\*Ethnic Groups: African American (AABE); Asian American (ABE); Hispanic American (HBE); Native American (NABE); White Female American (WFBE);**

**\*\*If yes, attach copy of recent certification letter.**

**EXHIBIT C – SCHEDULE OF INTENDED SUBCONTRACTOR UTILIZATION**

SUBCONTRACTOR NAME: \_\_\_\_\_

ADDRESS: \_\_\_\_\_

PHONE: \_\_\_\_\_

CONTACT PERSON: \_\_\_\_\_

ETHNIC GROUP\*: \_\_\_\_\_ COUNTY CERTIFIED\*\* \_\_\_\_\_

WORK TO BE PERFORMED: \_\_\_\_\_

DOLLAR VALUE OF WORK: \$ \_\_\_\_\_ PERCENTAGE VALUE: \_\_\_\_\_ %

SUBCONTRACTOR NAME: \_\_\_\_\_

ADDRESS: \_\_\_\_\_

PHONE: \_\_\_\_\_

CONTACT PERSON: \_\_\_\_\_

ETHNIC GROUP\*: \_\_\_\_\_ COUNTY CERTIFIED\*\* \_\_\_\_\_

WORK TO BE PERFORMED: \_\_\_\_\_

DOLLAR VALUE OF WORK: \$ \_\_\_\_\_ PERCENTAGE VALUE: \_\_\_\_\_ %

SUBCONTRACTOR NAME: \_\_\_\_\_

ADDRESS: \_\_\_\_\_

PHONE: \_\_\_\_\_

CONTACT PERSON: \_\_\_\_\_

ETHNIC GROUP\*: \_\_\_\_\_ COUNTY CERTIFIED\*\* \_\_\_\_\_

WORK TO BE PERFORMED: \_\_\_\_\_

DOLLAR VALUE OF WORK: \$ \_\_\_\_\_ PERCENTAGE VALUE: \_\_\_\_\_ %

SUBCONTRACTOR NAME: \_\_\_\_\_

ADDRESS: \_\_\_\_\_

PHONE: \_\_\_\_\_

CONTACT PERSON: \_\_\_\_\_

ETHNIC GROUP\*: \_\_\_\_\_ COUNTY CERTIFIED\*\* \_\_\_\_\_

WORK TO BE PERFORMED: \_\_\_\_\_

DOLLAR VALUE OF WORK: \$ \_\_\_\_\_ PERCENTAGE VALUE: \_\_\_\_\_ %

**\*Ethnic Groups: African American (AABE); Asian American (ABE); Hispanic American (HBE); Native American (NABE); White Female American (WFBE); \*\*If yes, attach copy of recent certification letter.**

**EXHIBIT C – SCHEDULE OF INTENDED SUBCONTRACTOR UTILIZATION**

**Total Dollar Value of Subcontractor Agreements: (\$)**

**Total Percentage Value: (%)**

**CERTIFICATION:** The undersigned certifies that he/she has read, understands and agrees to be bound by the Bid provisions, including the accompanying Exhibits and other terms and conditions regarding sub-contractor utilization. The undersigned further certifies that he/she is legally authorized by the Bidder to make the statement and representation in this Exhibit and that said statements and representations are true and correct to the best of his/her knowledge and belief. The undersigned understands and agrees that if any of the statements and representations are made by the Bidder knowing them to be false, or if there is a failure of the intentions, objectives and commitments set forth herein without prior approval of the County, then in any such event the Contractor’s acts or failure to act, as the case may be, shall constitute a material breach of the contract, entitling the County to terminate the Contract for default. The right to so terminate shall be in addition to, and in lieu of, any other rights and remedies the County may have for other defaults under the contract.

Signature/Title: \_\_\_\_\_

Firm or Corporate Name: \_\_\_\_\_

Address: \_\_\_\_\_

\_\_\_\_\_

Telephone: (    ) \_\_\_\_\_

Fax Number: (    ) \_\_\_\_\_

Email Address: \_\_\_\_\_

**EXHIBIT D**

**LETTER OF INTENT TO PERFORM AS A SUBCONTRACTOR**

**OR**

**PROVIDE MATERIALS OR SERVICES**

This form must be completed by ALL known subcontractors/suppliers and submitted with the bid. The Prime Contractor must submit Letters of Intent for ALL known subcontractors/suppliers at time of bid submission.

**To:** \_\_\_\_\_  
 (Name of Prime Contractor Firm)

**From:** \_\_\_\_\_  
 (Name of Subcontractor Firm)

**ITB/RFP Number:** \_\_\_\_\_

**Project Name:** \_\_\_\_\_

The undersigned is prepared to perform the following described work or provide materials or services in connection with the above project (specify in detail particular work items, materials, or services to be performed or provided):

Description of Work	Project Commence	Project Completion	Estimated Amount

\_\_\_\_\_  
 (Prime Bidder)

\_\_\_\_\_  
 (Subcontractor)

Signature \_\_\_\_\_ Signature \_\_\_\_\_

Title \_\_\_\_\_ Title \_\_\_\_\_

Date \_\_\_\_\_ Date \_\_\_\_\_

**EXHIBIT E – DECLARATION REGARDING SUBCONTRACTING PRACTICES**

If the bidder/proposer **does not intend to subcontract** any portion of the scope of work services(s), this form **must be** completed and submitted with the bid.

\_\_\_\_\_ Hereby declares that it is my/our intent to  
**(Bidder)**

Perform 100% of the work required for \_\_\_\_\_  
**(IFB/RFP Number)**

\_\_\_\_\_  
**(Description of Work)**

In making this declaration, the bidder/proposer states the following:

1. That the bidder does not customarily subcontract elements of this type project, and normally performs and has the capability to perform and will perform **all elements** of the work on this project with his/her own current work forces;
2. If it should become necessary to subcontract some portion of the work at a later date, the bidder will comply with all requirements of the County's Non-Discrimination Ordinance in providing equal opportunities to all firms to subcontract the work. The determination to subcontract some portion of the work at a later date shall be made in good faith and the County reserves the right to require additional information to substantiate a bidder's decision to subcontract work following the award of the contract. Nothing contained in this provision shall be employed to circumvent the spirit and intent of the County's Non-Discrimination Ordinances;
3. The bidder will provide, upon request, information sufficient for the County to verify Item Number one.

**AUTHORIZED COMPANY REPRESENTATIVE**

**Name:** \_\_\_\_\_ **Title:** \_\_\_\_\_ **Date:** \_\_\_\_\_

**Signature:** \_\_\_\_\_

**Firm:** \_\_\_\_\_

**Address:** \_\_\_\_\_

**Phone Number:** \_\_\_\_\_

**Fax Number:** \_\_\_\_\_

**Email Address:** \_\_\_\_\_

**EXHIBIT F – JOINT VENTURE DISCLOSURE AFFIDAVIT**

**IFB No.** \_\_\_\_\_

**Project Name** \_\_\_\_\_

This form must be completed and submitted with the bid if a Joint Venture approach is to be undertaken.

The firms listed below do hereby declare that they have entered into a joint venture agreement pursuant to the above mentioned project. The information requested below is to clearly identify and explain the extent of participation of each firm in the proposed joint venture. All items must be properly addressed before the business entity can be evaluated.

1. Firms:

1) Name of Business: \_\_\_\_\_

Street Address: \_\_\_\_\_

City/State/Zip: \_\_\_\_\_

County: \_\_\_\_\_

Nature of Business: \_\_\_\_\_

2) Name of Business: \_\_\_\_\_

Street Address: \_\_\_\_\_

City/State/Zip: \_\_\_\_\_

County: \_\_\_\_\_

Nature of Business: \_\_\_\_\_

3) Name of Business: \_\_\_\_\_

Street Address: \_\_\_\_\_

City/State/Zip: \_\_\_\_\_

County: \_\_\_\_\_

Nature of Business: \_\_\_\_\_

**NAME OF JOINT VENTURE (If applicable):** \_\_\_\_\_

**OFFICE ADDRESS:** \_\_\_\_\_

**PRINCIPAL OFFICE:** \_\_\_\_\_

**OFFICE PHONE:** \_\_\_\_\_

**EXHIBIT F – JOINT VENTURE DISCLOSURE AFFIDAVIT CONTINUED**

Note: Attach additional sheets as required

2. Describe the capital contributions by each joint venturer and accounting thereof. Indicate the percentage make-up for each joint venture partner.
3. Describe the financial controls of the joint venture, e.g., will a separate cost center be established? Which venturer will be responsible for keeping the books? How will the expense therefore be reimbursed? What is the authority of each joint venture to commit or obligate the order?
4. Describe any Ownership, options for Ownership, or loans between the joint ventures. Identify terms thereof.
5. Describe the estimate contract cash flow for each joint venturer.
6. To what extent and by whom will the on-site work be supervised?
7. To what extent and by whom will the administrative office be supervised?
8. Which joint venturer will be responsible for material purchases including the estimated cost thereof? How will the purchase be financed?
9. Which joint venturer will provide equipment? What is the estimated cost thereof? How will the equipment be financed?
10. Describe the experience and business qualifications of each joint venturer.
11. Submit a copy of all joint venture agreements and evidence of authority to do business in the State of Georgia as well as locally, to include all necessary business licenses.
12. Percent of ownership by each joint venture in terms of profit and loss sharing: \_\_\_\_\_  
\_\_\_\_\_
13. The authority of each joint venturer to commit or obligate the other: \_\_\_\_\_  
\_\_\_\_\_
14. Number of personnel to be involved in project, their crafts and positions and whether they are employees of the small business enterprise, the majority firm or the joint venture: \_\_\_\_\_  
\_\_\_\_\_

**EXHIBIT F – JOINT VENTURE DISCLOSURE AFFIDAVIT CONTINUED**

15. Identification of control and participation in venture; list those individuals who are responsible for day-to-day management and policy decision-maker, including, but not limited to, those with prime responsibility for areas designated below; (use additional sheets if necessary)

<u>Name</u> <u>Operation</u>	<u>Race</u>	<u>Sex</u>	<u>Financial</u> <u>Decisions</u>	<u>Supervision</u> <u>Field</u>
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____

In connection with any work that these firms, as a joint venture, might be authorized to perform in connection with above captioned contract, we each do hereby authorize representatives of the Fulton County Department of Purchasing and Contract Compliance and Departments of Finance, under the direction of the County Manger's Office, to examine, from time to time, the books, records and files to the extent that such relate to this County project.

**WE DO SOLEMNLY DECLARE AND AFFIRM UNDER THE PENALTIES OF PERJURY THAT THE CONTENTS OF THE FOREGOING DOCUMENT ARE TRUE AND CORRECT, AND THAT WE ARE AUTHORIZED, ON BEHALF OF THE ABOVE FIRMS, TO MAKE THIS AFFIDAVIT AND GRANT THE ABOVE PRIVILEGE.**

FOR: \_\_\_\_\_  
(Company)

Date: \_\_\_\_\_

\_\_\_\_\_  
(Signature of Affiant)

\_\_\_\_\_  
(Printed Name)

\_\_\_\_\_  
(Company)

Date: \_\_\_\_\_

\_\_\_\_\_  
(Signature of Affiant)

\_\_\_\_\_  
(Printed Name)

State of \_\_\_\_\_ :

County of \_\_\_\_\_:

On this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_, before me, appeared \_\_\_\_\_, the undersigned known to me to be the person described in the foregoing Affidavit and acknowledge that he (she) executed the same in the capacity therein stated and for the purpose therein contained.

**EXHIBIT G – PRIME CONTRACTOR/SUBCONTRACTOR UTILIZATION REPORT**

This report is required to be submitted by the tenth day of each month, with a copy of your payment invoice (schedule of values/payment application) to Contract Compliance. Failure to comply may result in the County commencing proceedings to impose sanctions on the successful bidder, in addition to purchasing any other available legal remedy. Sanctions may include the suspending of any payment or part thereof, termination or cancellation of the contract, and the denial to participate in any future contracts awarded by Fulton County.

REPORTING PERIOD		PROJECT NAME:	
FROM:		PROJECT NUMBER:	
TO:		PROJECT LOCATION:	

PRIME CONTRACTOR		Contract Award Date	Contract Award Amount	Change Order Amount	Contract Period	% Complete to Date
Name:						
Address:						
Telephone #:						

AMOUNT OF REQUISITION THIS PERIOD: \$ \_\_\_\_\_  
 TOTAL AMOUNT REQUISITION TO DATE: \$ \_\_\_\_\_  
 TOTAL AMOUNT REQUISITION TO DATE: \$ \_\_\_\_\_

**SUBCONTRACTOR UTILIZATION** (add additional rows as necessary)

Name of Sub-contractor	Description of Work	Contract Amount	Amount Paid To Date	Amount Requisition This Period	Contract Period	
					Starting Date	Ending Date
TOTALS						

Executed By: \_\_\_\_\_  
(Signature)

\_\_\_\_\_ (Printed Name)

**Should you have questions regarding any of the documents contained in Section 6, please feel free to contact the Office of Contract Compliance at (404) 612-6300, for further assistance.**

**EXHIBIT H****FULTON COUNTY FIRST SOURCE JOBS PROGRAM****STATEMENT OF POLICY:**

It is the policy of Fulton County Government to provide employment opportunities to the citizens of Fulton County. This policy will apply to all contracts procured through the Department of Purchasing & Contract Compliance valued in excess of \$200,000. The Prime Contractor is expected to utilize the First Source Jobs Program to fill 50% of the entry level jobs which arise as a result of any project funded in whole or in part with County funds with residents of Fulton County.

**PURPOSE:**

The purpose of this policy is to create a pool of employable persons who are residents of Fulton County to be called upon as a source to fill jobs created as a result of any eligible project funded in whole or in part with County funds in order to provide stable economic opportunities for families throughout the County. The First Source Jobs Program will be implemented by the Department of Purchasing & Contract Compliance and the Office of Workforce Development.

**MONITORING POLICY:**

Upon execution of a contract with Fulton County Government, the First Source Jobs Agreement (FSJ Form 2) will become a part of the contract between the bidder/proposer and Fulton County Government. The First Source Jobs Program will be monitored during routine site visits by the Office of Contract Compliance along with the Office of Workforce Development.

**FORM 1**

**FULTON COUNTY**

**First Source Jobs Program Information**

Company Name: \_\_\_\_\_

Project Number: \_\_\_\_\_

Project Name: \_\_\_\_\_

The following entry-level positions will become available as a result of the above referenced contract with Fulton County.

1. \_\_\_\_\_
2. \_\_\_\_\_
3. \_\_\_\_\_
4. \_\_\_\_\_
5. \_\_\_\_\_
6. \_\_\_\_\_

Include a job description and all required qualifications for each position listed above.

Identify a company representative and contact phone number who will be responsible for coordinating with the First Source Jobs Program:

Company Representative: \_\_\_\_\_

Phone Number: \_\_\_\_\_

Email Address: \_\_\_\_\_

**FORM 2**

**FULTON COUNTY**

**First Source Jobs Program Agreement**

Awarded Contractor's Name: \_\_\_\_\_

Formal Contract Name: \_\_\_\_\_

RFP/ITB Number: \_\_\_\_\_

Contact Person: \_\_\_\_\_

Contact Phone: \_\_\_\_\_

The contractor listed above agrees to the following:

1. The contractor shall make a good faith effort to fill 50% of the entry level position(s) created by this project using the Fulton County First Source Jobs Program.
2. The contractor shall provide the applicable details of every entry level job in writing within the required form.
3. The contractor shall be expected to present documentation that confirms employment terms to both the employee and Fulton County.

The Office of Contract Compliance will assist with monitoring the participation of First Source Jobs Program employees during routine site visits and report findings to the Office of Workforce Development for confirmation and follow-up. The Office of Workforce Development shall notify the Director of Human Services and the Purchasing Agent of any determination of non-compliance with the requirements of this policy and recommend a resolution or action to be taken.

Upon a determination by the Purchasing Agent and the Director of Human Services that a contractor has failed to comply with any portion of this policy, the County may impose the following:

1. Ten percent (10%) of all future payments under the involved eligible project shall be entitled to be withheld from a contractor that has violated this policy until the contractor complies with the provisions of this policy.

The undersigned agrees to the terms and conditions set forth in this agreement.

Contractor's Official Title: \_\_\_\_\_ Date: \_\_\_\_\_

Contractor's Name: \_\_\_\_\_

Contractor's Signature: \_\_\_\_\_

**FORM 3**

**END OF SECTION**

**Insurance and Risk Management Provisions  
Alpharetta Water Transmission Main**

It is Fulton County Government’s practice to obtain Certificates of Insurance from our Contractors and Vendors. Insurance must be written by a licensed agent in a company licensed to write insurance in the State of Georgia, with an A.M. Best rating of at least A-VI, subject to final approval by Fulton County. Respondents shall submit with the bid/proposal evidence of insurability satisfactory to Fulton County Government as to form and content. Either of the following forms of evidence is acceptable:

- A letter from an insurance carrier stating that upon your firm/company being the successful Bidder/Respondent that a Certificate of Insurance shall be issued in compliance with the Insurance and Risk Management Provisions outlined below.
- A Certificate of Insurance complying with the Insurance and Risk Management Provisions outlined below (Request for Bid/Proposal number and Project Name, Number and Description must appear on the Certificate of Insurance).
- A combination of a specific policy written with an umbrella policy covering liabilities in excess of the required limits is acceptable to achieve the applicable insurance coverage levels.

Upon award, the Contractor/Vendor must maintain at their expense, insurance with policy limits equal to or greater than the limits described below. Proof of insurance must be provided to Fulton County Government prior to the start of any activities/construction as described in the bid document(s). Any and all Insurance Coverage(s) and Bonds required under the terms and conditions of the contract shall be maintained during the entire length of the contract, including any extensions or renewals thereto, and until all work has been completed to the satisfaction of Fulton County Government.

**Accordingly the Respondent shall provide a certificate evidencing the following:**

**1. WORKERS COMPENSATION/EMPLOYER’S LIABILITY INSURANCE – STATUTORY (In compliance with the Georgia Workers Compensation Acts, including but not limited to U.S. Longshoremen and Harbor Workers Act and any other State or Federal Acts or Provisions in which jurisdiction may be granted)**

- 2.
- |                                |             |               |             |
|--------------------------------|-------------|---------------|-------------|
| Employer’s Liability Insurance | BY ACCIDENT | EACH ACCIDENT | \$1,000,000 |
| Employer’s Liability Insurance | BY DISEASE  | POLICY LIMIT  | \$1,000,000 |
| Employer’s Liability Insurance | BY DISEASE  | EACH EMPLOYEE | \$1,000,000 |

\*\*To include U.S. Longshoremen and Harbor Workers Act\*\*

**3. COMMERCIAL GENERAL LIABILITY INSURANCE (Including contractual Liability Insurance)**

Bodily Injury and Property Damage Liability (Other than Products/Completed Operations)	Each Occurrence \$1,000,000 General Aggregate \$2,000,000
Products\Completed Operation	Aggregate Limit \$2,000,000

Personal and Advertising Injury	Limits	\$1,000,000
Fire Damage	Limits	
\$100,000		

\*\*General Liability Policy to include the following:

- Per Project/Location Aggregate and Completed Operations for 3 Years after project completion.
- Policy to provide evidence of X, C, U coverage.
- Policy to have no exclusion for demolition work.

**4. BUSINESS AUTOMOBILE LIABILITY INSURANCE**

<b>Combined Single Limits</b>	Each Occurrence	\$1,000,000
-------------------------------	-----------------	-------------

(Including operation of non-owned, owned, and hired automobiles).

\*\*Broadened Pollution Endorsement CA9948 and MCS 90\*\*

**5. UMBRELLA LIABILITY** Per Occurrence/Aggregate \$5,000,000

**6. CONTRACTORS POLLUTION LIABILITY** Each Occurrence \$1,000,000

\*\*Or by endorsement to General Liability Policy for sudden and accidental\*\*

If Pollution provided by General Liability Endorsement and sudden and accidental, Completed Operations would not be a requirement.

- To include three (3) years of extended Completed Operations coverage.

**7. BUILDERS' RISK:** To be written on a Builders Risk "All-risk" form that shall at least include insurance for physical loss or damage to the Work, temporary buildings, falsework, and materials and equipment in transit, and shall insure against at least the following perils or causes of loss: fire, lightning, extended coverage, theft, vandalism, malicious mischief, earthquake, collapse, debris removal, demolition occasioned by enforcement of Laws and Regulations, water damage (other than caused by flood), and such other perils or causes of loss as may be specifically required by Supplementary Conditions) until Final Completion and Acceptance of the Project. Such policy of insurance shall contain at least the following sub-limits of insurance and deductibles:

Sub-limits:

Property in Transit	\$1,000,000
Property in Offsite Storage	\$1,000,000
Plans & Blueprints	\$25,000
Debris Removal	25% of Insured Physical Loss
Delay in Completion / Soft Cost	TBD
Ordinance of Law (Increased Cost of Construction)	\$1,000,000
Flood and Earthquake	Full Contract Value
<b>Deductibles:</b>	
Flood and Earthquake	\$25,000
Water Damage other than Flood	\$100,000
All other Perils	\$10,000

Owner and Contractor waive all rights against each other and any of their subcontractors, sub-subcontractors, agents and employees, each of the other, for damages caused by fire or other causes of loss to the extent covered by property insurance obtained pursuant to this Section, or other property insurance applicable to the Work, accept such rights as they have to the proceeds of such insurance.

The policy will name Fulton County, The Contractor and Subcontractors of all tiers as Insureds under the policy.

### **Certificates of Insurance**

Certificates shall state that the policy or policies shall not expire, be cancelled or altered without at least forty-five (45) days prior written notice to Fulton County Government. Policies and Certificates of Insurance are to list Fulton County Government as an Additional Insured (except for Workers' Compensation) and shall conform to all terms and conditions (including coverage of the indemnification and hold harmless agreement) contained in the Insurance and Risk Management Provisions.

If Fulton County Government shall so request, the Respondent, Contractor or Vendor will furnish the County for its inspection and approval such policies of insurance with all endorsements, or confirmed specimens thereof certified by the insurance company to be true and correct copies.

The Contractor agrees to name the Owner and all other parties required of the Contractor/Vendor shall be included as additional insureds on the CGL, using ISO Additional Insured Endorsement forms CG 2010 11/85 or its equivalent coverage to the additional insureds. This insurance for the additional insureds shall be as broad as the coverage provided for the named insured Subcontractor. It shall apply as Primary Insurance before any other insurance or self-insurance, including any deductible, non-contributory, and Waiver of Subrogation provided to the Additional Insureds.

Additional Insured under the General Liability, Auto Liability, Umbrella Policies (with exception of Workers Compensation and Professional Liability), with no Cross Suits exclusion.

#### **Important:**

It is understood that **Insurance in no way Limits the Liability of the Contractor/Vendor.**

### **USE OF PREMISES**

Contractor/Vendor shall confine its apparatus, the storage of materials and the operations of its workers to limits/requirements indicated by law, ordinance, permits and any restrictions of Fulton County Government and shall not unreasonably encumber the premises with its materials.

### **PROTECTION OF PROPERTY**

Contractor/Vendor will adequately protect its own work from damage, will protect Fulton County Government's property from damage or loss and will take all necessary precautions during the progress of the work to protect all persons and the property of others from damage or loss.

Contractor/Vendor shall take all necessary precautions for the safety of employees of the work and shall comply with all applicable provisions of the Federal, State and local safety laws and building codes to prevent accidents or injury to persons on, about, or adjacent to the premises where work is being performed.

Contractor/Vendor shall erect and properly maintain at all times as required by the conditions and progress of the work, all necessary safeguards for the protection of its employees, Fulton County Government employees and the public and shall post all applicable signage and other warning devices to protect against potential hazards for the work being performed.

### **INDEMNIFICATION AND HOLD HARMLESS AGREEMENT**

To the fullest extent of the Law, Contractor/Vendor hereby agrees to release, indemnify, defend and hold harmless Fulton County, its Commissioners, officers, employees, subcontractors, successors, assigns and agents, from and against any and all losses (including death), claims, damages, liabilities, costs and expenses (including but not limited to all actions, proceedings, or investigations in respect thereof and any costs of judgments, settlements, court costs, attorney's fees or expenses, regardless of the outcome of any such action, proceeding, or investigation), caused by, relating to, based upon or arising out of any act or omission by Contractor/Vendor, its directors, officers, employees, subcontractors, successors, assigns or agents, or otherwise in connection (directly or indirectly) with its acceptance, or the performance, or nonperformance, of its obligations under these agreements. Such obligations shall not be construed to negate, abridge or otherwise reduce any other rights or obligations of indemnity which would otherwise exist as to any party or person as set forth in this paragraph.

Contractor/Vendor's obligation to protect, defend, indemnify and hold harmless, as set forth hereinabove, shall also include, but is not limited to, any matter arising out of any actual or alleged infringement of any patent, trademark, copyright, or service mark, or other actual or alleged unfair competition disparagement of product or service, or other tort or any type whatsoever, or any actual or alleged violation of trade regulations.

Contractor/Vendor further agrees to protect, defend, indemnify and hold harmless Fulton County, its Commissioners, officers, employees, subcontractors, successors, assigns and agents from and against any and all claims or liability for compensation under the Worker's Compensation Act, Disability Benefits Act, or any other employee benefits act arising out of injuries sustained by any employees of Contractor/Vendor. These indemnities shall not be limited by reason of the listing of any insurance coverage.

***If the bid/quotation involves construction services Contractor/Vendor will be responsible fully for any and all damage to the work during the course of construction, until the point of Final acceptance by Fulton County.***

FULTON COUNTY ACKNOWLEDGES THAT ALL PROVISIONS OF THIS INDEMNITY AGREEMENT MAY NOT BE APPLICABLE TO THE CONTRACTOR/VENDOR'S BUSINESS. TO THE EXTENT THAT CONTRACTOR/VENDOR MAY DEMONSTRATE SUCH NONAPPLICABILITY, FULTON COUNTY MAY NEGOTIATE AMENDMENTS TO THIS AGREEMENT AS THE CIRCUMSTANCES DICTATE.

CONTRACTOR/VENDOR ACKNOWLEDGES HAVING READ, UNDERSTANDING, AND AGREEING TO COMPLY WITH THIS INDEMNIFICATION AND HOLD HARMLESS AGREEMENT, AND THE REPRESENTATIVE OF THE CONTRACTOR/VENDOR IDENTIFIED BELOW IS AUTHORIZED TO SIGN CONTRACTS ON BEHALF OF THE RESPONDING CONTRACTOR/VENDOR.

COMPANY: \_\_\_\_\_ SIGNATURE: \_\_\_\_\_

NAME: \_\_\_\_\_ TITLE: \_\_\_\_\_

DATE: \_\_\_\_\_

END OF SECTION

**OWNER - CONTRACTOR AGREEMENT**

**W042 – ALPHARETTA WATER TRANSMISSION MAIN**

**ITB # 11ITB1W042-DB**

Contractor: \_\_\_\_\_

Project No. W042\_\_\_\_\_

Address: \_\_\_\_\_

Telephone: \_\_\_\_\_

Contact: \_\_\_\_\_

Facsimile: \_\_\_\_\_

THIS AGREEMENT is effective as of the \_\_\_\_ day of \_\_\_\_\_, by and between Fulton County, a political subdivision of the State of Georgia (hereinafter called the “County”), and the above named CONTRACTOR in accordance with all provisions of this Construction agreement, consisting of the following Contract Documents:

- General Conditions
- Bid Form
- Scope of Work and Technical Specifications
- Drawings and Specifications
- Exhibits
- Purchasing Forms
- Office of Contract Compliance Forms
- Risk Management Insurance Provisions Forms

WITNESSETH: That the said Contractor has agreed, and by these presents does agree with the said County, for and in consideration of a Contract Price of \_\_\_\_\_(\$\_\_\_\_\_) and other good and valuable consideration, and under the penalty expressed on Bonds hereto attached, to furnish all equipment, tools, materials, skill, and labor of every description necessary to carry out and complete in good, firm, and substantial, and workmanlike manner, the Work specified, in strict conformity with the Drawings and the Specifications hereinafter set forth, which Drawings and Specifications together with the bid submittals made by the Contractor, General Conditions, Special Provisions, Detailed Specifications, Exhibits, and this Agreement, shall all form essential parts of this Contract. The Work covered by this Contract includes all Work indicated on Plans and Specifications and listed in the Bid entitled:

*Project Number: W042*

### ALPHARETTA WATER TRANSMISSION MAIN

The Contractor shall commence the Work with adequate force and equipment within 10 days from receipt of Notice to Proceed from the County, and shall complete the work within **240** calendar days from the Notice to Proceed or the date work begins, whichever comes first. The Contractor shall remain responsible for performing, in accordance with the terms of the contract, all work assigned prior to the expiration of the said calendar days allowed for completion of the work even if the work is not completed until after the expiration of such days.

For each calendar day that any work remains uncompleted after the time allowed for completion of the work, the Contractor shall pay the County the sum of \$ 1,000.00 not as a penalty but as liquidated damages, which liquidated damages the County may deduct from any money due the contractor. At the County's convenience and not to its prejudice the County may provide written notice of the commencement of the assessment of liquidated damages.

As full compensation for the faithful performance of this Contract, the County shall pay the Contractor in accordance with the General Conditions and the prices stipulated in the Bid, hereto attached.

It is further mutually agreed between the parties hereto that if, at any time after the execution of this Agreement and the Surety Bonds hereto attached for its faithful performance, the County shall deem the surety or sureties upon such bonds to be unsatisfactory, or, if, for any reason, such bonds cease to be adequate to cover the performance of the Work, the Contractor shall, at his expense, within five days after receipt of notice from the County so to do, furnish an additional bond or bonds in such form and amount, and with such surety or sureties as shall be satisfactory to the County. In such event no further payment to the Contractor shall be deemed to be due under this Agreement until such new or additional security for the faithful performance of the Work shall be furnished in manner and form satisfactory to the County.

The Contractor hereby assumes the entire responsibility and liability for any and all injury to or death of any and all persons, including the Contractor's agents, servants, and employees, and in addition thereto, for any and all damages to property caused by or resulting from or arising out of any act or omission in connection with this contract or the prosecution of work hereunder, whether caused by the Contractor or the Contractor's agents, Servants, or employees, or by any of the Contractor's subcontractors or suppliers, and the Contractor shall indemnify and hold harmless the County, the Construction Manager, or any of their subcontractors from and against any and all loss and/or expense which they or any of them may suffer or pay as a result of claims or suits due to, because of, or arising out of any and all such injuries, deaths and/or damage, irrespective of County or Construction Manager negligence (except that no party shall be indemnified for their own sole negligence). The Contractor, if requested, shall assume and defend at the Contractor's own expense, any suit, action or other legal proceedings arising there from, and the Contractor hereby agrees to satisfy, pay, and cause to be discharged of record any judgment which may be rendered against the County and the Construction Manager arising there from.

In the event of any such loss, expense, damage, or injury, or if any claim or demand for damages as heretofore set forth is made against the County or the Construction Manager, the County may withhold from any payment due or thereafter to become due to the

Contractor under the terms of this Contract, an amount sufficient in its judgment to protect and indemnify it and the Construction Manager from any and all claims, expense, loss, damages, or injury; and the County, in its discretion, may require the Contractor to furnish a surety bond satisfactory to the County providing for such protection and indemnity, which bond shall be furnished by the Contractor within five (5) days after written demand has been made therefore. The expense of said Bond shall be borne by the Contractor. **[See General Conditions for similar provisions]**

This Contract constitutes the full agreement between the parties, and the Contractor shall not sublet, assign, transfer, pledge, convey, sell or otherwise dispose of the whole or any part of this Contract or his right, title, or interest therein to any person, firm or corporation without the previous consent of the County in writing. Subject to applicable provisions of law, this Contract shall be in full force and effect as a Contract, from the date on which a fully executed and approved counterpart hereof is delivered to the Contractor and shall remain and continue in full force and effect until after the expiration of any guarantee period and the Contractor and his sureties are finally released by the County.

This agreement was approved by the Fulton County Board of Commissioner on [Insert approval date and item number].

*[SIGNATURES NEXT PAGE]*

**IN WITNESS THEREOF**, the Parties hereto have caused this Contract to be executed by their duly authorized representatives as attested and witnessed and their corporate seals to be hereunto affixed as of the day and year date first above written.

OWNER:

CONTRACTOR:

**FULTON COUNTY, GEORGIA**

**[Insert Company Name]**

\_\_\_\_\_  
John H. Eaves, Commission Chair  
Board of Commissioners

\_\_\_\_\_  
[Insert Name & Title of person  
authorized to sign contract]

ATTEST:

ATTEST:

\_\_\_\_\_  
Mark Massey  
Clerk to the Commission (Seal)

\_\_\_\_\_  
Secretary/  
Assistant Secretary

(Affix Corporate Seal)

APPROVED AS TO FORM:

\_\_\_\_\_  
Office of the County Attorney

APPROVED AS TO CONTENT:

\_\_\_\_\_  
David Ricks  
Director, Department of General  
Services/Public Works

**END OF SECTION**

**PERFORMANCE BOND**

No contract with Fulton County for work to be done shall be valid for any purpose unless the Contractor provides a Performance Bond with good and sufficient surety payable to, in favor of, and for the protection of Fulton County. The Performance Bond shall be in the amount of 100% of the total contract amount, payable by the terms of the Contract, and shall be written on the following form.

Surety companies executing Bonds must appear on the Treasury Department's most current list (Circular 570 as amended) and be authorized to transact business as a surety in Georgia.

Attestation for the corporation must be by the corporate officer; for a partnership by another partner; for an individual by a notary with the corporate seal.

**PERFORMANCE BOND**

**KNOW ALL MEN BY THESE PRESENTS** that \_\_\_\_\_  
(Insert name of Contractor)

(hereinafter called the “Principal”) and \_\_\_\_\_ (hereinafter called the  
(Insert name of Surety)  
“Surety”), are held and firmly bound unto **FULTON COUNTY**, a political subdivision of the State of Georgia (hereinafter called the “Owner”), its successors and assigns, in the penal sum of \_\_\_\_\_ [100% of Contract amount], lawful money of the United States of America, for the payment of which the Principal and the Surety bind themselves, their administrators, executors, successors and assigns, jointly and severally, firmly by these presents.

**WHEREAS**, the Principal has entered, or is about to enter, into a certain written contract with the Owner, dated \_\_\_\_\_, which is incorporated herein by reference in its entirety (hereinafter called the “Contract”), for construction-type services of a project known as **W042 – ALPHARETTA WATER TRANSMISSION MAIN**, as more particularly described in the Contract (hereinafter called the “Project”);

**NOW, THEREFORE**, the conditions of this obligation are as follows, that if the Principal shall fully and completely perform all the undertakings, covenants, terms, conditions, warranties, and guarantees contained in the Contract, including all modifications, amendments, changes, deletions, additions, and alterations thereto that may hereafter be made, then this obligation shall be void; otherwise it shall remain in full force and effect.

Whenever the Principal shall be, and declared by the Owner to be, in default under the Construction-Type Contract, the Surety shall promptly remedy the default as follows:

1. Complete the Contract in accordance with its terms and conditions; or, at the sole option of the Owner,
2. Obtain a bid or bids for completing the Contract in accordance with its terms and conditions, and upon determination by the Surety and the Owner of the lowest responsible bidder, arrange for a contract between such bidder and Owner and make available as the work progresses (even though there should be a default or succession of defaults under the Contract or contracts of completion arranged under this paragraph) sufficient funds to pay the cost of completion less the balance of the contract price; but not exceeding, including other costs and damages for which the Surety may be liable hereunder, the penal sum set forth in the first paragraph hereof, as may be adjusted, and the Surety shall make available and pay to the Owner the funds required by this Paragraph prior to the payment of the Owner of the balance of the contract price, or any portion thereof. The term “balance of the contract price,” as used in this paragraph, shall mean the total amount payable by the Owner to the Contractor under the Contract, and any amendments thereto, less the amount paid by the Owner to the Contractor; or, at the sole option of the Owner,

3. Allow Owner to complete the work and reimburse the Owner for all reasonable costs incurred in completing the work.

In addition to performing as required in the above paragraphs, the Surety shall indemnify and hold harmless the Owner from any and all losses, liability and damages, claims, judgments, liens, costs and fees of every description, including reasonable attorney's fees, litigation costs and expert witness fees, which the Owner may incur, sustain or suffer by reason of the failure or default on the part of the Principal in the performance of any or all of the terms, provisions, and requirements of the Contract, including any and all amendments and modifications thereto, or incurred by the Owner in making good any such failure of performance on the part of the Principal.

The Surety shall commence performance of its obligations and undertakings under this Bond promptly and without delay, after written notice from the Owner to the Surety.

The Surety hereby waives notice of any and all modifications, omissions, additions, changes, alterations, extensions of time, changes in payment terms, and any other amendments in or about the Contract, and agrees that the obligations undertaken by this Bond shall not be impaired in any manner by reason of any such modifications, omissions, additions, changes, alterations, extensions of time, change in payment terms, and amendments.

The Surety hereby agrees that this Bond shall be deemed amended automatically and immediately, without formal or separate amendments hereto, upon any amendment to the Contract, so as to bind the Principal and the Surety to the full and faithful performance of the Contract as so amended or modified, and so as to increase the penal sum to the adjusted Contract Price of the Contract.

No right of action shall accrue on this Bond to or for the use of any person, entity or corporation other than the Owner and any other obligee named herein, or their executors, administrators, successors or assigns.

This Bond is intended to comply with O.C.G.A. Section 36-91-1 et seq., and shall be interpreted so; as to comply with; the minimum requirements thereof. However, in the event the express language of this Bond extends protection to; the Owner beyond that contemplated by O.C.G.A. Section 36-91-1 et seq. and O.C.G.A. Section 13-10-1, as amended, or any other statutory law applicable to this Project, then the additional protection shall be enforced in favor of the Owner, whether or not such protection is found in the applicable statutes.

**IN WITNESS WHEREOF** the undersigned have caused this instrument to be executed and their respective corporate seals to be affixed and attested by their duly authorized representatives this \_\_\_\_\_ day of \_\_\_\_\_, \_\_\_\_\_.

\_\_\_\_\_(SEAL)  
(Principal)

By:\_\_\_\_\_

Attest:

\_\_\_\_\_  
Secretary

\_\_\_\_\_(SEAL)  
(Surety)

By:\_\_\_\_\_

Attest:

\_\_\_\_\_  
Secretary

\_\_\_\_\_  
(Address of Surety's Home Office)

\_\_\_\_\_  
(Resident Agent of Surety)

END OF SECTION

**PAYMENT BOND**

No Contract with Fulton County for work to be done shall be valid for any purpose unless the Contractor provides a Payment Bond with good and sufficient surety payable to Fulton County for the use and protection of all sub-contractors and all persons supplying labor, materials, machinery, and equipment in the prosecution of the work provided for in the Contract. The Payment Bond shall be in the amount of 100% of the total contract amount, payable by the terms of the Contract, and shall be written on the following form.

Surety companies executing Bonds must appear on the Treasury Department's most current list (Circular 570 as amended) and be authorized to transact business in the State of Georgia.

Attestation for the corporation must be by the corporate officer; for a partnership by another partner; for an individual by a notary with the corporate seal.

**PAYMENT BOND**

**KNOW ALL MEN BY THESE PRESENTS** that \_\_\_\_\_  
*(Insert name of Contractor)*

(hereinafter called the "Principal") and \_\_\_\_\_  
*(Insert name of Surety)*

"Surety"), are held and firmly bound unto **FULTON COUNTY**, a political subdivision of the State of Georgia (hereinafter called the "Owner"), its successors and assigns as obligee, in the penal sum of \_\_\_\_\_ *[100% of Contract amount]*, lawful money of the United States of America, for the payment of which the Principal and the Surety bind themselves, their administrators, executors, successors and assigns, jointly and severally, firmly by these presents.

**WHEREAS**, the Principal has entered, or is about to enter, into a certain written contract with the Owner, dated \_\_\_\_\_, which is incorporated herein by reference in its entirety (hereinafter called the "Contract"), for construction-type services of a project known as **W042 – ALPHARETTA WATER TRANSMISSION MAIN**, as more particularly described in the Contract (hereinafter called the "Project");

**NOW, THEREFORE**, the condition of this obligation is such that if the Principal shall promptly make payment to all persons working on or supplying labor or materials under the Contract, and any amendments thereto, with regard to labor or materials furnished and used in the Project, and with regard to labor or materials furnished but not so used, then this obligation shall be void; but otherwise it shall remain in full force and effect.

1. A "Claimant" shall be defined herein as any subcontractor, person, party, partnership, corporation or the entity furnishing labor, services or materials used, or reasonably required for use, in the performance of the Contract, without regard to whether such labor, services or materials were sold, leased or rented, and without regard to whether such Claimant is or is not in privity of contract with the Principal or any subcontractor performing work on the Project, including, but not limited to, the following labor, services, or materials: water, gas, power, light, heat, oil, gasoline, telephone service or rental of equipment directly applicable to the Contract.
2. In the event a Claimant files a lien against the property of the Owner, and the Principal fails or refuses to satisfy or remove it promptly, the Surety shall satisfy or remove the lien promptly upon written notice from the Owner, either by bond or as otherwise provided in the Contract.
3. The Surety hereby waives notice of any and all modifications, omissions, additions, changes, alterations, extensions of time, changes in the payment terms, and any other amendments in or about the Contract and agrees that the obligations undertaken by this Bond shall not be impaired in any manner by reason of any such modifications, omissions, additions, changes, alterations, extensions of time, changes in payment terms, and amendments.
4. The Surety hereby agrees that this Bond shall be deemed amended automatically and immediately, without formal or separate amendments hereto, upon any amendment or modifications to the Contract, so as to bind the Principal and Surety, jointly and severally, to the full payment of any Claimant under the

Contract, as amended or modified, provided only that the Surety shall not be liable for more than the penal sum of the Bond, as specified in the first paragraph hereof.

5. This Bond is made for the use and benefit of all persons, firms, and corporations who or which may furnish any materials or perform any labor for or on account of the construction-type services to be performed or supplied under the Contract, and any amendments thereto, and they and each of them may sue hereon.
6. No action may be maintained on this Bond after one (1) year from the date the last services, labor, or materials were provided under the Contract by the Claimant prosecuting said action.
7. This Bond is intended to comply with O.C.G.A. Section 13-10-1, and shall be interpreted so as to comply with the minimum requirements thereof. However, in the event the express language of this Bond extends protection to the Owner beyond that contemplated by O.C.G.A. Section 13-10-1, or any other statutory law applicable to this Project, then the additional protection shall be enforced in favor of the Owner, whether or not such protection is found in the applicable statutes.

**IN WITNESS WHEREOF** the undersigned have caused this instrument to be executed and their respective corporate seals to be affixed and attested by their duly authorized representatives this \_\_\_\_\_ day of \_\_\_\_\_, \_\_\_\_\_.

\_\_\_\_\_(SEAL)  
(Principal)

By:\_\_\_\_\_

Attest:

\_\_\_\_\_  
Secretary

\_\_\_\_\_(SEAL)  
(Surety)

By:\_\_\_\_\_

Attest:

\_\_\_\_\_  
Secretary

\_\_\_\_\_  
(Address of Surety's Home Office)

\_\_\_\_\_  
(Resident Agent of Surety)

**END OF SECTION**

## GENERAL CONDITIONS:

**00700-1 FAMILIARITY WITH SITE**

Execution of this agreement by the Contractor is a representation that the Contractor has visited the site, has become familiar with the local conditions under which the work is to be performed, and has correlated personal observations with the requirements of this agreement.

**00700-2 CONTRACT DOCUMENTS**

This agreement consists of Owner's invitation for bid, instructions to bidders, bid form, performance bond, payment bond, acknowledgments, the contract, general conditions, special conditions, specifications, plans, drawings, exhibits, addenda, and written change orders.

- A. Notice of Award of Contract:
- B. Execution of Contract Documents

Upon notification of Award of Contract, the Owner shall furnish the Contractor the conformed copies of Contract Documents for execution by the Contractor and the Contractor's surety.

Within ten (10) days after receipt the Contractor shall return all the documents properly executed by the Contractor and the Contractor's surety. Attached to each document shall be an original power-of-attorney for the person executing the bonds for the surety and certificates of insurance for the required insurance coverage.

After receipt of the documents executed by the Contractor and his surety with the power-of-attorney and certificates of insurance, the Owner shall complete the execution of the documents. Distribution of the completed documents will be made upon completion. Should the Contractor and/or Surety fail to execute the documents within the time specified; the Owner shall have the right to proceed on the Bid Bond accompanying the bid.

If the Owner fails to execute the documents within the time limit specified, the Contractor shall have the right to withdraw the Contractor's bid without penalty.

**Drawings and Specifications:**

The Drawings, Specifications, Contract Documents, and all supplemental documents, are considered essential parts of the Contract, and requirements occurring in one are as binding as though occurring in all. They are intended to define, describe and provide for all Work necessary to complete the Project in an acceptable manner, ready for use, occupancy, or operation by the Owner.

In case of conflict between the Drawings and Specifications, the Specifications shall govern. Figure dimensions on Drawings shall govern over scale dimensions, and detailed Drawings shall govern over general Drawings.

In cases where products or quantities are omitted from the Specifications, the description and quantities shown on the Drawings shall govern.

Any ambiguities or need for clarification of the Drawings or Specifications shall be immediately reported to the Construction Manager in writing. Any such ambiguity or need for clarification shall be handled by the Construction Manager in writing. No clarification of the Drawings and Specifications hereunder by the Construction Manager shall entitle the Contractor to any additional monies unless a Change Order has been processed as provided by "Changes in the Contract" hereof.

Any work done by the Contractor following a discovery of such differing site condition or ambiguity or need for clarification in the Contract Drawings and Specifications prior to a written report to the Construction Manager shall not entitle the Contractor to additional monies and shall be done at the Contractor's risk.

The Construction Manager will furnish the Contractor five (5) copies of the Contract Drawings and the Specifications, one copy of which the Contractor shall have available at all times on the Project site.

### **00700-3 DEFINITIONS**

The following terms as used in this agreement are defined as follows to the extent the definitions herein differ or conflict with those in the Instructions for Bidders, Section 00100, the definitions herein shall control.

Change Order - A written order to the Contractor issued by the County pursuant to Fulton County Policy and Procedures 800-6 for changes in the work within the general scope of the contract documents, adjustment of the contract price, extension of the contract time, or reservation of determination of a time extension

Construction Manager or Engineer shall mean Fulton Construction Management Partners, the County authorized representative for this project.

Contractor shall mean the party of the second part to the Contract Agreement or the authorized and legal representative of such party.

Contract Documents include the Contract Agreement, Contractor's Bid (including all documentation accompanying the Bid and any post-Bid documentation required by the County prior to the Notice of Award), Bonds, all Special Conditions, General Conditions, Supplementary Conditions, Specifications, Drawings and addenda, together with written amendments, change orders, field orders and the Construction Manager's written interpretations and clarifications issued in accordance with the General Conditions on or after the date of the Contract Agreement.

Shop drawing submittals reviewed in accordance with the General Conditions, geotechnical investigations and soils report and drawings of physical conditions in or relating to existing surface structures at or contiguous to the site are not Contract Documents.

Contract Price - The sum specified in the Agreement to be paid to the Contractor in consideration of the Work.

Contract Time shall mean the number of consecutive calendar days as provided in the Contract Agreement for completion of the Work, to be computed from the date of Notice to Proceed.

Owner or County shall mean Fulton County Government, party of the first part to the Contract Agreement, or its authorized and legal representatives.

Day - A calendar day of twenty-four hours lasting from midnight of one day to midnight the next day.

Design Consultant shall mean the firm or corporation responsible for the detailed design drawings and specifications.

Director - Director of the Department of Public Works of Fulton County, Georgia or the designee thereof.

Final Completion shall mean the completion of all work as required in accordance with the terms and conditions of the contract documents.

Liquidated Damages shall mean the amount, stated in the Contract Agreement, which the Contractor agrees to pay to the Owner for each consecutive calendar day beyond the Contract time required to complete the Project or for failing to comply with associated milestones. Liquidated Damages will end upon written notification from the Owner of Final Acceptance of the Project or upon written notification of from the Owner of completion of the milestone.

Notice to Proceed - A written communication issued by the County to the Contractor authorizing it to proceed with the work, establishing the date of commencement and completion of the work, and providing other direction to the Contractor.

Products shall mean materials or equipment permanently incorporated into the work.

Program Manager - Not used in this contract. Delete all references.

Project Manual - The Contract Documents.

Provide shall mean to furnish and install.

Substantial Completion - The date certified by the Construction Manager when all or a part of the work, as established pursuant to General Condition 0700-81, is sufficiently completed in accordance with the requirements of the contract documents so that the identified portion of the work can be utilized for the purposes for which it is intended.

Work or Project - All of the services specified, indicated, shown or contemplated by the contract documents, and furnishing by the Contractor of all materials, equipment, labor, methods, processes, construction and manufacturing materials and equipment, tools, plans, supplies, power, water, transportation and other things necessary to complete such services in accordance with the contract documents to insure a functional and complete facility.

#### **00700-4 CODES**

All codes, specifications, and standards referenced in the contract documents shall be the latest editions, amendments and revisions of such referenced standards in effect as of the date of the request for proposals for this contract.

**00700-5 REVIEW OF CONTRACT DOCUMENTS**

Before making its proposal to the County, and continuously after the execution of the agreement, the Contractor shall carefully study and compare the contract documents and shall at once report to the Construction Manager any error, ambiguity, inconsistency or omission that may be discovered, including any requirement which may be contrary to any law, ordinance, rule, or regulation of any public authority bearing on the performance of the work. By submitting its proposal, the Contractor agrees that the contract documents, along with any supplementary written instructions issued by or through the Construction Manager that have become a part of the contract documents, appear accurate, consistent and complete insofar as can be reasonably determined. If the Contractor has timely reported in writing any error, inconsistency, or omission to the Construction Manager, has properly stopped the affected work until instructed to proceed, and has otherwise followed the instructions of the Construction Manager, the Contractor shall not be liable to the County for any damage resulting from any such error, inconsistency, or omission in the contract documents. The Contractor shall not perform any portion of the work without the contract documents, approved plans, specifications, products and data, or samples for such portion of the work. For purposes of this section “timely” is defined as the time period in which the contractor discovers, or should have discovered, the error, inconsistency, or omission, with the exercise of reasonable diligence.

**00700-6 STRICT COMPLIANCE**

No observation, inspection, test or approval of the County or Construction Manager shall relieve the Contractor from its obligation to perform the work in strict conformity with the contract documents except as provided in General Condition 00700-48.

**00700-7 APPLICABLE LAW**

All applicable State laws, County ordinances, codes, and rules and regulations of all authorities having jurisdiction over the construction of the project shall apply to this agreement. The Contractor shall comply with the requirements of any Fulton County program concerning non-discrimination in contracting. All work performed within the right of way of the Georgia Department of Transportation and any railroad crossing shall be in accordance with Georgia Department of Transportation regulations, policies and procedures and, where applicable, those of any affected railroad. The Contractor shall comply with all laws, ordinances, codes, rules and regulations bearing on the conduct of the work as specified and the Contractor agrees to indemnify and hold harmless the County, its officers, agents and employees, as well as the Construction Manager and the Program Manager against any claim or liability arising from or based on the violation of any law, ordinance, regulation, order or decree affecting the conduct of the work, whether occasioned by the Contractor, his agents or employees.

**00700-8 PERMITS, LICENSES AND BONDS**

All permits and licenses necessary for the work shall be secured and paid for by the Contractor. If any permit, license or certificate expires or is revoked, terminated, or suspended as a result of any action on the part of the Contractor, the Contractor shall not be entitled to additional compensation or time. The Contractor shall obtain and keep in force at all times performance and payment bonds payable to Fulton County in penal amounts equal to 100% of the Contract price.

**00700-9 TAXES**

- A. The Contractor shall pay all sales, retail, occupational, service, excise, old age benefit and unemployment compensation taxes, consumer, use and other similar taxes, as well as any other taxes or duties on the materials, equipment, and labor for the work provided by the Contractor which are legally enacted by any municipal, county, state or federal authority, department or agency at the time bids are received, whether or not yet effective. The Contractor shall maintain records pertaining to such taxes and levies as well as payment thereof and shall make the same available to the County at all reasonable times for inspection and copying. The Contractor shall apply for any and all tax exemptions which may be applicable and shall timely request from the County such documents and information as may be necessary to obtain such tax exemptions. The County shall have no liability to the Contractor for payment of any tax from which it is exempt.
- B. The Contractor is obligated to comply with all local and State Sales and Use Tax laws. The Contractor shall provide the Owner with documentation to assist the Owner in obtaining sales and/or use tax refunds for eligible machinery and equipment used for the primary purpose of reducing or eliminating air or water pollution as provided for in Chapter 48-8-3 (36) and (37) of the Official Code of Georgia. All taxes shall be paid by the Contractor. All refunds will accrue to the Owner.

Acceptance of the project as complete and final payment will not be made by the Owner until the Contractor has fully complied with this requirement.

**00700-10 DELINQUENT CONTRACTORS**

The County shall not pay any claim, debt, demand or account whatsoever to any person firm or corporation who is in arrears to the County for taxes. The County shall be entitled to a counterclaim, back charge, and offset for any such debt in the amount of taxes in arrears, and no assignment or transfer of such debt after the taxes become due shall affect the right of the County to offset any taxes owed against said debt.

**00700-11 LIEN WAIVERS**

The Contractor shall furnish the County with evidence that all persons who have performed work or furnished materials pursuant to this agreement have been paid in full prior to submitting its demand for final payment pursuant to this agreement. A final affidavit, Exhibit A, must be completed, and submitted to comply with requirements of 00700-11. In the event that such evidence is not furnished, the County may retain sufficient sums necessary to meet all lawful claims of such laborers and materialmen. The County assumes no obligation nor in any way undertakes to pay such lawful claims from any funds due or that may become due to the Contractor.

**00700-12 MEASUREMENT**

All items of work to be paid for per unit of measurement shall be subject to inspection, measurement, and confirmation by the Construction Manager.

**00700-13 ASSIGNMENT**

The Contractor shall not assign any portion of this agreement or moneys due there from (include factoring of receivables) without the prior written consent of the County. The Contractor shall retain personal control and shall provide personal attention to the

fulfillment of its obligations pursuant to this agreement. Any assignment without the express written consent of the County shall render this contract voidable at the sole option of the County.

**00700-14 FOREIGN CONTRACTORS**

In the event that the Contractor is a foreign corporation, partnership, or sole proprietorship, the Contractor hereby irrevocably appoints the Secretary of State of Georgia as its agent for service of all legal process for the purpose of this contract only.

**00700-15 INDEMNIFICATION [there are two indemnification clauses, the other is in the Contract Cover Sheet]**

The Contractor hereby assumes the entire responsibility and liability for any and all injury to or death of any and all persons, including the Contractor's agents, servants, and employees, and in addition thereto, for any and all damages to property caused by or resulting from or arising out of any act or omission in connection with this contract or the prosecution of work hereunder, whether caused by the Contractor or the Contractor's agents, servants, or employees, or by any of the Contractor's subcontractors or suppliers, and the Contractor shall indemnify and hold harmless the County, the Construction Manager and the Program Manager, or any of their subcontractors from and against any and all loss and/or expense which they or any of them may suffer or pay as a result of claims or suits due to, because of, or arising out of any and all such injuries, deaths and/or damage, irrespective of County or Construction Manager or Program Manager negligence (except that no party shall be indemnified for their own sole negligence). The Contractor, if requested, shall assume and defend at the Contractor's own expense, any suit, action or other legal proceedings arising there from, and the Contractor hereby agrees to satisfy, pay, and cause to be discharged of record any judgment which may be rendered against the County, the Construction Manager and the Program Manager arising there from.

In the event of any such loss, expense, damage, or injury, or if any claim or demand for damages as heretofore set forth is made against the County or the Construction Manager or the Program Manager, the County may withhold from any payment due or thereafter to become due to the Contractor under the terms of this Contract, an amount sufficient in its judgment to protect and indemnify it and the Construction Manager and the Program Manager from any and all claims, expense, loss, damages, or injury; and the County, in its discretion, may require the Contractor to furnish a surety bond satisfactory to the County providing for such protection and indemnity, which bond shall be furnished by the Contractor within five (5) days after written demand has been made therefore. The expense of said Bond shall be borne by the Contractor.

**00700-16 SUPERVISION OF WORK AND COORDINATION WITH OTHERS**

The Contractor shall supervise and direct the work using the Contractor's best skill and attention. The Contractor shall be solely responsible for all construction methods and procedures and shall coordinate all portions of the work pursuant to the contract subject to the overall coordination of the Construction Manager. All work pursuant to this agreement shall be performed in a skillful and workmanlike manner.

The County reserves the right to perform work related to the Project with the County's own forces and to award separate contracts in connection with other portions of the project, other work on the site under these or similar conditions of the contract, or work which has been extracted from the Contractor's work by the County.

When separate contracts are awarded for different portions of the project or other work on the site, the term “separate contractor” in the Contract Documents in each case shall mean the contractor who executes each separate County Agreement.

The Contractor shall cooperate with the County and separate contractors in arranging the introduction and storage of materials and equipment and execution of their work, and shall cooperate in coordinating connection of its work with theirs as required by the Contract Documents.

If any part of the Contractor’s Work depends for proper execution or results upon the work of the County or any separate contractor, the Contractor shall, prior to proceeding with that portion of the Work, promptly report to the Construction Manager any apparent discrepancies or defects in such other work that render it unsuitable for such proper execution and results **within fourteen (14) days** of discovery of such discrepancy or defect. Failure of the Contractor to so report in writing shall constitute an acceptance of the County’s or separate contractor’s work as fit and proper to receive the Work, except as to any defects which may subsequently become apparent in such work by others. Any costs caused by defective or untimely work shall be borne by the party responsible therefore.

Should the Contractor wrongfully cause damage to the work or property of the County or to other work or property on the site, including the work of separate contractors, the Contractor shall promptly remedy such damage at the Contractor’s expense.

Should the Contractor be caused damage by any other contractor on the Project, by reason of such other contractor’s failure to perform properly his contract with the County, no action shall lie against the County or the Construction Manager inasmuch as the parties to this agreement are the only beneficiaries hereof and there are no third party beneficiaries and neither the County nor the Construction Manager shall have liabilities therefore, but the Contractor may assert his claim for damages solely against such other contractor. The Contractor shall not be excused from performance of the contract by reason of any dispute as to damages with any other contractor or third party.

Where the Work of this Contract shall be performed concurrently in the same areas as other construction work, the Contractor shall coordinate with the Construction Manager and the separate contractors in establishing mutually acceptable schedules and procedures that shall permit all jobs to proceed with minimum interference.

If a dispute arises between the Contractor and separate contractors as to their responsibility for cleaning up, the County may clean up and charge the cost thereof to the Contractor or contractors responsible therefore as the County shall determine to be just.

#### **00700-17 ADMINISTRATION OF CONTRACT**

The Program Manager and the Construction Manager shall provide administration services as hereinafter described.

For the administration of this Contract, the Construction Manager shall serve as the County’s primary representative during design and construction and until final payment to the Contractor is due. The Construction Manager shall advise and consult with the County and the Program Manager. The primary point of contact for the Contractor shall

be the Construction Manager. All correspondence from the Contractor to the County shall be forwarded through the Construction Manager. Likewise, all correspondence and instructions to the Contractor shall be forwarded through the Construction Manager.

The Construction Manager will determine in general that the construction is being performed in accordance with design and engineering requirements, and will endeavor to guard the County against defects and deficiencies in the Work.

The Construction Manager will not be responsible for or have control or charge of construction means, methods, techniques, sequences, or procedures, or for safety precautions and programs in connection with the Work, nor will it be responsible for the Contractor's failure to carry out the Work in accordance with the Contract Documents. The Construction Manager will not be responsible for or have control or charge over the acts or omissions of the Contractor, its engineers, consultants, subcontractors, or any of their agents or employees, or any other persons performing the Work.

Based on the Construction Manager's observations regarding the Contractor's Applications for Payment, the Construction Manager shall determine the amounts owing to the Contractor, in accordance with the payment terms of the Contract, and shall issue Certificates for Payment in such amount to the County.

The Construction Manager shall render interpretations necessary for the proper execution or progress of the Work. Either party to the Contract may make written requests to the Construction Manager for such interpretations.

Claims, disputes and other matters in question between the Contractor and the County relating to the progress of the Work or the interpretation of the Contract Documents shall be referred to the Construction Manager for interpretation.

All interpretations of the Construction Manager shall be consistent with the intent of and reasonably inferable from the Contract Documents and shall be in writing or in graphic form.

Except as otherwise provided in this Contract, the Construction Manager shall issue a decision on any disagreement concerning a question of fact arising under this Contract. The Construction Manager shall reduce the decision to writing and mail or otherwise furnish a copy thereof to the Contractor. The decision of the Construction Manager shall be final and conclusive unless, within thirty (30) days from the date of receipt of such copy, the Contractor files a written appeal with the Director of Public Works and mails or otherwise furnishes the Construction Manager a copy of such appeal. The decision of the Director of Public Works or the Director's duly authorized representative for the determination of such appeals shall be final and conclusive. Such final decision shall not be pleaded in any suit involving a question of fact arising under this Contract, provided such is not fraudulent, capricious, arbitrary, so grossly erroneous as necessarily implying bad faith, or is not supported by substantial evidence. In connection with any appeal proceeding under this Article, the Contractor shall be afforded an opportunity to be heard and to offer evidence in support of Contractor's appeal. Pending any final decision of a dispute hereunder, the Contractor shall proceed diligently with the performance of the Contract as directed by the Construction Manager.

The Construction Manager shall have authority to reject Work which does not conform to the Contract Documents. Whenever, in the Construction Manager's opinion, it is considered necessary or advisable for the implementation of the intent of the Contract Documents, the County shall have authority to require special inspection or testing of the Work whether or not such Work be then fabricated, installed or completed. The Contractor shall pay for such special inspection or testing if the Work so inspected or tested is found not to comply with the requirements of the contract; the County shall pay for special inspection and testing if the Work is found to comply with the contract. Neither the Construction Manager's authority to act under this Subparagraph, nor any decision made by the Construction Manager in good faith either to exercise or not to exercise such authority, shall give rise to any duty or responsibility of the Construction Manager to the Contractor, any subcontractor, any of their agents or employees, or any other person performing any of the Work.

The Contractor shall provide such shop drawings, product data, and samples as may be required by the Construction Manager and/or as required by these Contract Documents. The Construction Manager shall conduct inspections to determine Substantial Completion and Final Completion, and shall receive and forward to the County for review written warranties and related documents required by the Contract Documents and assembled by the Contractor. The Construction Manager shall approve and issue Certificates for Payment upon compliance with Substantial and Final Completion requirements indicated in General Conditions 00700-81, 00700-82, 00700-84 and 00700-85 of this Agreement.

Except as provided in General Condition 00700-48, the Contractor shall not be relieved from the Contractor's obligations to perform the work in accordance with the contract documents by the activities or duties of the County or any of its officers, employees, or agents, including inspections, tests or approvals, required or performed pursuant to this agreement.

#### **00700-18 RESPONSIBILITY FOR ACTS OF EMPLOYEES**

The Contractor shall employ only competent and skilled personnel. The Contractor shall, upon demand from the Construction Manager, immediately remove any superintendent, foreman or workman whom the Construction Manager may consider incompetent or undesirable.

The Contractor shall be responsible to the County for the acts and omissions of the Contractor's employees, subcontractors, and agents as well as any other persons performing work pursuant to this agreement for the Contractor.

#### **00700-19 LABOR, MATERIALS, SUPPLIES, AND EQUIPMENT**

Unless otherwise provided in this agreement, the Contractor shall make all arrangements with necessary support agencies and utility companies provide and pay for all labor, materials, equipment, tools, construction equipment and machinery, water, heat, utilities, transportation, and other facilities and services necessary for the execution and completion of the work.

#### **00700-20 DISCIPLINE ON WORK SITE**

The Contractor shall enforce strict discipline and good order among its employees and subcontractors at all times during the performance of the work, to include compliance

with the Fulton County Drug Free Work Place Policy. The Contractor shall not employ any subcontractor who is not skilled in the task assigned to it. The Construction Manager may, by written notice, require the Contractor to remove from the work any subcontractor or employee deemed by the Construction Manager to be incompetent.

#### **00700-21 HOURS OF OPERATION**

All work at the construction site shall be performed during regular business hours of the Fulton County government, except upon the Construction Manager's prior written consent to other work hours. It is further understood that the Contractor's construction schedule is based on a normal 40 hours, five day work week, less Fulton County-recognized holidays. Contractors work schedule shall not violate Fulton County Noise Ordinance by working hours inconsistent with the Fulton County Noise Ordinance. The County's current noise ordinance or other applicable ordinance shall govern. If the Contractor desires to work in excess of this limit, the Contractor shall submit a written request to the Construction Manager, a minimum of five days prior to the desired work date. The Contractor shall be responsible for any additional expenses incurred by the Owner as a result of the extended work hours, including resident inspection overtime. The cost associated with resident inspector overtime shall be deducted from the Contractor monthly payment request.

#### **00700-22 FAMILIARITY WITH WORK CONDITIONS**

The Contractor shall take all steps necessary to ascertain the nature and location of the work and the general and local conditions which may affect the work or the cost thereof. The Contractor's failure to fully acquaint itself with the conditions which may affect the work, including, but not limited to conditions relating to transportation, handling, storage of materials, availability of utilities, labor, water, roads, weather, topographic and subsurface conditions, other separate contracts to be entered into by the County relating to the project which may affect the work of the Contractor, applicable provisions of law, and the character and availability of equipment and facilities necessary prior to and during the performance of the work shall not relieve the Contractor of its responsibilities pursuant to this agreement and shall not constitute a basis for an equitable adjustment of the contract terms. The County reserves the right to perform with its own forces or to contract with other entities for other portions of the project work, in which case the Contractor's responsibility to assure its familiarity with work conditions hereunder shall include all coordination with such other contractors and the County necessary to insure that there is no interference between contractors as will delay or hinder any contractor in its prosecution of work on the project. The County assumes no responsibility for any understandings or representations concerning conditions of the work made by any of its officers, agents, or employees prior to the execution of this agreement.

#### **00700-23 RIGHT OF ENTRY**

The County reserves the right to enter the site of the work by such agent, including the Construction Manager, as it may elect for the purpose of inspecting the work or installing such collateral work as the County may desire. The Contractor shall provide safe facilities for such access so that the County and its agents may perform their functions.

#### **00700-24 NOTICES**

Any notice, order, instruction, claim or other written communication required pursuant to this agreement shall be deemed to have been delivered or received as follows:

Upon personal delivery to the Contractor, its authorized representative, or the Construction Manager on behalf of the County. Personal delivery may be accomplished by in-person hand delivery or bona fide overnight express service.

Three days after depositing in the United States mail a certified letter addressed to the Contractor or the Construction Manager for the County. For purposes of mailed notices, the County's mailing address shall be 141 Pryor Street, 6th Floor, Atlanta, Georgia 30303, or as the County shall have otherwise notified the Contractor. The Contractor's mailing address shall be the address stated in its proposal or as it shall have most recently notified the Construction Manager in writing.

### **00700-25 SAFETY**

#### **A. SAFETY, HEALTH AND LOSS PREVENTION**

The Contractor shall be responsible for implementing a comprehensive project-specific safety, health and loss prevention program and employee substance abuse program for this project. All Sub-Contractors must either implement their own program or follow the Contractor's safety, health and loss prevention program and employee substance abuse program.

The Contractor's safety, health and loss prevention program and employee substance abuse program must meet or exceed all governmental regulations (OSHA, EPA, DOT, State, local), and any other specific Fulton County requirements

#### **B. COUNTY'S SAFETY, HEALTH, AND LOSS PREVENTION PROCESS GUIDELINES AND REQUIREMENTS**

The County and its agents reserve the right, but assume no duty, to establish and enforce safety, health, and loss prevention guidelines and to make the appropriate changes in the guidelines, for the protection of persons and property and to review the efficiency of all protective measures taken by the Contractor. The Contractor shall comply with all safety, health, and loss prevention process guidelines and requirements and changes made by the County or its agent(s). The issuance of any such guidelines or changes by the County or its agent(s) shall not relieve the Contractor of its duties and responsibilities under this Agreement, and the County or its agent(s) shall not thereby assume, nor be deemed to have assumed, any such duties or responsibilities of the Contractor.

#### **C. COMPLIANCE OF WORK, EQUIPMENT, AND PROCEDURES WITH ALL APPLICABLE LAWS and REGULATIONS**

All Work, whether performed by the Contractor or its Sub-Contractors of any tier, or anyone directly or indirectly employed by any of them, and all equipment, appliances, machinery, materials, tools and like items incorporated or used in the Work, shall be in compliance with and conform to:

1. All applicable laws, ordinances, rules, regulations and orders of any public, quasi-public or other governmental authority relating to the safety of persons and their protection against injury, specifically including, but in no event limited to, the Federal Occupational Safety and Health Act of 1970, as amended, and all rules and regulations now or hereafter in effect pursuant to said Act.

2. All rules, regulations, and requirements of the County or its agent(s) and its insurance carriers relating there to. In the event of a conflict or differing requirements the more stringent shall govern.

#### D. PROTECTION OF THE WORK

1. The Contractor shall, throughout the performance of the Work, maintain adequate and continuous protection of all Work and temporary facilities against loss or damage from whatever cause, shall protect the property of the County and third parties from loss or damage from whatever cause arising out of the performance of the Work, and shall comply with the requirements of the County or its agent(s) and its insurance carriers, and with all applicable laws, codes, rules and regulations, (as same may be amended) with respect to the prevention of loss or damage to property as a result of fire or other hazards.
2. The County or its agent(s) may, but shall not be required to, make periodic inspections of the Project work area. In such event, however, the Contractor shall not be relieved of its aforesaid responsibilities and the County or its agent(s) shall not assume, nor shall it be deemed to have assumed, any responsibility otherwise imposed upon the assurance of Contractor by this Agreement.

#### E. SAFETY EQUIPMENT

1. The Contractor shall provide to each worker on the Project work area the proper safety equipment for the duties being performed by that worker and will not permit any worker on the Project work area who fails or refuses to use the same. The County or its agent shall have the right, but not the obligation, to order the removal of a worker from the Project work site for his/her failure to comply with safe practices or substance abuse policies.

#### F. EMERGENCIES

1. In any emergency affecting the safety of persons or property, or in the event of a claimed violation of any federal or state safety or health law or regulation, arising out of or in any way connected with the Work or its performance, the Contractor shall act immediately to prevent threatened damage, injury or loss and to remedy said violation. Failing such action the County or its agent(s) may immediately take whatever steps it deems necessary including, but not limited to, suspending the Work as provided in this Agreement.
2. The County or its agent(s) may offset any and all costs or expenses of whatever nature, including attorneys' fees, paid or incurred by the County or its agent(s) (whether such fees are for in-house counsel or counsel retained by the County or its agent), in taking the steps authorized by Section 00700-25(G) (1) above against any sums then or thereafter due to the Contractor. The Contractor shall defend, indemnify and hold the County, its officers, agents, and employees harmless against any and all costs or expenses caused by or arising from the exercise by the County of its authority to act in an emergency as set out herein. If the Contractor shall be entitled to any additional compensation or extension of time change order on account of emergency work not due to the fault or

neglect of the Contractor or its Sub-Contractors, such additional compensation or extension of time shall be determined in accordance with General Condition 00700-52 and General Condition 00700-87 of this Agreement.

G. SUSPENSION OF THE WORK

1. Should, in the judgment of the County or its agent(s), the Contractor or any Sub-Contractor fail to provide a safe and healthy work place, the County or its agent shall have the right, but not the obligation, to suspend work in the unsafe areas until deficiencies are corrected. All costs of any nature (including, without limitation, overtime pay, liquidated damages or other costs arising out of delays) resulting from the suspension, by whomsoever incurred, shall be borne by the Contractor.
2. Should the Contractor or any Sub-Contractor fail to provide a safe and healthy work place after being formally notified in writing by the County or its agents of such non-compliance, the contract may be terminated following the termination provision of the contract.

H. CONTRACTOR'S INDEMNITY OF THE COUNTY FOR CONTRACTOR'S NON-COMPLIANCE WITH SAFETY PROGRAM

1. The Contractor recognizes that it has sole responsibility to assure its Safety Program is implemented and to assure its construction services are safely provided. The Contractor shall indemnify, defend and hold the County and its agents harmless, from and against any and all liability (whether public or private), penalties (contractual or otherwise), losses, damages, costs, attorneys' fees, expenses, causes of action, claims or judgments resulting, either in whole or in part, from any failure of the Contractor, its Sub-Contractors of any tier or anyone directly or indirectly employed by any of them or for whose acts any of them may be liable, to comply with the safety requirements of the contract. The Contractor shall not be relieved of its responsibilities under the safety requirements of the Contract should the County or its agent(s) act or fail to act pursuant to its rights hereunder.
2. The Contractor shall not raise as a defense to its obligation to indemnify under this Subparagraph I any failure of those indemnified hereunder to assure Contractor operates safely, it being understood and agreed that no such failure shall relieve the Contractor from its obligation to assure safe operations or from its obligation to so indemnify. The Contractor also hereby waives any rights it may have to seek contribution, either directly or indirectly, from those indemnified hereunder.
3. In any and all claims against those indemnified hereunder by any employee of the Contractor, any Sub-Contractor of any tier or anyone directly or indirectly employed by any of them or anyone for whose acts any of them may be liable, the indemnification obligation under this Subparagraph I shall not be limited in any way as to the amount or type of damages, compensation or benefits payable by or for the Contractor or any Sub-Contractor of any tier under any workers' compensation act, disability benefit or other employee benefit acts.

**00700-26 BLASTING AND EXCAVATION**

The Contractor acknowledges that it is fully aware of the contents and requirements of O.C.G.A. § 25-9-1 through 25-9-12 concerning blasting and excavation near underground gas pipes and facilities and shall fully comply therewith.

**00700-27 HIGH VOLTAGE LINES**

The Contractor acknowledges that it is fully aware of the contents and requirements O.C.G.A. § 46-3-30 through 46-3-39 concerning safeguards against contact with high voltage lines, and the Contractor shall fully comply with said provisions.

**00700-28 SCAFFOLDING AND STAGING**

The Contractor acknowledges that it is the person responsible for employing and directing others to perform labor within the meaning of O.C.G.A. § 34-1-1 and agrees to comply with said provisions.

**00700-29 CLEAN-UP**

The Contractor shall clean up all refuse, rubbish, scrap materials, and debris caused by its operations to the end that the site of the work shall present a neat, orderly and workmanlike appearance at all times.

**00700-30 PROTECTION OF WORK**

The Contractor shall be responsible for maintenance and protection of the work, which shall include any County-furnished supplies, material, equipment, until final completion of this agreement and acceptance of the work as defined herein. Any portion of the work suffering injury, damage or loss shall be considered defective and shall be corrected or replaced by the Contractor without additional cost to the County.

**00700-31 REJECTED WORK**

The Contractor shall promptly remove from the project all work rejected by the Construction Manager for failure to comply with the contract documents and the Contractor shall promptly replace and re-execute the work in accordance with the contract documents and without expense to the County. The Contractor shall also bear the expense of making good all work of other Contractors destroyed or damaged by such removal or replacement.

**00700-32 DEFECTIVE WORK**

If the Contractor defaults or neglects to carry out any portion of the work in accordance with the contract documents, and fails within three days after receipt of written notice from the Construction Manager to commence and continue correction of such default or neglect with diligence and promptness, the County may, after three days following receipt by the Contractor of an additional written notice and without prejudice to any other remedy the County may have, make good such deficiencies and complete all or any portion of any work through such means as the County may select, including the use of a separate Contractor. In such case, an appropriate change order shall be issued deducting from the payments then or thereafter due the Contractor the cost of correcting such deficiencies. In the event the payments then or thereafter due the Contractor are not sufficient to cover such amount, the Contractor shall pay the difference to the County on demand.

The County may, at its option, accept defective or nonconforming work instead of requiring its removal or correction. In such case, a change order shall be issued reducing the price due the contractor to the extent appropriate and equitable. Such contract price adjustment shall be effected whether or not final payment has been made.

**00700-33 WARRANTY OF NEW MATERIALS**

The Contractor warrants to the County that all materials and equipment furnished under this contract will be new unless otherwise specified, and the Contractor further warrants that all work will be of good quality, free from faults and defects, and in conformance with the contract documents. The warranty set forth in this paragraph shall survive final acceptance of the work.

**00700-34 CONTRACTOR'S WARRANTY OF THE WORK**

If within one year after the date of issuance of the certificate of final payment pursuant to General Condition 84, or within such longer period of time as may be prescribed by law or by the term of any applicable special warranty required by the contract documents, any of the work is found to be defective or not in accordance with the contract documents, the Contractor shall correct such work promptly after receipt of written notice from the Construction Manager to do so. This obligation shall survive both final payment for the work and termination of the contract.

**00700-35 ASSIGNMENT OF MANUFACTURERS' WARRANTIES**

Without limiting the responsibility or liability of the Contractor pursuant to this agreement, all warranties given by manufacturers on materials or equipment incorporated in the work are hereby assigned by the Contractor to the County. If requested, the Contractor shall execute formal assignments of said manufacturer's warranties to the County. All such warranties shall be directly enforceable by the County.

**00700-36 WARRANTIES IMPLIED BY LAW**

The warranties contained in this agreement, as well as those warranties implied by law, shall be deemed cumulative and shall not be deemed alternative or exclusive. No one or more of the warranties contained herein shall be deemed to alter or limit any other.

**00700-37 STOP WORK ORDERS**

In the event that the Contractor fails to correct defective work as required by the contract documents or fails to carry out the work in accordance with contract documents, the Construction Manager, in writing, may order the Contractor to stop work until the cause for such order has been eliminated. This right of the County to stop work shall not give rise to any duty on the part of the County or the Construction Manager to execute this right for the benefit of the Contractor or for any other person or entity.

**00700-38 TERMINATION FOR CAUSE**

If the Contractor is adjudged bankrupt, makes a general assignment for the benefit of creditors, suffers the appointment of a receiver on account of its insolvency, fails to supply sufficient properly skilled workers or materials, fails to make prompt payment to subcontractors or materialmen, disregards laws, ordinances, rules, regulations, or orders of any public authority having jurisdiction, fails to diligently prosecute the work, or is otherwise guilty of a material violation of this agreement and fails within seven days after receipt of written notice to commence and continue correction of such default, neglect, or violation with diligence and promptness, the County may, after seven days following

receipt by the Contractor of an additional written notice and without prejudice to any other remedy the County may have, terminate the employment of the Contractor and take possession of the site as well as all materials, equipment, tools, construction equipment and machinery thereon. The County may finish the work by whatever methods the County deems expedient. In such case, the Contractor shall not be entitled to receive any further payment until the work is completed. If the unpaid balance of the contract price exceeds the cost of completing the work, such excess shall be paid to the Contractor. If such costs exceed the unpaid balance, the Contractor shall pay the difference to the County on demand. This obligation for payment shall survive the termination of the contract. Termination of this agreement pursuant to this paragraph may result in disqualification of the Contractor from bidding on future County contracts.

#### **00700-39 TERMINATION FOR CONVENIENCE**

The County may, at any time upon written notice to the Contractor, terminate the whole or any portion of the work for the convenience of the County. The effective date of the terminations shall be provided in the written notice. Said termination shall be without prejudice to any right or remedy of the County provided herein. In addition, in the event this agreement has been terminated due to the default of the Contractor, and if it is later determined that the Contractor was not in default pursuant to the provisions of this agreement at the time of termination, then such termination shall be considered a termination for convenience pursuant to this paragraph.

#### **00700-40 TERMINATION FOR CONVENIENCE - PAYMENT**

If the Contract is terminated for convenience by the Owner as provided in this article, Contractor will be paid compensation for those services actually performed as approved by the Owner or his representative. Partially completed tasks will be compensated for based on a signed statement of completion prepared by the Project Manager and submitted to the Contractor which shall itemize each task element and briefly state what work has been completed and what work remains to be done. Contractor shall also be paid for reasonable costs for the orderly filing and closing of the project.

#### **00700-41 TERMINATION FOR CONVENIENCE - PAYMENT LIMITATIONS**

Except for normal spoilage, and except to the extent that the County shall have otherwise expressly assumed the risk of loss, there shall be excluded from the amounts payable to the Contractor the fair value, as determined by the Construction Manager, of property which is destroyed, lost, stolen or damaged so as to become undeliverable to the County or to another buyer.

#### **00700-42 COST TO CURE**

If the County terminates for cause the whole or any part of the work pursuant to this agreement, then the County may procure upon such terms and in such manner as the Construction Manager may deem appropriate, supplies or services similar to those so terminated, and the Contractor shall be liable to the County for any excess costs for such similar supplies or services. The Contractor shall continue the performance of this agreement to the extent not terminated hereunder.

#### **00700-43 ATTORNEY'S FEES**

Should the Contractor default pursuant to any of the provisions of this agreement, the Contractor and its surety shall pay to the County such reasonable attorney's fees as the

County may expend as a result thereof and all costs, expenses, and filing fees incidental thereto.

**00700-44 CONTRACTOR'S RESPONSIBILITIES UPON TERMINATION**

After receipt of a notice of termination from the County, and except as otherwise directed by the Construction Manager, the Contractor shall:

1. Stop work under the contract on the date and to the extent specified in the notice of termination;
2. Place no further orders or subcontracts for materials, services or facilities, except as may be necessary for completion of such portion of the work under the agreement as is not terminated;
3. Terminate all orders and subcontracts to the extent that they relate to the performance of work terminated by the notice of termination;
4. Assign to the County in the manner, at the times, and to the extent directed by the Construction Manager, all of the rights, title and interest of the Contractor under the orders and subcontracts so terminated, in which case the County shall have the right, at its discretion, to settle or pay any and all claims arising out of the termination of such orders or subcontracts;
5. Settle all outstanding liabilities and all claims arising out of such termination of orders and subcontracts with the approval or ratification of the Construction Manager, to the extent the Construction Manager may require, which approval or ratification shall be final for all purposes;
6. Transfer title and deliver to the entity or entities designated by the Construction Manager, in the manner, at the times, and to the extent, if any, directed by the Construction Manager, and to the extent specifically produced or specifically acquired by the Contractor for the performance of such portion of the work as has been terminated:
  - a. The fabricated or un-fabricated parts, work, and progress, partially completed supplies, and equipment, materials, parts, tools, dyes, jigs, and other fixtures, completed work, supplies, and other material produced as a part of or acquired in connection with the performance of the work terminated by the notice of termination; and
  - b. The completed or partially completed plans, drawings, information, and other property to the work.
7. Use its best efforts to sell in the manner, at the times, to the extent, and at the prices directed or authorized by the Construction Manager, any property described in Section 6 of this paragraph, provided, however, that the Contractor shall not be required to extend credit to any buyer and further provided that the proceeds of any such transfer or disposition shall be applied in reduction of any payments to be made by the County to the Contractor pursuant to this agreement.
8. Complete performance of such part of the work as shall not have been terminated by the notice of termination; and

9. Take such action as may be necessary, or as the Construction Manager may direct, for the protection and preservation of the property related to the agreement which is in the possession of the Contractor and in which the County has or may acquire an interest.

**00700-45 RECORDS**

The Contractor shall preserve and make available to the County all of its records, books, documents and other evidence bearing on the costs and expenses of the Contractor and any subcontractor pursuant to this agreement upon three days advance notice to the Contractor.

**00700-46 DEDUCTIONS**

In arriving at any amount due the Contractor pursuant to the terms of this agreement, there shall be deducted all liquidated damages, advance payments made to the Contractor applicable to the termination portion of the contract, the amount of any claim which the County may have against the Contractor, the amount determined

By the Construction Manager to be necessary to protect the County against loss due to outstanding potential liens or claims, and the agreed price of any materials acquired or sold by the Contractor and not otherwise recovered by or credited to the County.

**00700-47 REIMBURSEMENT OF THE COUNTY**

In the event of termination, the Contractor shall refund to the County any amount paid by the County to the Contractor in excess of the costs properly reimbursable to the Contractor.

**00700-48 SUSPENSION, INTERRUPTION, DELAY, DAMAGES**

The Contractor shall be entitled to only those damages and that relief from termination by the County as specifically set forth in this agreement. The Construction Manager may issue a written order requiring the Contractor to suspend, delay or interrupt all or any part of the work for such period of time as the County may determine to be appropriate for the convenience of the County. If the performance of the work is interrupted for an unreasonable period of time by an act of the County or any of its officers, agents, employees, contractors, or consultants in the administration of this agreement, an equitable adjustment shall be made for any increase in the Contractor's costs of performance and any increase in the time required for performance of the work necessarily caused by the unreasonable suspension, delay, or interruption. Any equitable adjustment shall be reduced to writing and shall constitute a modification to this agreement. In no event, however, shall an equitable adjustment be made to the extent that performance of this agreement would have been suspended, delayed or interrupted by any other cause, including the fault or negligence of the Contractor. No claim for an equitable adjustment pursuant to this paragraph shall be permitted before the Contractor shall have notified the Construction Manager in writing of the act or failure to act involved, and no claim shall be allowed unless asserted in writing to the Construction Manager within ten days after the termination of such suspension, delay or interruption.

**00700-49 COMMENCEMENT AND DURATION OF WORK**

The County may issue a Notice to Proceed at any time within 120 days following execution of the contract by the County. The Contractor shall commence work pursuant to this agreement within ten days of mailing or delivery of written notice to proceed. The

Contractor shall diligently prosecute the work to completion within the time specified therefore in the Agreement. The capacity of the Contractor's construction and manufacturing equipment and plan, sequence and method of operation and forces employed, including management and supervisory personnel, shall be such as to insure completion of the work within the time specified in the Agreement. The Contractor and County hereby agree that the contract time for completion of the work is reasonable taking into consideration the average climatic conditions prevailing in the locality of the work and anticipated work schedules of other contractors whose activities are in conjunction with or may affect the work under this contract.

**00700-50 TIME OF THE ESSENCE**

All time limits stated in this agreement are of the essence of this contract.

**00700-51 IMPACT DAMAGES**

Except as specifically provided pursuant to a stop work order or change order, the Contractor shall not be entitled to payment or compensation of any kind from the County for direct or indirect or impact damages including, but not limited to, costs of acceleration arising because of delay, disruption, interference or hindrance from any cause whatsoever whether such delay, disruption, interference or hindrance is reasonable or unreasonable, foreseeable or unforeseeable, or avoidable, provided, however, that this provision shall not preclude the recovery of damages by the Contractor for hindrances or delays due solely to fraud or bad faith on the part of the County, its agents, or employees. The Contractor shall be entitled only to extensions in the time required for performance of the work as specifically provided in the contract.

**00700-52 DELAY**

The Contractor may be entitled to an extension of the contract time, but not an increase in the contract price or damages, for delays arising from unforeseeable causes beyond the control and without the fault or negligence of the Contractor or its subcontractors for labor strikes, acts of God, acts of the public enemy, acts of the state, federal or local government in its sovereign capacity, by acts of another separate contractor, or by an act or neglect of the County.

**00700-53 INCLEMENT WEATHER**

The Contractor shall not be entitled to an extension of the contract time due to normal inclement weather. Unless the Contractor can substantiate to the satisfaction of the Construction Manager that there was greater than normal inclement weather and that such greater than normal inclement weather actually delayed the work, the Contractor shall not be entitled to an extension of time therefore. The following shall be considered the normal inclement weather days for each month listed, and extensions of time shall be granted in increments of not less than one half day only for inclement weather in excess of the days set out.

January	10 days
February	10 days
March	7 days
April	6 days
May	4 days
June	3 days
July	4 days

August	2 days
September	2 days
October	3 days
November	6 days
December	9 days

**00700-54 DELAY - NOTICE AND CLAIM**

The Contractor shall not receive an extension of time unless a Notice of Delay is filed with the Construction Manager within ten days of the first instance of such delay, disruption, interference or hindrance and a written Statement of the Claim is filed with the Construction Manager within 20 days of the first such instance. In the event that the Contractor fails to comply with this provision, it waives any claim which it may have for an extension of time pursuant to this agreement.

**00700-55 STATEMENT OF CLAIM - CONTENTS**

The Statement of Claim referenced in Article 00700-54 shall include specific information concerning the nature of the delay, the date of commencement of the delay, the construction activities affected by the delay, the person or organization responsible for the delay, the anticipated extent of the delay, and any recommended action to avoid or minimize the delay.

**00700-56 WORK BEHIND SCHEDULE, REMEDY BY CONTRACTOR**

If the work actually in place falls behind the currently updated and approved schedule, and it becomes apparent from the current schedule that work will not be completed within the contract time, the Contractor agrees that it will, as necessary, or as directed by the Construction Manager, take action at no additional cost to the County to improve the progress of the work, including increasing manpower, increasing the number of working hours per shift or shifts per working day, increasing the amount of equipment at the site, and any other measure reasonably required to complete the work in a timely fashion.

**00700-57 DILIGENCE**

The Contractor's failure to substantially comply with the requirements of the preceding paragraph may be grounds for determination by the County that the Contractor is failing to prosecute the work with such diligence as will insure its completion within the time specified. In such event, the County shall have the right to furnish, from its own forces or by contract, such additional labor and materials as may be required to comply with the schedule after 48 hours written notice to the Contractor, and the Contractor shall be liable for such costs incurred by the County.

**00700-58 SET-OFFS**

Any monies due to the Contractor pursuant to the preceding paragraph of this agreement may be deducted by the County against monies due from the County to the Contractor.

**00700-59 REMEDIES CUMULATIVE**

The remedies of the County under Articles 00700-56, 00700-57, and 00700-58 are in addition to and without prejudice to all of the rights and remedies of the County at law, in equity, or contained in this agreement.

**00700-60 TITLE TO MATERIALS**

No materials or supplies shall be purchased by the Contractor or by any Subcontractor subject to any chattel mortgage or under a conditional sales contract or other agreement by which any interest is retained by the seller. The Contractor hereby warrants that it has good and marketable title to all materials and supplies used by it in the work, and the Contractor further warrants that all materials and supplies shall be free from all liens, claims, or encumbrances at the time of incorporation in the work.

**00700-61 INSPECTION OF MATERIALS**

All materials and equipment used in the construction of the project shall be subject to adequate inspection and testing in accordance with accepted standards and in accordance with the requirements of the contract documents. Additional tests performed after the rejection of materials or equipment shall be at the Contractor's expense.

**00700-62 CONSTRUCTION MANAGER'S PRESENCE DURING TESTING**

All tests performed by the Contractor shall be witnessed by the Construction Manager unless the requirement therefore is waived in writing. The Construction Manager may perform additional tests on materials previously tested by the Contractor, and the Contractor shall furnish samples for this purpose as requested.

**00700-63 MATERIALS INCORPORATED IN WORK**

The Contractor shall furnish all materials and equipment to be incorporated in the work. All such materials or equipment shall be new and of the highest quality available. Manufactured materials and equipment shall be obtained from sources which are currently manufacturing such materials, except as otherwise specifically approved by the Construction Manager.

**00700-64 STORAGE OF MATERIALS**

Materials and equipment to be incorporated in the work shall be stored in such a manner as to preserve their quality and fitness for the work and to facilitate inspection.

**00700-65 PAYROLL REPORTS**

The Contractor may be required to furnish payroll reports to the Construction Manager as required by the Owner Controlled Insurance Program.

**00700-66 CONTRACTORS' REPRESENTATIVE**

Before beginning work, the Contractor shall notify the Construction Manager in writing of one person within its organization who shall have complete authority to supervise the work, receive orders from the Construction Manager, and represent the Contractor in all matters arising pursuant to this agreement. The Contractor shall not remove its representative without first designating in writing a new representative. The Contractor's representative shall normally be present at or about the site of work while the work is in progress. When neither the Contractor nor its representative is present at the work site,

the superintendent, foreman, or other of the Contractor' employee in charge of the work shall be an authorized representative of the Contractor.

#### **00700-67 SPECIALTY SUB-CONTRACTORS**

The Contractor may utilize the services of specialty subcontractors on those parts of the project which, under normal contracting practices, are performed by specialty subcontractors. The Contractor shall not award more than seventy-five percent of the work to subcontractors.

#### **00700-68 INSPECTION BY THE CONSTRUCTION MANAGER**

All work pursuant to this agreement shall be subject to inspection by the Construction Manager for conformity with contract drawings and specifications. The Contractor shall give the Construction Manager reasonable advance notice of operations requiring special inspection of a portion of the work.

#### **00700-69 WORK COVERED PRIOR TO CONSTRUCTION MANAGER'S INSPECTION**

In the event that work is covered or completed without the approval of the Construction Manager, and such approval is required by the specifications or required in advance by the Construction Manager, the Contractor shall bear all costs involved in inspection notwithstanding conformance of such portion of the work to the contract drawings and specifications.

#### **00700-70 SCHEDULING OF THE WORK**

***The work of this contract shall be planned, scheduled, executed, and reported as required by the Contract Documents.***

#### **00700-71 PROGRESS ESTIMATES**

The Contractor shall prepare a written report for the Construction Manager's approval, on County forms, of the total value of work performed and materials and equipment obtained to the date of submission. Such a report must accompany each request for a progress payment and is subject to review and approval by the Construction Manager. Approval of a progress estimate or tendering of a progress payment shall not be considered an approval or acceptance of any work performed, and all estimates and payments shall be subject to correction in subsequent estimates. Progress payments shall be made for all completed activities and for materials suitably stored on-site.

#### **00700-72 PROGRESS PAYMENTS**

Upon approval of each monthly estimate of work performed and materials furnished, the Construction Manager shall approve payment to the Contractor for the estimated value of such work, materials, and equipment, less the amount of all prior payments and any liquidated damages. The Contractor will be paid 100 percent, less retainage, of the cost of materials received and properly stored on-site but not incorporated into the work. Payments for materials or equipment stored on the site shall be conditioned upon submission by the Contractor of bills of sale to establish the County's title to such materials or equipment. The Contractor's request for payment shall provide sufficient detail as to the work completed or materials purchased for which payment is requested to permit meaningful review by the Construction Manager.

**00700-73 TIME OF PAYMENT**

The Contractor will be paid within 45 days following receipt of an approved Progress Estimate. The Contractor expressly agrees that the payment provisions within this Contract shall supersede the rates of interest, payment periods, and contract and subcontract terms provided for under the Georgia Prompt Pay Act, O.C.G.A. §13-11-1 et seq., and that the rates of interest, payment periods, and contract and subcontract terms provided for under the Prompt Pay Act shall have no application to this Contract. The County shall not be liable for any late payment interest or penalty.

**00700-74 RETAINAGE**

The County shall retain from each progress payment ten percent of the estimated value of the work performed until the progress payments, including retainage, total 50 percent of the contract price. If a contract includes two or more projects or assignments that have been separately priced and have separate budgets, and the performances of such projects or assignments are not related to or dependent upon the performance of any other, the 50 per cent limit shall be based upon the price for each individual project or assignment. Thereafter, no further retainage shall be withheld so long as the Contractor is making satisfactory progress to insure completion of the work within the time specified therefore. The County may reinstate the ten percent retainage in the event the Construction Manager determines that the Contractor is not making satisfactory progress to complete the work within the time specified in this agreement or in the event that the Construction Manager provides a specific cause for such withholding. The County may also withhold retainage upon substantial completion of the work as provided in O.C.G.A. §13-10-81(c). Interest may be paid upon the retainage in accordance with Georgia law.

**00700-75 PAYMENT OF SUBCONTRACTORS**

The Contractor shall promptly pay each subcontractor upon the receipt of payment from the County. Such payment shall be made from the amount paid to the Contractor pursuant to the subcontractor's work. The Contractor shall also maintain the records of the percentage retained from payments to the Contractor pursuant to such subcontractor's work. The Contractor shall procure agreements from each subcontractor requiring each subcontractor to pay their subcontractors, agents and employees in a similar manner. The County reserves the right to inquire of any subcontractor, supplier, materialmen, or subconsultant, the status of any indebtedness of the Contractor. The County further reserves the right to require the Contractor to designate on each instrument of payment exceeding \$400.00 to subcontractors, suppliers, materialmen, and subconsultants that such payment is on account of the work under this Contract.

**00700-76 COUNTY'S RESPONSIBILITIES TO SUBCONTRACTORS**

Neither the County nor the Construction Manager shall have any obligation to pay any subcontractor except as otherwise required by law.

**00700-77 PROGRESS PAYMENTS - ACCEPTANCE OF WORK**

Certification of progress payments, as well as the actual payment thereof, shall not constitute the County's acceptance of work performed pursuant to this agreement.

**00700-78 PAYMENTS IN TRUST**

All sums paid to the Contractor pursuant to this agreement are hereby declared to constitute trust funds in the hands of the contractor to be applied first to the payment of claims of subcontractors, laborers, and suppliers arising out of the work, to claims for utilities furnished and taxes imposed, and to the payment of premiums on surety and other bonds and on insurance for any other application.

**00700-79 JOINT PAYMENTS**

The County reserves the right to issue any progress payment or final payment by check jointly to the Contractor and any subcontractor or supplier.

**00700-80 RIGHT TO WITHHOLD PAYMENT**

The Construction Manager may decline to approve payment and may withhold payment in whole or in part to the extent reasonable and necessary to protect the County against loss due to defective work, probable or actual third party claims, the Contractor's failure to pay subcontractors or materialmen, reasonable evidence that the work will not be completed within the contract time or contract price or damage to the County or any other contractor on the project.

**00700-81 CERTIFICATE OF SUBSTANTIAL COMPLETION**

Upon the Contractor's submission of a request for a certificate of Substantial Completion, the Construction Manager shall inspect the work and determine whether the work is Substantially Complete. If the work is Substantially Complete, the Construction Manager shall issue a certificate of Substantial Completion of the work which shall establish the date of Substantial Completion, shall state the responsibilities of the County and the Contractor for security, maintenance, heat, utilities, damage to the work and insurance, and shall fix the time within which the Contractor shall complete the items submitted by the Contractor as requiring correction or further work. The certificate of substantial completion of the work shall be submitted to the County and the Contractor for their written acceptance of the responsibilities assigned to them pursuant to such certificate.

If in the sole opinion of the Construction Manager, the work is not substantially complete, the Construction Manager shall notify the Contractor of such, in writing, and outline requirements to be met to achieve Substantial Completion.

**00700-82 PAYMENT UPON SUBSTANTIAL COMPLETION**

Upon Substantial Completion of the work and upon application by the Contractor and approval by the Construction Manager, the County shall make payment reflecting 100% work completed, less value of work remaining as determined by Construction Manager and any authorized retainage.

**00700-83 COMMENCEMENT OF WARRANTIES**

Warranties required by this agreement shall commence on the date of final completion of the project as determined under Article 00700-84 unless otherwise provided in the certificate of Substantial Completion.

**00700-84 FINAL PAYMENT - WAIVER OF CLAIMS, DISPUTE OF FINAL PAYMENT**

The acceptance of the Substantial Completion payment shall constitute a waiver of all claims by the Contractor except those previously made in writing and identified by the Contractor as unsettled at the time of application for payment at Substantial Completion

and except for the retainage sums due at final acceptance. Following the Construction Manager's issuance of the certificate of Substantial Completion and the Contractor's completion of the work pursuant to this agreement, the Contractor shall forward to the Construction Manager a written notice that the work is ready for final inspection and acceptance. If after inspection the Construction Manager certifies that the work is complete and issues written notification of such to the Contractor, the Contractor shall forward to the Construction Manager a final application for payment. The Construction Manager shall issue a certificate for payment, which shall approve final payment to the Contractor and shall establish the date of final completion.

In the event the Contractor timely disputes the amount of the final payment, the amount due the Contractor shall be deemed by the Contractor and the County to be an unliquidated sum and no interest shall accrue or be payable on the sum finally determined to be due to the Contractor for any period prior to final determination of such sum, whether such determination be by agreement of the Contractor and the County or by final judgment of the proper court in the event of litigation between the County and the Contractor. The Contractor specifically waives and renounces any and all rights it may have under O.C.G.A. §13-6-13 and agrees that in the event suit is brought by the Contractor against the County for any sum claimed by the Contractor under the Contract or for any extra or additional work, no interest shall be awarded on any sum found to be due from the County to the Contractor in the final judgment entered in such suit. All final judgments shall draw interest at the legal rate, as specified by law.

#### **00700-85 DOCUMENTATION OF COMPLETION OF WORK**

Neither the final payment nor the remaining retainage shall become due until the Contractor submits the following documents to the Construction Manager:

- a. An affidavit that all payrolls, bills for materials and equipment, and other indebtedness connected with the work have been paid other otherwise satisfied;
- b. The surety's consent to final payment; and
- c. Any other data reasonably required by the County or Construction Manager establishing payment or satisfaction of all such obligations, including releases, waivers of liens, and documents of satisfaction of debts.

In the event that a subcontractor refuses to furnish a release or waiver as required by the County or Construction Manager, the Contractor may furnish a bond satisfactory to the County to indemnify the County against such loss. In the event that any lien or indebtedness remains unsatisfied after all payments are made, the contractor shall refund to the County all moneys that the County may become compelled to pay in discharging such lien or other indebtedness, including all costs and reasonable attorney's fees.

#### **00700-86 GOVERNING LAW**

Each and every provision of this agreement shall be construed in accordance with and governed by Georgia law. The parties acknowledge that this contract is executed in Fulton County, Georgia and that the contract is to be performed in Fulton County, Georgia. Each party hereby consents to the Fulton Superior Court's sole jurisdiction over any dispute which arises as a result of the execution or performance of this agreement, and each party hereby waives any and all objections to venue in the Fulton Superior Court.

**00700-87 CHANGES IN THE WORK****A. CHANGE ORDERS**

1. A Change Order is a written order to the Contractor signed to show the approval and the authorization of the County, issued after execution of the Contract, authorizing a change in the Work and/or an adjustment in the Contract Sum or the Contract Time. Change Orders shall be written using forms designated by the County with Contractor providing supporting documentation as required by the Construction Manager. The Contract Sum and the Contract Time may be changed only by approved Change Order pursuant to Fulton County Procedure 800-6. The amount payable by the Change Order is payment in full for all direct and indirect costs incurred and related to the work under said Change Order, including but not limited to delays, imports, acceleration, disruption and extended overhead. A Change Order signed by the Contractor indicates the Contractor's agreement therewith, including the adjustment in either or both of the Contract Sum or the Contract Time.
2. The County, without invalidating the Contract, may order changes in the Work within the general scope of the Contract as defined herein. The time allowed for performance of the work and the contract price to be paid to the Contractor may be adjusted accordingly.
3. The cost or credit to the County resulting from a change in the Work shall be determined in one or more of the following ways:
  - a. By mutual acceptance of a lump sum properly itemized and supported by sufficient substantiating data to permit evaluation;
  - b. By unit prices stated in the Contract Documents or subsequently agreed upon;
  - c. By cost to be determined in a manner agreed upon by the parties and a mutually acceptable fixed or percentage fee; or
  - d. By the method provided in Subparagraph 4a below.
4. If none of the methods set forth in Subparagraphs 3a, 3b, or 3c above is agreed upon, the Contractor, provided a written order signed by the Construction Manager is received, shall promptly proceed with the Work involved. The cost of such Work shall then be determined by the Construction Manager on basis of the reasonable expenditures and savings of those performing the Work attributable to the change. The cost of the change shall include only the items listed in Subparagraph 5a below, and in the case of either a decrease or an increase in the Contract Sum, an allowance for overhead and profit in accordance with the schedules set forth in Subparagraphs 5b and 6 below shall be applied to the cost or credit.
  - a. In such case, and also under Subparagraph 3a above, the Contractor shall keep and present, in such form as the Construction Manager may prescribe, an itemized accounting of all actual costs expended, together with appropriate supporting data for inclusion in a Change Order.



- b. For the Contractor, for any work performed by a Contractor's subcontractor, five (5) percent of the amount due the subcontractor.
  - c. For each subcontractor or sub-subcontractor involved, for any work performed by that subcontractor's or sub-subcontractor's own forces, ten (10) percent of the cost.
  - d. For each subcontractor, for work performed by a sub-subcontractor, five (5) percent of the amount due to the sub-subcontractor.
  - e. Cost to which overhead and profit is to be applied shall be determined in accordance with Subparagraph 5 above unless modified otherwise.
7. In order to facilitate checking of quotations for extras or credits, all proposals or bids, except those so minor that their propriety can be seen by inspection, shall be accompanied by a complete itemization of costs, including labor cost, materials and subcontracts. Labor and materials shall be itemized in the manner defined in Subparagraph 4 above. Where major cost items are subcontracts, they shall be itemized also. In no case shall a change be approved without such itemization.
  8. No payment shall be made for any changes to the contract that are not included in a fully executed Change Order.
- B. CONCEALED, UNKNOWN AND DIFFERING CONDITIONS
1. Should concealed conditions be encountered in the performance of the Work below the surface of the ground, or should concealed or unknown conditions in an existing structure be at variance with the conditions indicated by the Contract Documents, or should unknown physical conditions below the surface of the ground or concealed or unknown conditions in an existing structure of an unusual nature, differing materially from those ordinarily encountered and generally recognized as inherent in work of the character provided for in this Contract, be encountered, the Contract Sum and Contract Time shall be equitably adjusted by Change Order upon request by either party made **within twenty (20) days after the first observance** of the conditions. No such request for equitable adjustment shall be valid unless the Contractor complies with this (20) days notice and Subparagraph C.1. below.
  2. The Contractor shall promptly, and before such conditions are disturbed, notify the Construction Manager in writing of any claim of concealed, unknown or differing conditions pursuant to this paragraph. The Construction Manager shall authorize the Engineer to investigate the conditions, and if it is found that such conditions do materially so differ and cause an increase or decrease in the Contractor's cost of, or the time required for, performance of any part of the Work under this Contract, whether or not changed as a result of such conditions, an equitable adjustment shall be recommended to the Construction Manager.

3. No claim of the Contractor under this clause shall be allowed unless the Contractor has given the notice required in (a) above, prior to disturbing the condition.
4. No claim by the Contractor for an equitable adjustment shall be allowed if asserted after final payment under this Contract.
5. Any materially differing site condition as between what is shown on the Drawings and Specifications and actually found on site shall be immediately reported to the Construction Manager in writing prior to the commencement of Work at the site. Failure of the Contractor to notify the Construction Manager in writing of the differing site condition prior to performance of Work at the site shall constitute a waiver of any claim for additional monies. Any Change Order necessitated by the differing site condition shall be processed as provided under "Changes in the Contract".

#### C. REQUESTS FOR ADDITIONAL COST

1. If the Contractor wishes to request an increase in the Contract Sum, the Contractor shall give the Construction Manager written notice thereof within twenty (20) days after the occurrence of the event, or identification of the conditions, giving rise to such request. This notice shall be given by the Contractor before proceeding to execute the Work, except in an emergency endangering life or property in which case the Contractor shall proceed in accordance with Article 00700-25, and Subparagraph A.4 above. No such request shall be valid unless so made within the twenty (20) days specified above. If the County and the Contractor cannot agree on the amount of the adjustment in the Contract Sum, it shall be determined by the Construction Manager. Any change in the Contract Sum resulting from such claim shall be documented by Change Order.
2. If the Contractor claims that additional cost is involved because of, but not limited to (1) any written interpretation pursuant to General Condition 00700-17 of this Agreement, (2) any order by the County to stop the Work pursuant to Articles 00700-25 and 00700-37 of this Agreement where the Contractor was not at fault, or any such order by the Construction Manager as the County's agent, or (3) any written order for a minor change in the Work issued pursuant to Paragraph D below, the Contractor shall submit a request for an increase in the Contract Sum as provided in Subparagraph C.1 above. No such claim shall be valid unless the Contractor complies with Subparagraph C.1 above and approved by the County pursuant to Change Order Policy 800-6.

#### D. MINOR CHANGES IN THE WORK

The Construction Manager may order minor changes in the Work not involving an adjustment in the Contract Price, extension of the time allowed for performance of the work and not inconsistent with the intent of the Contract Documents. Such changes shall be effected by a written Change Directive issued by the Construction Manager, and shall be binding on the County and the Contractor. The Contractor shall carry out such written orders promptly.

#### E. BONDS

If any change order results in an increase in the contract price, the contractor shall increase the penal sum of the performance and payment bonds to equal the increased price.

**00700-88 DISAGREEMENT WITH ORDERS FOR CHANGE**

Contractor's written acceptance of a Change Order or other order for changes shall constitute his final and binding agreement to the provisions thereof and a waiver of all claims in connection therewith, whether direct or consequential in nature. Should Contractor disagree with any order for changes, he may submit a notice of potential claim to the Construction Manager, at such time as the order is set forth in the form of a Change Order. Disagreement with the provisions of an order for changes shall not relieve Contractor of his obligation under Article 00700-87 of this Agreement.

**00700-89 NO WAIVER OF REMEDIES**

Exercise by the County of any remedy is not exclusive of any other remedy available to County and shall not constitute a waiver of any such other remedies. Failure of the County to exercise any remedy, including breach of contract remedies, shall not preclude the County from exercising such remedies in similar circumstances in the future.

**00700-90 LAND AND RIGHTS-OF-WAY**

The owner will provide, as indicated in the Contract Documents and prior to Notice to Proceed, the lands upon which the work is to be done, right-of-way for access thereto, and such other lands which are designated for the use of the Contractor. The Contractor shall confine the Contractor's work and all associated activities to the easements and other areas designated for the Contractor's use. The Contractor shall comply with any limits on construction methods and practices which may be required by easement agreements. If, due to some unforeseen reason, the necessary easements are not obtained, the Contractor shall receive an equitable extension of contract time dependent upon the effect on the critical path of the project schedule or the County may terminate the Contract for its convenience.

**00700-91 COORDINATION WITH STATE DEPARTMENT OF TRANSPORTATION**

No clearing or grading shall be completed by Contractor within the State Department of Transportation (DOT) area under construction. The Contractor must coordinate his construction scheduling with DOT.

If the Contractor begins work before DOT's completion date, he must obtain the approval of DOT before starting work in the area. The state DOT has the right to stop the Contractor's work the DOT area.

The Contractor shall receive no additional compensation or damages resulting from delay or work stoppage from DOT actions or scheduling.

Contractor shall obtain DOT drawings of the DOT, project area for verification of road geometry, storm drains, etc. from Georgia Department of Transportation or Fulton County. The Contractor is responsible for obtaining any pertinent DOT revisions.

**INDEX**

<b>SUBJECT</b>	<b>GENERAL CONDITION</b>
Administration of Contract	17
Applicable Law	7
Assignment	13
Blasting and Excavation	26
Changes	87, 88
Clean Site	29
Codes	4
Commencement of Work	49
Contract Documents	2
Contractor's Representative	66
Defective Work	31, 32
Definitions	3
Delay	51, 52, 54, 55
Extension of Time	52, 53, 54
Familiarity of Time	1, 22
Final Payment	84
Governing Law	86
High Voltage Lines	27
Inclement Weather	53
Indemnification	15
Inspections	23, 61, 62, 68, 69
Interruption	48
Licenses	8
Liquidated Damages	46
New Materials	33, 63
Notices	24
Payment	72, 73, 75
Payment of Subcontractors	75, 76
Payment Upon Substantial Completion	82, 84
Payroll Reports	65
Permits	8
Progress Payments	72, 73, 77, 78, 79, 80
Protection of Work	30, 64
Records Inspection	45
Retainage	11, 74
Safety	25
Scaffolding and Staging	28
Scheduling	70
Service of Process	14
Stop Work Order	37
Subcontractors	67, 76
Substantial Completion	81
Suspension	48
Supervision of Work	16, 66
Surety's Responsibility	17

Taxes	9, 10
Termination for Cause	38, 44, 47
Termination for Convenience	39, 40, 41
Time of the Essence	50
Warranties	33, 34, 35, 36
Work Behind Schedule	56

**EXHIBIT A**

**FINAL AFFIDAVIT**  
**TO FULTON COUNTY, GEORGIA**

I, \_\_\_\_\_, hereby certify that all suppliers of materials, equipment and service, subcontractors, mechanic, and laborers employed by \_\_\_\_\_ or any of his subcontractors in connection with the design and/or construction of \_\_\_\_\_ at Fulton County have been paid and satisfied in full as of \_\_\_\_\_, 20\_\_\_\_, and that there are no outstanding obligations or claims of any kind for the payment of which Fulton County on the above-named project might be liable, or subject to, in any lawful proceeding at law or in equity.

\_\_\_\_\_  
Signature

\_\_\_\_\_  
Title

Personally appeared before me this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_. \_\_\_\_\_, who under Oath deposes and says that he is \_\_\_\_\_ of the firm of \_\_\_\_\_, that he has read the above statement and that to the best of his knowledge and belief same is an exact true statement.

\_\_\_\_\_  
Notary Public

\_\_\_\_\_  
My Commission expires

END OF SECTION

**Part 1 General****1.01 Description**

- A. The Project consists of the following major elements: obtaining all permits, furnishing all materials and equipment, and performing all labor necessary to install approximately 2925 linear feet of 54-inch diameter and 1550 linear feet of 12-inch ductile iron pipe (DIP) water mains and appurtenances as shown in the Project Drawings along Kimball Bridge Road in Alpharetta.
- B. All Work described above shall be performed as shown on the Drawings and as specified.

**1.02 Project Location**

- A. The project is located in Fulton County, in the City of Alpharetta, Georgia along Kimball Bridge Road.
- B. All work will be performed within the existing right-of-way and permanent easement as shown on the drawings. Any temporary easements or construction easements required are the responsibility of the contractor.

**1.03 Working Hours**

Contractor working hours will be restricted to Fulton County standard hours, from 8:30 A.M. to 5:00 P.M., or as required by the City of Alpharetta to comply with traffic control regulations and noise ordinance.

**1.04 Quantities**

The Owner reserves the right to alter the quantities of work to be performed or to extend or shorten the improvements at any time when and as found necessary, and the Contractor shall perform the work as altered, increased or decreased. Payment for such increased or decreased quantity will be made in accordance with the Instructions to Bidders. No allowance will be made for any change in anticipated profits nor shall such changes be considered as waiving or invalidating any conditions or provisions of the Contract and Bond.

END OF SECTION

## Part 1 General

### 1.01 Scope

The scope of this Section is to convey to the Contractor unique and unusual stipulations and requirements which have been established for this Project. Some of the stipulations and requirements are a result of negotiations with various entities and organizations which have an interest in this Project. Some requirements are based on technical aspects of the Project which are not otherwise conveyed to the Contractor. The provisions of this Section shall supersede the provisions of the Specifications but shall not supersede the Bidding Requirements, Contract Forms or Conditions of the Contract.

### 1.02 Standards

Existing pavement, sidewalks and curbs shall be replaced in accordance with Fulton County and Georgia Department of Transportation specifications and standards (i.e. Grey Book) to match existing conditions at a minimum.

### 1.03 Submittals

#### A. Sequence Submittal

1. Submit a proposed sequence for construction in accordance with Section 01340 with appropriate times of starting and completion of tasks to Engineer for review.
2. The Contractor may propose alternatives to the sequencing constraints to that shown in this Section in an attempt to reduce the disruption to the community or streamline the tasks associated with this Contract. The Owner and Engineer are not obligated to accept any of these alternatives.

- B. All required submittals must be approved by the Owner and Engineer prior to any on site work. This includes but is not limited to the construction sequencing schedule, erosion and sedimentation control plan, tree protection plan, traffic management plan, product shop drawings, and health and safety and loss prevention programs.

### 1.04 Existing Facility Operations

- A. The existing facilities and continuity of water service must be maintained during the time construction activities are in progress.
- B. The Contractor shall coordinate the work with the Owner so that the construction will not restrain or hinder the operation of the existing facilities. If, at any time, any portion of the facilities are out of service, the Contractor must obtain approval from the Owner, five days in advance, as

to the date, time and length of time that portion of the facilities are out of service until service is restored.

- C. After having coordinated the work with the Owner, the Contractor shall prepare a submittal in accordance with Section 01340 to include the time, time limits and methods of each connection or alteration and have the approval of the Engineer before any work is undertaken on the connections or alterations.
- D. The Contractor shall comply with the stipulations contained in permits obtained from GDOT, City of John's Creek, and the City of Alpharetta as they pertain to work hours, lane closures, noise pollution, traffic detours, and road closures.

### **1.05 Sequencing**

- A. General
  - 1. The Contractor shall be solely responsible for all construction sequencing.
  - 2. The completion of specific preliminary sequencing tasks indicated will be required prior to any significant construction activities.
  - 3. The Contractor is responsible for obtaining permit or other written agreement from the temporary and permanent owners of the Kimball Bridge Road right-of way where the project will occur.
  - 4. The Contractor to verify topography in the area of the City of Alpharetta's green way prior to the procurement of pipe materials.
  - 5. Kimball Bridge Road to remain fully operational during the execution of this project.
- B. Notify the Owner in writing at least 72 hours prior to starting work that will require taking existing facilities out of service.
- C. The Contractor may utilize multiple crews to construct the pipeline concurrently at various locations with the approval of the Owner.

END OF SECTION

**Part 1 General****1.01 Partial Occupancy By Owner**

Whenever, in the opinion of the Engineer, any section or portion of the Work or any structure is in suitable condition, it may be put into use upon the written order of the Engineer and such usage will not be held in any way as an acceptance of said Work or structure, or any part thereof, or as a waiver of any of the provisions of these Specifications and the Contract. Pending final completion and acceptance of the Work, all necessary repairs and replacements, due to defective materials or workmanship or operations of the Contractor, for any section of the Work so put into use shall be performed by the Contractor at Contractor's own expense.

END OF SECTION

**Part 1 General****1.01 Scope**

- A. The Bid lists each item of the Project for which payment will be made. No payment will be made for any items other than those listed in the Bid.
- B. Required items of work and incidentals necessary for the satisfactory completion of the work which are not specifically listed in the Bid, and which are not specified in this Section to be measured are to be included in one of the items listed in the Bid, and shall be considered as incidental to the work. All costs thereof, including Contractor's overhead costs and profit, shall be considered as included in the lump sum or unit prices bid for the various Bid items. The Contractor shall prepare the Bid accordingly.
- C. Work includes furnishing all plant, labor, equipment, tools and materials, which are not furnished by the Owner and performing all operations required to complete the work satisfactorily, in place, as specified and as indicated on the Drawings.

**1.02 Descriptions**

- A. Measurement of an item of work will be by the unit indicated in the Bid.
- B. Final payment quantities shall be determined from the record drawings. The record drawing lengths, dimensions, quantities, etc. shall be determined by a survey after the completion of all required work. Said drawings shall conform to Section 01720 of these Specifications. The precision of final payment quantities shall match the precision shown for that item in the Bid. Final payment quantities for items not shown on the drawings, for example silt fencing, shall be based on the quantity approved by the Owner or Engineer from field measurements.
- C. Lump sum items will be measured based on a well-balanced apportionment of the work complete and related materials on-hand but not installed.
- D. Payment will include all necessary and incidental related work not specified to be included in any other item of work listed in the Bid.
- E. Unless otherwise stated in individual sections of the Specifications or in the Bid, no separate payment will be made for any item of work, materials, parts, equipment, supplies or related items required to perform and complete the work. The costs for all such items required shall be included in the price bid for item of which it is a part.
- F. Payment will be made by extending unit prices multiplied by quantities provided and then summing the extended prices to reflect actual work. Such price and payment shall constitute full compensation to the Contractor for furnishing all plant, labor, equipment, tools and materials

not furnished by the Owner and for performing all operations required to provide to the Owner the entire Project, complete in place, as specified and as indicated on the Drawings.

- G. "Products" shall mean materials or equipment permanently incorporated into the work.

### **1.03 Erosion and Sedimentation Control**

#### **A. General**

1. No separate payment shall be made for temporary and/or permanent erosion and sedimentation controls, except as noted below. All other temporary and/or permanent erosion and sedimentation control costs shall be included in the unit price bid for the item to which it pertains.
2. No payment will be made for any portion of the Project for which temporary erosion and sedimentation controls are not properly maintained.
3. Quantities for payment shall be based upon actual quantity constructed by the Contractor.

- B. Reinforced Silt Fence: All costs for Type C reinforced silt fence, including installation, maintenance, repair, replacement, and removal, shall be included in the unit price bid for REINFORCED SILT FENCE.

- C. Hay Bale Check Dam: All costs for hay bale check dams, including hay bales, necessary earthwork, periodic maintenance and repair, and removal of sediment and hay bales following establishment of permanent erosion control measures shall be included in the unit price bid for HAY BALE CHECK DAM.

- D. Curb Inlet Filter: All costs for fabric, blocks, wires and the furnishing of all labor, materials, equipment and tools necessary for installation, maintenance, repair and removal shall be included in the unit price bid for CURB INLET FILTER. Payment shall be measured based on actual quantity installed.

#### **F. Water Main Grassing**

1. The unit price bid for WATER MAIN GRASSING shall be for one time clean up of the pipeline route and grassing, whether permanent, temporary, or both. Any other costs for labor, materials, and equipment for clean up and grassing of the disturbed area shall be included in the unit price bid for the item to which it pertains.
2. No additional payment will be made for those lengths of pipeline where the Contractor must reseed due to inadequate watering and

maintenance; loss of seeds caused by site erosion, e.g., wind and rain; inadequate germination of the seeds; inadequate coverage/density; providing permanent species at the appropriate season after temporary grassing has been performed.

3. No additional payment will be made for providing a temporary species of grass where the seasonal limitations do not allow for the proper germination of a permanent species of grass. Any additional cost anticipated for sowing a temporary species shall be included in the price bid for the item to which it pertains.
  4. Measurement for payment for WATER MAIN GRASSING shall be based upon the final area restored, measured to the nearest square yard. The area may include the pipeline route, or immediate adjacent areas used for construction purposes for equipment, pipe laying, excavated soil, etc., up to the edge of limit of construction shown on the Drawings.
  5. No payment will be made for any length of Water main where the clean up and grassing operation is not maintained.
- G. Sodding: Sodding where ordered by the Engineer, or as required to replace existing, shall be provided at the unit price bid for SODDING. Payment for sodding shall be in addition to the payment made for Water Main Grassing.

#### **1.04 Water Mains and Accessories**

- A. Existing Utilities and Obstructions
1. No separate payment will be made for any delay or extra cost encountered by the Contractor due to protection, avoidance or relocation of existing utilities, mains or services shown or not shown on the Drawings.
  2. Horizontal Conflict: No separate payment shall be made for changing the horizontal alignment of the water main to avoid a horizontal conflict, except where authorized for additional fittings and/or pipe.
  3. Vertical Conflict: No separate payment shall be made for lowering the water main alignment to avoid a vertical conflict, except where authorized for additional fittings, concrete encasement or steel casing where required.
- B. Construction Along Highways, Streets and Roadways: Payment for TRAFFIC CONTROL shall be made on a Lump Sum basis for maintaining, detouring and controlling traffic along highways, streets, roadways and driveways, for the Segment to which it pertains. Payment shall include the cost of erecting and maintaining barriers, signs, lights, traffic control and channelization devices, flagmen and other necessary

work to provide a safe work zone in accordance with the project Traffic Control Plan and the current Manual On Uniform Traffic Control Devices for Streets and Highways.

C. Location and Grade

1. No separate payment shall be made for any surveying performed by the Contractor for construction staking to establish or confirm the location of reference points, right of ways or easements or location and grade of the water main.
2. The CONSTRUCTION VERIFICATION SURVEYING cash allowance is solely for the use of the Engineer or Project Manager for verification of the Contractor's reference points, centerlines and work performed. The presence of this cash allowance in no way relieves the Contractor of the responsibility of, including but not limited to, installing reference points, centerlines, temporary bench marks or verifying that the work has been performed accurately.

D. Laying and Jointing Pipe and Accessories

1. Payment for DUCTILE IRON PIPE WATER MAIN shall be made for the quantity provided. Measurement for payment shall be made along the centerline of the pipe, through valves and fittings. No payment shall be made for sections of pipe which are not installed.
2. Fittings
  - a. The unit price bid for FITTINGS shall include the costs of fittings and joint accessories. Weight of fittings for payment shall be AWWA C 110 standard weight for all mechanical joint ends and shall not include the weight of bolts, glands, or cement lining.
  - b. Anchor couplings will be paid for at the unit price bid for FITTINGS and shall not be included in the quantities measured for WATER MAIN. Weight for payment of anchor couplings will be determined from the manufacturer's standard weight, including the coupling and rotating split gland.
3. Fire Hydrants
  - a. Payment for fire hydrants shall be made at the unit price bid for FIRE HYDRANT ASSEMBLY - COMPLETE. All costs for the associated valve, valve box, and hydrant lead piping or anchor couplings shall be included in the price bid for FIRE HYDRANT ASSEMBLY - COMPLETE. Fittings will be paid for separately at the unit price bid for FITTINGS.



3. The cost for making connection to existing pipe lines with couplings, including furnishing the coupling, shall be included in the unit price bid for CONNECT TO EXISTING WATER MAIN.
- F. Thrust Restraint
1. No separate payment will be made for retainer glands, lok ring or harnessing.
  2. Payment for concrete blocking shall be made at the unit price bid for THRUST BLOCKING. Quantities shall be determined from the dimensions shown on the Drawings for each size and type of fitting for which blocking is installed. The Contractor shall bear all costs for quantities in excess of the scheduled amount, as may be required due to over excavation or other reasons.
  3. No separate payment will be made for thrust collars. All costs associated with providing thrust collars as shown on the Drawings or as specified shall be included in the unit price bid for the item to which it pertains.
- G. No additional payment shall be made for abandoning existing piping or salvaging valve boxes, valve markers, fire hydrants or other materials shown on the Drawings or specified, including delivery of salvaged items to the Owner's storage yard. The cost of such work and materials shall be included in the unit price bid for WATER MAIN.
- H. No additional payment shall be made for pavement removal and replacement associated with water main abandonment or salvaging of materials. The cost of such work and materials shall be included in the unit price bid for WATER MAIN.
- I. All costs related to the implementation of the easement and permit stipulations shall be included in the unit price bid for the item to which it pertains.
- J. Clean-Up, Pressure Testing, and Disinfection: No separate payment will be made for clean-up, pressure testing, and disinfection. All costs associated with clean up, pressure testing and disinfection of water main shall be included in the unit price bid for WATER MAIN
- K. Valve Vault:
1. Measurement for VALVE VAULT shall be on a unit price basis in accordance with a well-balanced, detailed apportionment of the work complete and materials on-hand but not installed for the construction of the valve vault to house the valve at the station indicated. The apportionment shall be prepared by the Contractor and approved by the Engineer.

2. Payment shall be at the lump sum price named for the construction of the VALVE VAULT at the station indicated. Payment shall include the, concrete vault, hatch (or manhole cover), sump, ladder, miscellaneous fittings, and other work necessary to complete the valve vault as specified and as shown on the drawings. The actual valve will be paid for under the associated VALVE item.

#### L. Air Release Valve

1. Measurement for AIR RELEASE VALVE shall be on a unit price basis in accordance with a well-balanced, detailed apportionment of the work complete and materials on-hand but not installed for the construction of the air release valve at the station indicated. The apportionment shall be prepared by the Contractor and approved by the Engineer.
2. Payment for AIR RELEASE VALVE shall be made at the unit price named for the construction of the air release valve at the station indicated. The price shall constitute full payment for the air valve, piping, tee, tapping, fittings, manhole, frame & cover, stone and all related items as called for on the drawings and in the specifications.

#### M. Utility Relocation

1. Measurement for UTILITY RELOCATION shall be on a lump sum basis in accordance with a well-balanced, detailed apportionment of the work complete and materials on-hand but not installed for the relocation of the specified utility at the station indicated. The apportionment shall be prepared by the Contractor and approved by the Engineer.
2. Payment for UTILITY RELOCATION shall be made at the lump sum price named for the relocation of the specified utility at the station indicated. The price shall constitute full payment for the valves, piping, fittings, taps, by-pass system, manhole, frame & cover, stone, concrete, coordination with the utility owner and all related items as called for on the drawings and in the specifications.
3. Known utility relocations not shown under this bid item but indicated on the plans are considered incidental and the cost of which shall be included in the work to which it pertains.
4. Unknown utility conflicts that in the opinion of the Owner and Engineer require significant work to relocate (e.g. storm drains, sanitary sewers, water mains larger than 6-inch, multi-conduit duct banks) may be addressed under the Cash Allowance item for Utility Relocations. Where the removal and replacement of curb inlets and catch basins is unavoidable, that cost will be addressed under the Cash Allowance for Utility Relocations.
5. The Contractor shall anticipate minor utility conflicts, that are unknown and may not be shown on the drawings, for which additional payment will not be made.

**1.05 Bore and Jack Casing**

- A. Payment for BORE AND JACK CASING shall be made only at the completion of all work specified for the casing installation. No partial payment shall be made for the construction of the casing.
- B. Casing pipe may be included in Partial Payment Requests as stored materials, if the casing pipe is stored at the Project site. Casing pipe which has been properly installed, but has not yet been paid for as installed casing, may also be included as stored materials.
- C. In the event that rock is encountered during the installation of the pipe casing which, in the opinion of the Engineer, cannot be removed through the casing then the Engineer may authorize the Contractor to complete the work by another method via a change order.
- D. No additional payment shall be made for rock excavation through the casing or through the tunnel.
- E. Payment for pipe in casing shall be made only at the completion of all work specified for the pipe installation, at the unit price bid for WATER MAIN.

**1.06 Removing and Replacing Pavement**

- A. Payment for removing and replacing pavement will be made based on the measured quantity replaced at the unit price bid for REMOVE AND REPLACE PAVEMENT. The unit price bid shall include all costs associated with removing and replacing pavement, including providing subbase material and select backfill if necessary, traffic control and temporary measures for maintaining traffic. No separate payment shall be made for the 18-inch thick flowable fill subbase, as required by Fulton County, City of Alpharetta and City of John's Creek, the cost of which shall be included in the unit price for REMOVE AND REPLACE PAVEMENT.
- B. Payment shall be made only for that length for which the pipeline is constructed underneath the pavement as shown on the Drawings. The allowable width shall be as shown on standard details.
- C. Payment for soils testing shall be made from the SOILS, CONCRETE, ASPHALT, AND MATERIALS TESTING cash allowance. No payment shall be made for tests that fail to verify required results.
- D. No additional payment will be made for removing and replacing damaged adjacent pavement.
- E. No separate payment shall be made for pavement removal and replacement associated with abandonment of existing water mains or installation of water services.

- F. Payment for pavement resurfacing shall be made at the unit price bid for RESURFACE PAVEMENT. Limits eligible for payment shall be based on widths and lengths as shown on the Drawings. Measurement shall be made based on record drawing dimensions. The unit price bid shall include all labor, materials, tools and equipment necessary for pavement resurfacing, as specified, including milling, tack coat, surface course, and pothole repair.

#### **1.07 Remove and Replace Curb and Gutter**

- A. Payment for removing and replacing curb and gutter shall be made based on the measured quantity at the unit price bid for REMOVE AND REPLACE CURB AND GUTTER. The quantity shall be defined by the limits indicated in the Standard Details. Measurement shall be made based on record drawing dimensions.
- B. Payment for soil, asphalt and concrete testing shall be made from the SOILS, CONCRETE, ASPHALT, AND MATERIALS TESTING cash allowance. No payment shall be made for tests that fail to verify required results.
- C. No additional payment will be made for removing and replacing damaged adjacent curb and gutter caused by the Contractor.
- D. No additional payment shall be made for saw cutting curb and gutter.
- E. It is anticipated that existing curb inlets and storm drain catch basins can be avoided during construction. If the Contractor encounters a situation where the proposed pipeline cannot be installed without removal of an existing curb inlet or catch basin, then the Engineer and Owner shall be notified. If approved, the removal and replacement of the curb inlet and/or catch basin will be paid for from the UTILITY RELOCATION cash allowance.

#### **1.08 Remove and Replace Sidewalk**

- A. Payment for removing and replacing sidewalk will be made based on the measured quantity replaced at the unit price bid for REMOVE AND REPLACE SIDEWALK. Measurement shall be made based on record drawing dimensions.
- B. The unit price for removing and replacing sidewalk shall include removal and disposal of existing sidewalk, base, bricks, concrete, forms, curing and the furnishing of all labor, materials, tools and appliances, and all related items necessary to complete the work.
- C. Payment for soil, asphalt and concrete testing shall be made from the SOILS, CONCRETE, ASPHALT, AND MATERIALS TESTING cash

allowance. No payment shall be made for tests which fail to verify required results.

#### **1.09 Remove and Replace Driveway**

- A. Payment for removing and replacing driveways shall be made based on the measured quantity replaced, for the type of pavement (asphalt or concrete) at the unit price bid for REMOVE AND REPLACE PAVEMENT.
- B. No additional payment will be made for removing and replacing damaged adjacent area of driveway caused by the Contractor.
- C. No additional payment shall be made for saw cutting driveways.

#### **1.10 Concrete Encasement**

- A. No separate payment will be made for supporting existing storm or sanitary sewer pipe when installing water main crossing over or under storm or sanitary pipe. Cost for such work should be included in the unit price bid for WATER MAIN.
- B. No separate payment will be made for removing and replacing existing storm or sanitary pipe for the purpose of ease in construction when installing water main. Cost of such work should be included in the unit price bid for the item to which it pertains.
- C. Payment for concrete encasement as shown on the Drawings or as directed by the Engineer shall be made at the unit price bid for CONCRETE ENCASEMENT.

#### **1.11 Clearing and Grubbing**

- A. No separate payment shall be made for clearing and grubbing. All costs shall be included in the unit price bid for WATER MAIN.
- B. The cost of moving and reestablishing landscape features, including labor and materials, shall be included in the unit price bid for the item to which it pertains.

#### **1.12 Trench Excavation and Backfill**

- A. No separate or additional payment will be made for any special or unique method, means, techniques or equipment necessary for the Contractor's compliance with these Specifications, regulatory requirements, permits, laws or regulations which govern this Project.
- B. Trench Excavation: No separate payment will be made for trench excavation. All costs shall be included in the unit price bid for the item to which it pertains at the appropriate depth.

- C. Sheeting, Bracing and Shoring: No separate payment will be made for providing any sheeting, bracing and shoring.
- D. Trench Rock Excavation
1. Rock excavation shall be paid for as an extra in addition to payment for trench excavation provided for elsewhere in these Specifications. Payment will be made for the measured quantity of rock excavated, at the sum of the unit prices for TRENCH ROCK EXCAVATION.
  2. The unit price for TRENCH ROCK EXCAVATION is for the cost of rock excavation, the cost of additional bedding and backfill material as specified and all costs incidental thereto.
  3. The maximum allowable volume of rock excavation for payment shall be based on a trench width equal to the outside diameter of the pipe barrel plus 18 inches, but not less than 30 inches, and depth of rock on the pipe centerline, from the top of the rock to the bottom of the rock or the specified bottom of the trench, whichever has the higher elevation.
  4. The Engineer must be given reasonable notice to measure all rock.
  5. No allowance shall be made for excavating to extra widths for construction of appurtenances, for excavating to sloping sides, or for excavations made necessary by the physical limitations of the Contractor's equipment. Cost of such additional rock excavation shall be included in the unit price bid for the item to which it pertains.
  6. Payment for blasting monitoring shall be made from the BLASTING MONITORING cash allowance. A fee must be agreed upon by the Engineer prior to the Contractor employing an independent, qualified specialty subcontractor to monitor the blasting. If the Contractor employs the specialty subcontractor prior to the Engineer's approval of the fee, all such costs are subject to non reimbursement.
- E. No separate payment shall be made for dewatering.
- F. Trench Foundation and Stabilization
1. No payment for trench stabilization shall be authorized until after the trench has been dewatered. If the pipe is installed in an inadequately prepared trench bottom, the Engineer shall notify the Contractor in writing of the deficiency and will not authorize payment for that portion of that length of pipe which was improperly installed.

2. No additional payment will be made for material required for specified bedding.
3. Payment for trench stabilization shall be made on the basis of the amount authorized and the unit price bid for TRENCH STABILIZATION - BEYOND BEDDING. Payment shall include all costs for the removal and disposal of the unsuitable material and replacement with crushed stone.
4. No separate payment shall be made for Filter Fabric installed under Trench Stabilization.

G. Bedding and Haunching

1. No separate payment will be made for material used to provide specified bedding. The cost of all bedding materials shall be included in the unit price bid for water main, except for trench stabilization.
2. No additional payment will be made for additional trench depth.
3. The cost for providing Type 4 or Type 5 bedding where needed and/or specified shall be included in the unit price bid water main.
4. No additional payment will be made for improved bedding required to compensate for over excavation of the trench.

H. Initial Backfill

1. No separate payment shall be made for initial backfill.
2. No separate payment shall be made for drying out the initial backfill material in order to meet the compaction requirements.
3. No separate payment shall be made for the adding of moisture to the initial backfill materials in order to meet the compaction requirements.
4. No separate payment shall be made for providing select material if the insitu material cannot meet the compaction requirements.

I. Final Backfilling

1. No additional payment will be made for additional material when excavated materials are used.
2. No separate payment shall be made for drying out the final backfill material in order to meet the compaction requirements.

3. No separate payment shall be made for the adding of moisture to the final backfill materials in order to meet the compaction requirements.
  4. No additional payment will be made for providing select material if the insitu material cannot meet the compaction requirements.
- J. Additional Material: No separate payment will be made for additional earth or fill materials imported to the Project site.

### **1.13 Tree Protection**

- A. No separate payment will be made for preparing the Tree Protection Work Plan.
- B. Measurement for payment for Orange Safety Fence for tree protection, where ordered by the Engineer or shown on the Drawings, shall be made at the unit price bid for ORANGE SAFETY FENCE. The unit price shall include fence material, posts, signs, and labor.
- C. Payment for Type C Silt Fence in front of the Orange Safety Fence, if required by the Engineer, shall be made at the unit price bid for REINFORCED SILT FENCE.
- D. No separate payment will be made for devices used for protection of tree bark, trimming, or repairing damaged trees.
- E. No separate payment shall be made for root cutting, if required by City Arborist.

### **1.14 Cash Allowances**

- A. General
  1. The Contractor shall include in the Bid Total all allowances stated in the Contract Documents. These allowances shall cover the net cost of the services provided by a firm selected by the Owner. The Contractor's handling costs, labor, overhead, profit and other expenses contemplated for the original allowance shall be included in the items to which they pertain and not in allowances.
  2. No payment will be made for nonproductive time on the part of testing personnel due to the Contractor's failure to properly coordinate testing activities with the work schedule or the Contractor's problems with maintaining equipment in good working condition. The Contractor shall make all necessary excavations and shall supply any samples of materials necessary for conducting compaction and density tests.
  3. No payment shall be provided for services that fail to verify required results.

- B. Should the net cost be more or less than the specified amount of the allowance, the Contract will be adjusted accordingly by change order. The amount of change order will not recognize any changes in handling costs at the site, labor, overhead, profit and other expenses caused by the adjustment to the allowance.
- C. Documentation
1. Submit copies of the invoices with each periodic payment request from the firm providing the services.
  2. Submit results of services provided which verify required results.
- D. Schedule of Cash Allowances
1. Soils, Concrete, Asphalt and Materials Testing: Allow the amount provided in the Bid for the services of a geotechnical engineering firm and testing laboratory to verify soils conditions including trench excavation and backfill, asphalt coring and density tests, testing of concrete cylinders for poured in place concrete, and similar issues as directed by the Engineer.
  2. Construction Verification Surveying
    - a. Allow the amount provided in the Bid for construction surveying by an independent surveying firm, selected by the Owner, to perform horizontal and vertical alignment checks at the discretion of the Engineer.
    - b. This allowance is solely for the use of the Engineer for verification of the Contractor's reference points, centerlines and work performed. The presence of this cash allowance in no way relieves the Contractor of the responsibility of installing reference points, centerlines, temporary bench marks or verifying that the work has been performed accurately.
  3. Blasting Monitoring: Allow the amount provided in the Bid for the services of an independent, qualified specialty subcontractor to monitor the blasting, when directed by the Engineer.
  4. Additional Landscaping Not Shown on the Drawings: Allow the amount specified in the Bid for the provision of landscaping in addition to that shown on the Drawings or specified, when directed by the Engineer.
  5. Utility Conflict Resolution: Allow the amount specified in the Bid to resolve any unforeseen utility conflicts, including relocating and/or replacement.

6. Unforeseen conditions: Allow the amount specified in the Bid to resolve any unforeseen conditions, as directed and approved by the Engineer.
7. Additional Investigations and Design by Engineer: Allow the amount specified in the Bid to allow the Owner to order the Engineer of Record to perform additional subsurface utility investigations, and/or topographic surveys, and/or prepare revisions to the Drawings in order to verify site conditions and any changes to the site conditions shown on the Drawings. The Contractor will be expressly authorized to hire, on behalf of and as an agent of the Owner, the Engineer to perform the services ordered by the Owner. The Contractor shall not scope, direct or review services performed by the Engineer at any time. The Contractor shall have no responsibility or liability for the Engineer's work product or services performed at the direction of the Owner, or for any claims arising out of the Engineer's performance.
8. Temporary Access Road: Allow the amount specified in the Bid to design, obtain permits, construct and maintain a temporary access road/lane between the Buice Road and Waters Road intersections along Kimball Bridge Road, as shown on the traffic control plans and details.

END OF SECTION

## Part 1 General

### 1.01 Scope

- A. Construction staking shall include all of the surveying work required to layout the Work and control the location of the finished Project. The Contractor shall have the full responsibility for constructing the Project to the correct horizontal and vertical alignment, as shown on the Drawings, as specified, or as ordered by the Engineer. The Contractor shall assume all costs associated with rectifying work constructed in the wrong location.
- B. From the information shown on the Drawings and the information to be provided as indicated under Project Conditions below, the Contractor shall:
1. Be responsible for setting reference points and/or offsets, establishment of baselines, and all other layout, staking, and all other surveying required for the construction of the Project **and the Contractor can't claim delay for deviations.**
  2. Safeguard all reference points, stakes, grade marks, horizontal and vertical control points, and shall bear the cost of re establishing same if disturbed.
  3. Stake out the permanent and temporary easements or the limits of construction to ensure that the Work is not deviating from the indicated limits.
  4. Be responsible for all damage done to reference points, baselines, center lines and temporary bench marks, and shall be responsible for the cost of re establishment of reference points, baselines, center lines and temporary bench marks as a result of the operations.
- C. Baselines shall be defined as the line to which the location of the Work is referenced, i.e., edge of pavement, road centerline, property line, right of way or survey line.
- D. Record Drawing surveys shall be performed in accordance with Section 01720 of these Specifications.

### 1.02 Project Conditions

- A. The Drawings provide the location and/or coordinates of principal components of the Project. The alignment of some components of the Project may be indicated in the Specifications. The Engineer may order changes to the location of some of the components of the Project or provide clarification to questions regarding the correct alignment.

- B. The survey points, control points, and baseline to be provided to the Contractor shall be limited to only that information which can be found on the Project site by the Contractor.
- C. A boundary and topographic survey is included on the Drawings.

### **1.03 Quality Assurance**

- A. The Contractor shall furnish documentation, prepared by a surveyor currently registered in the State of Georgia, confirming that staking is being done to the horizontal and vertical alignment shown in the Contract Documents. This requires that the Contractor hire, at the Contractor's own expense, a currently registered surveyor, acceptable to the Owner, to provide ongoing construction staking or confirmation of such.
- B. Any deviations from the Drawings shall be confirmed by the Engineer prior to construction of that portion of the Project.
- C. Quantities for payments measured under this Contract shall be certified by the registered surveyor.
- D. Construction Verification Surveying Cash Allowance
  - 1. This cash allowance is solely for the use of the Engineer for verification of the Contractor's reference points, centerlines and work performed and is not to be used by the Contractor to provide cut sheets.
  - 2. The presence of this cash allowance in no way relieves the Contractor of the responsibility of installing reference points, centerlines, temporary bench marks, verifying that the work has been performed accurately, and all other work covered by this Section.

### **1.04 Water Mains and Accessories**

- A. Staking Precision: The precision of construction staking required shall be that which the correct location of the water main can be established for construction and verified by the Engineer. Where the location of components of the water main, e.g. fittings, valves, road crossings and are not dimensioned, the establishment of the location of these components shall be based upon scaling these locations from the Drawings with relation to readily identifiable land marks, e.g., survey reference points, power poles, manholes, etc.
- B. Reference Points
  - 1. Reference points shall be placed, at or no more than three feet, from the outside of the construction easement or right of way. The location of the reference points shall be recorded in a log with a copy provided to the Engineer for use, prior to verifying reference

point locations. Distances shall be accurately measured to 0.01 foot.

2. The Contractor shall give the Engineer reasonable notice that reference points are set. The reference point locations must be verified by the Engineer prior to commencing clearing and grubbing operations.

END OF SECTION

**Part 1 General****1.01 Scope**

- A. Permits and Responsibilities: The Contractor shall, without additional expense to the Owner, be responsible for obtaining all necessary licenses and permits, including building permits, and for complying with any applicable federal, state, county and municipal laws, codes and regulations, in connection with the prosecution of the Work.
- B. The Contractor shall take proper safety and health precautions to protect the Work, the workers, the public and the property of others.
- C. The Contractor shall also be responsible for all materials delivered and work performed until completion and acceptance of the Work, except for any completed unit of construction thereof which may heretofore have been accepted.

END OF SECTION

**Part 1 General****1.01 Description**

- A. Whenever reference is made to conforming to the standards of any technical society, organization, body, code or standard, it shall be construed to mean the latest standard, code, specification or tentative specification adopted and published at the time of advertisement for Bids. This shall include the furnishing of materials, testing of materials, fabrication and installation practices. In those cases where the Contractor's quality standards establish more stringent quality requirements, the more stringent requirement shall prevail. Such standards are made a part hereof to the extent which is indicated or intended.
- B. The inclusion of an organization under one category does not preclude those organizations' standards from applying to another category.
- C. In addition, all work shall comply with the applicable requirements of local codes, utilities and other authorities having jurisdiction.
- D. All material and equipment, for which a UL Standard, an AGA or NSF approval or an ASME requirement is established, shall be so approved and labeled or stamped. The label or stamp shall be conspicuous and not covered, painted, or otherwise obscured from visual inspection.
- E. The standards which apply to this Project are not necessarily restricted to those organizations which are listed in Article 1.02.

**1.02 Standard Organizations****A. Piping and Valves**

ACPA	American Concrete Pipe Association
ANSI	American National Standards Institute
API	American Petroleum Institute
ASME	American Society of Mechanical Engineers
AWWA	American Water Works Association
CISPI	Cast Iron Soil Pipe Institute
DIPRA	Ductile Iron Pipe Research Association
FCI	Fluid Controls Institute
MSS	Manufacturers Standardization Society
NCPI	National Clay Pipe Institute
NSF	National Sanitation Foundation
PPI	Plastic Pipe Institute
Uni Bell	PVC Pipe Association

**B. Materials**

AASHTO	American Association of State Highway and Transportation Officials
ANSI	American National Standards Institute

- |    |  |  |
|----|--|--|
|    | ASTM                                   | American Society for Testing and Materials                 |
| C. | Painting and Surface Preparation       |  |
|    | NACE                                   | National Association of Corrosion Engineers                |
|    | SSPC                                   | Steel Structures Painting Council                          |
| D. | Electrical and Instrumentation         |  |
|    | AEIC                                   | Association of Edison Illuminating Companies               |
|    | AIEE                                   | American Institute of Electrical Engineers                 |
|    | EIA                                    | Electronic Industries Association                          |
|    | ICEA                                   | Insulated Cable Engineers Association                      |
|    | IEC                                    | International Electrotechnical Commission                  |
|    | IEEE                                   | Institute of Electrical and Electronic Engineers           |
|    | IES                                    | Illuminating Engineering Society                           |
|    | IPC                                    | Institute of Printed Circuits                              |
|    | IPCEA                                  | Insulated Power Cable Engineers Association                |
|    | ISA                                    | ISA – The Instrumentation, Systems, and Automation Society |
|    | NEC                                    | National Electric Code                                     |
|    | NEMA                                   | National Electrical Manufacturers Association              |
|    | NFPA                                   | National Fire Protection Association                       |
|    | REA                                    | Rural Electrification Administration                       |
|    | TIA                                    | Telecommunications Industries Association                  |
|    | UL                                     | Underwriter's Laboratories                                 |
|    | VRCI                                   | Variable Resistive Components Institute                    |
| E. | Aluminum                               |  |
|    | AA                                     | Aluminum Association                                       |
|    | AAMA                                   | American Architectural Manufacturers Association           |
| F. | Steel and Concrete                     |  |
|    | ACI                                    | American Concrete Institute                                |
|    | AISC                                   | American Institute of Steel Construction, Inc.             |
|    | AISI                                   | American Iron and Steel Institute                          |
|    | CRSI                                   | Concrete Reinforcing Steel Institute                       |
|    | NRMA                                   | National Ready Mix Association                             |
|    | PCA                                    | Portland Cement Association                                |
|    | PCI                                    | Prestressed Concrete Institute                             |
| G. | Welding                                |  |
|    | ASME                                   | American Society of Mechanical Engineers                   |
|    | AWS                                    | American Welding Society                                   |
| H. | Government and Technical Organizations |  |
|    | AIA                                    | American Institute of Architects                           |
|    | APHA                                   | American Public Health Association                         |
|    | APWA                                   | American Public Works Association                          |

ASA	American Standards Association
ASAE	American Society of Agricultural Engineers
ASCE	American Society of Civil Engineers
ASQC	American Society of Quality Control
ASSE	American Society of Sanitary Engineers
CFR	Code of Federal Regulations
CSI	Construction Specifications Institute
EDA	Economic Development Administration
EPA	Environmental Protection Agency
FCC	Federal Communications Commission
FmHA	Farmers Home Administration
FS	Federal Specifications
IAI	International Association of Identification
ISEA	Industrial Safety Equipment Association
ISO	International Organization for Standardization
ITE	Institute of Traffic Engineers
NBFU	National Board of Fire Underwriters
(NFPA)	National Fluid Power Association
NBS	National Bureau of Standards
NISO	National Information Standards Organization
OSHA	Occupational Safety and Health Administration
SI	Salt Institute
SPI	The Society of the Plastics Industry, Inc.
USDC	United States Department of Commerce
WEF	Water Environment Federation

#### I. General Building Construction

AHA	American Hardboard Association
AHAM	Association of Home Appliance Manufacturers
AITC	American Institute of Timber Construction
APA	American Parquet Association, Inc.
APA	American Plywood Association
BHMA	Builders Hardware Manufacturers Association
BIFMA	Business and Institutional Furniture Manufacturers Association
DHI	Door and Hardware Institute
FM	Factory Mutual Fire Insurance Company
HPMA	Hardwood Plywood Manufacturers Association
HTI	Hand Tools Institute
IME	Institute of Makers of Explosives
ISANTA	International Staple, Nail and Tool Association
ISDSI	Insulated Steel Door Systems Institute
IWS	Insect Screening Weavers Association
MBMA	Metal Building Manufacturers Association
NAAMM	National Association of Architectural Metal Manufacturers
NAGDM	National Association of Garage Door Manufacturers
NCCLS	National Committee for Clinical Laboratory Standards
NFPA	National Fire Protection Association
NFSA	National Fertilizer Solutions Association
NKCA	National Kitchen Cabinet Association
NWMA	National Woodwork Manufacturers Association

	NWWDA	National Wood Window and Door Association
	RMA	Rubber Manufacturers Association
	SBC	SBCC Standard Building Code
	SDI	Steel Door Institute
	SIA	Scaffold Industry Association
	SMA	Screen Manufacturers Association
	SPRI	Single Ply Roofing Institute
	TCA	Tile Council of America
	UBC	Uniform Building Code
J.	Roadways	
	AREA	American Railway Engineering Association
	DOT	Department of Transportation
	SSRBC	Standard Specifications for Construction of Transportation Systems, Georgia Department of Transportation
K.	Plumbing	
	AGA	American Gas Association
	NSF	National Sanitation Foundation
	PDI	Plumbing Drainage Institute
	SPC	SBCC Standard Plumbing Code
L.	Refrigeration, Heating, and Air Conditioning	
	AMCA	Air Movement and Control Association
	ARI	American Refrigeration Institute
	ASHRAE	American Society of Heating, Refrigeration, and Air Conditioning Engineers
	ASME	American Society of Mechanical Engineers
	CGA	Compressed Gas Association
	CTI	Cooling Tower Institute
	HEI	Heat Exchange Institute
	IIAR	International Institute of Ammonia Refrigeration
	NB	National Board of Boilers and Pressure Vessel Inspectors
	PFMA	Power Fan Manufacturers Association
	SAE	Society of Automotive Engineers
	SMACNA	Sheet Metal and Air Conditioning Contractors National Association
	SMC	SBCC Standard Mechanical Code
	TEMA	Tubular Exchangers Manufacturers Association
M.	Equipment	
	AFBMA	Anti Friction Bearing Manufacturers Association, Inc.
	AGMA	American Gear Manufacturers Association
	ALI	Automotive Lift Institute
	CEMA	Conveyor Equipment Manufacturers Association
	CMAA	Crane Manufacturers Association of America
	DEMA	Diesel Engine Manufacturers Association
	MMA	Monorail Manufacturers Association

OPEI	Outdoor Power Equipment Institute, Inc.
PTI	Power Tool Institute, Inc.
RIA	Robotic Industries Association
SAMA	Scientific Apparatus Makers Association

**1.03            Symbols**

Symbols and material legends shall be as scheduled on the Drawings.

END OF SECTION

**Part 1 General****1.01 Scope**

- A. Work under this Section includes all scheduling and administering of pre construction and progress meetings as herein specified and necessary for the proper and complete performance of this Work.
- B. Scheduling and Administration by Engineer:
  - 1. Prepare agenda.
  - 2. Make physical arrangements for the meetings.
  - 3. Preside at meetings.
  - 4. Record minutes and include significant proceedings and decisions.
  - 5. Distribute copies of the minutes to participants.

**1.02 Preconstruction Conference**

- A. The Engineer shall schedule the preconstruction conference prior to the issuance of the Notice to Proceed.
- B. Representatives of the following parties are to be in attendance at the meeting:
  - 1. Owner.
  - 2. Engineer.
  - 3. Contractor and superintendent.
  - 4. Major subcontractors.
  - 5. Representatives of governmental or regulatory agencies when appropriate.
- C. The agenda for the preconstruction conference shall consist of the following as a minimum:
  - 1. Distribute and discuss a list of major subcontractors and a tentative construction schedule.
  - 2. Critical work sequencing.
  - 3. Designation of responsible personnel and emergency telephone numbers.

4. Processing of field decisions and change orders.
5. Adequacy of distribution of Contract Documents.
6. Schedule and submittal of shop drawings, product data and samples.
7. Pay request format, submittal cutoff date, pay date and retainage.
8. Procedures for maintaining record documents.
9. Use of premises, including office and storage areas and Owner's requirements.
10. Major equipment deliveries and priorities.
11. Safety and first aid procedures.
12. Security procedures.
13. Housekeeping procedures.
14. Work hours.

### **1.03 Project Coordination Meetings**

- A. Schedule regular monthly meetings as directed by the Engineer. Additional meetings may be requested at any time at the discretion of the Owner, Engineer or Contractor. The party requesting a meeting shall provide the other two parties with as much notice as possible, as well as a written agenda for such meeting.
- B. Hold called meetings as the progress of the Work dictates.
- C. The meetings shall be held at the location indicated by the Engineer.
- D. Representatives of the following parties are to be in attendance at the meetings:
  1. Engineer.
  2. Contractor and superintendent.
  3. Major subcontractors as pertinent to the agenda.
  4. Owner's representative as appropriate.
  5. Representatives of governmental or other regulatory agencies as appropriate.

- E. The minimum agenda for progress meetings shall consist of the following:
1. Review and approve minutes of previous meetings.
  2. Review work progress since last meeting.
  3. Note field observations, problems and decisions.
  4. Identify problems which impede planned progress.
  5. Review off site fabrication problems.
  6. Review Contractor's corrective measures and procedures to regain plan schedule.
  7. Review Contractor's revision to the construction schedule as outlined in the Supplementary Conditions.
  8. Review submittal schedule; expedite as required to maintain schedule.
  9. Maintenance of quality and work standards.
  10. Review changes proposed by Owner for their effect on the construction schedule and completion date.
  11. Complete other current business.

END OF SECTION

---

**Part 1 General**

**1.01 Scope**

- A. The work under this Section includes preparing, furnishing, distributing, and periodic updating of the construction schedules as specified herein.
- B. The purpose of the schedule is to demonstrate that the Contractor can complete the overall Project within the Contract Time and meet all required interim milestones.

**1.02 Submittals**

- A. Overall Project Schedule (OPS)
  - 1. Submit the schedule within 10 days after date of the Notice to Proceed.
  - 2. The Engineer will review the schedule and return it within 10 days after receipt.
  - 3. If required, resubmit within 10 days after receipt of a returned copy.
- B. Near Term Schedule (NTS)
  - 1. Submit the first Near Term Schedule within 10 days of the Notice to Proceed.
  - 2. The Engineer will review the schedule and return it within 10 days after receipt.
- C. Submit an update of the OPS and NTS with each progress payment request.
- D. Submit the number of copies required by the Contractor, plus four copies to be retained by the Engineer.

**1.03 Approval**

Approval of the Contractor's detailed construction program and revisions thereto shall in no way relieve the Contractor of any of Contractor's duties and obligations under the Contract. Approval is limited to the format of the schedule and does not in any way indicate approval of, or concurrence with, the Contractor's means, methods and ability to carry out the Work.

**1.04 Overall Project Schedule (OPS)**

- A. The Contractor shall submit to the Owner for approval a detailed Overall Project Schedule of the Contractor's proposed operations for the duration of the Project. The OPS shall be in the form of a Gantt/bar chart.
- B. Gantt/Bar Chart Schedule

1. Each activity with a duration of five or more days shall be identified by a separate bar. Activities with a duration of more than 20 days shall be sub divided into separate activities.
2. The schedule shall include activities for shop drawing preparation and review, fabrication, delivery, and installation of major or critical path materials and equipment items.
3. The schedule shall show the proposed start and completion date for each activity. A separate listing of activity start and stop dates and working day requirements shall be provided unless the information is shown in text form on the Gantt/bar chart.
4. The schedule shall identify the Notice to Proceed date, the Contract Completion date, major milestone dates, and a critical path.
5. The schedule shall be printed on a maximum 11 x 17 inch size paper. If the OPS needs to be shown on multiple sheets, a simplified, one page, summary bar chart showing the entire Project shall be provided.
6. The schedule shall have a horizontal time scale based on calendar days and shall identify the Monday of each week.
7. The schedule shall show the precedence relationship for each activity.

#### **1.05 Near Term Schedule (NTS)**

- A. The Contractor shall develop and refine a detailed Near Term Schedule showing the day to day activities with committed completion dates which must be performed during the upcoming 30 day period. The detailed schedule shall represent the Contractor's best approach to the Work which must be accomplished to maintain progress consistent with the Overall Project Schedule.
- B. The Near Term Schedule shall be in the form of Gantt/bar chart and shall include a written narrative description of all activities to be performed and describe corrective action to be taken for items that are behind schedule.

#### **1.06 Updating**

- A. Show all changes occurring since previous submission of the updated schedule.
- B. Indicate progress of each activity and show actual completion dates.
- C. The Contractor shall be prepared to provide a narrative report at the Project Coordination Meetings. The report shall include the following:
  1. A description of the overall Project status and comparison to the OPS.

2. Identify activities which are behind schedule and describe corrective action to be taken.
3. A description of changes or revisions to the Project and their effect on the OPS.
4. A description of the Near Term Schedule of the activities to be completed during the next 30 days. The report shall include a description of all activities requiring participation by the Engineer and/or Owner.

END OF SECTION

---

**Part 1 General****1.01 Scope**

- A. The Contractor shall furnish all equipment and labor materials required to provide the Owner with digital construction videos and photographs of the Project. Photographs and videos shall be provided on a compact disk, in DVD format.
- B. Photo and video files shall become the property of the Owner and none of the videos or photographs herein shall be published without express permission of the Owner.

**1.02 Pre and Post Construction Videos and Photographs**

- A. Prior to the beginning of any work, the Contractor shall take project videos and photographs of the work area to record existing conditions.
- B. Following completion of the work, another recording and photos shall be made showing the same areas and features as in the pre construction videos and photographs.
- C. All conditions which might later be subject to disagreement shall be shown in sufficient detail to provide a basis for decisions.
- D. The pre construction videos and photographs shall be submitted to the Engineer within 25 calendar days after the date of receipt by the Contractor of Notice to Proceed. Post construction videos and photographs shall be provided prior to final acceptance of the project.

**1.03 Progress Photographs and Submittals**

- A. Progress photograph files shall be provided on compact discs as well as hard copies.
- B. The file name of each photograph shall at a minimum contain the date the photograph was taken. All photographs shall be labeled to indicate date, time taken, and description of work shown.
- C. A minimum of 10 photographs shall be submitted with each request for payment. The view selection will be as agreed to with the Engineer. One copy of each photograph shall be submitted. Failure to include photographs may be cause for rejection of the payment request.
- D. Videos shall be submitted with a log of the items recorded, referenced to stations and property identification numbers.

END OF SECTION

## Part 1 General

### 1.01 Scope

- A. The work under this Section includes submittal to the Engineer of shop drawings, product data and samples required by the various sections of these Specifications.
- B. Submittal Contents: The submittal contents required are specified in each section.
- C. Definitions: Submittals are categorized as follows:

- 1. Shop Drawings

- a. Shop drawings shall include technical data, drawings, diagrams, procedure and methodology, performance curves, schedules, templates, patterns, test reports, calculations, instructions, measurements and similar information as applicable to the specific item for which the shop drawing is prepared.
- b. Provide newly prepared information, on reproducible sheets, with graphic information at accurate scale (except as otherwise indicated) or appropriate number of prints hereof, with name or preparer (firm name) indicated. The Contract Drawings shall not be traced or reproduced by any method for use as or in lieu of detail shop drawings. Show dimensions and note dimensions that are based on field measurement. Identify materials and products in the work shown. Indicate compliance with standards and special coordination requirements. Do not allow shop drawings to be used in connection with the Work without appropriate final "Action" markings by the Engineer.
- c. Drawings shall be presented in a clear and thorough manner. Details shall be identified by reference to sheet and detail, specification section, schedule or room numbers shown on the Contract Drawings.
- d. Minimum assembly drawings sheet size shall be 24 x 36
- e. Minimum detail sheet size shall be 8 1/2 x 11 inches.
- f. Minimum Scale:
  - i. Assembly Drawings Sheet, Scale: 1 inch = 30 feet.
  - ii. Detail Sheet, Scale: 1/4 inch = 1 foot.

inches.

- 2. Product Data

- a. Product data includes standard printed information on materials, products and systems, not specially prepared for this Project, other than the designation of selections from among available choices printed therein.
  - b. Collect required data into one submittal for each unit of work or system, and mark each copy to show which choices and options are applicable to the Project. Include manufacturer's standard printed recommendations for application and use, compliance with standards, application of labels and seals, notation of field measurements which have been checked and special coordination requirements.
3. Samples
- a. Samples include both fabricated and un fabricated physical examples of materials, products and units of work, both as complete units and as smaller portions of units of work, either for limited visual inspection or, where indicated, for more detailed testing and analysis.
  - b. Provide units identical with final condition of proposed materials or products for the work. Include "range" samples, not less than three units, where unavoidable variations must be expected, and describe or identify variations between units of each set. Provide full set of optional samples where the Engineer's selection is required. Prepare samples to match the Engineer's sample where indicated. Include information with each sample to show generic description, source or product name and manufacturer, limitations and compliance with standards. Samples are submitted for review and confirmation of color, pattern, texture and "kind" by the Engineer. Engineer will note "test" samples, except as otherwise indicated, for other requirements, which are the exclusive responsibility of the Contractor.
4. Miscellaneous submittals related directly to the Work (non administrative) i.e., maintenance agreements, workmanship bonds, project photographs, survey data and reports, physical work records, statements of applicability, quality testing and certifying reports, copies of industry standards, record drawings, field measurement data, operating and maintenance materials, overrun stock, security/protection/safety keys and similar information, devices and materials applicable to the Work but not processed as shop drawings, product data or samples.

### **1.02 Specific Category Requirements**

- A. General: Except as otherwise indicated in the individual work sections, comply with general requirements specified herein for each indicated category of submittal. Submittals shall contain:

1. The date of submittal and the dates of any previous submittals.
2. The Project title.
3. Numerical submittal numbers, starting with 1.0, 2.0, etc. Revisions to be numbered 1.1, 1.2, etc.
4. The Names of:
  - a. Contractor
  - b. Supplier
  - c. Manufacturer
5. Identification of the product, with the Specification section number, permanent equipment tag numbers and applicable Drawing No.
6. Field dimensions, clearly identified as such.
7. Relation to adjacent or critical features of the Work or materials.
8. Applicable standards, such as ASTM or Federal Specification numbers.
9. Notification to the Engineer in writing, at time of submissions, of any deviations on the submittals from requirements of the Contract Documents.
10. Identification of revisions on resubmittals.
11. An 8 x 3 inch blank space for Contractor and Engineer stamps.
12. Contractor's stamp, initialed or signed, certifying to review of submittal, verification of products, field measurements and field construction criteria and coordination of the information within the submittal with requirements of the Work and of Contract Documents.
13. Submittal sheets or drawings showing more than the particular item under consideration shall have all but the pertinent description of the item for which review is requested crossed out.

### **1.03 Routing of Submittals**

- A. Submittals and routine correspondence shall be routed as follows:
  1. Supplier to Contractor (through representative if applicable)
  2. Contractor to Engineer
  3. Engineer to Contractor and Owner
  4. Contractor to Supplier

### **Part 2 Products**

**2.01 Shop Drawings**

- A. Unless otherwise specifically directed by the Engineer, make all shop drawings accurately to a scale sufficiently large to show all pertinent features of the item and its method of connection to the Work.
- B. Submit all shop drawings in the form of six hard copies and one pdf file.
- C. One reproducible for all submittals larger than 11 x 17 inches and no more than three prints of other submittals will be returned to the Contractor.

**2.02 Manufacturer's Literature**

- A. Where content of submitted literature from manufacturers includes data not pertinent to this submittal, clearly indicate which portion of the contents is being submitted for the Engineer's review.
- B. Submit the number of copies which are required to be returned (not to exceed three) plus three copies which will be retained by the Engineer.

**2.03 Samples**

- A. Samples shall illustrate materials, equipment or workmanship and established standards by which completed work is judged.
- B. Unless otherwise specifically directed by the Engineer, all samples shall be of the precise article proposed to be furnished.
- C. Submit all samples in the quantity which is required to be returned plus one sample which will be retained by the Engineer.

**2.04 Colors**

- A. Unless the precise color and pattern is specifically described in the Contract Documents, wherever a choice of color or pattern is available in a specified product, submit accurate color charts and pattern charts to the Engineer for review and selection.
- B. Unless all available colors and patterns have identical costs and identical wearing capabilities, and are identically suited to the installation, completely describe the relative costs and capabilities of each.

**Part 3 Execution****3.01 Contractor's Coordination of Submittals**

- A. Prior to submittal for the Engineer's review, the Contractor shall use all means necessary to fully coordinate all material, including the following procedures:
  - 1. Determine and verify all field dimensions and conditions, catalog numbers and similar data.

2. Coordinate as required with all trades and all public agencies involved.
  3. Submit a written statement of review and compliance with the requirements of all applicable technical Specifications as well as the requirements of this Section.
  4. Clearly indicate in a letter or memorandum on the manufacturer's or fabricator's letterhead, all deviations from the Contract Documents.
- B. Each and every copy of the shop drawings and data shall bear the Contractor's stamp showing that they have been so checked. Shop drawings submitted to the Engineer without the Contractor's stamp will be returned to the Contractor for conformance with this requirement.
- C. The Owner may back charge the Contractor for costs associated with having to review a particular shop drawing, product data or sample more than two times to receive a "No Exceptions Taken" mark.
- D. Grouping of Submittals
1. Unless otherwise specifically permitted by the Engineer, make all submittals in groups containing all associated items.
  2. No review will be given to partial submittals of shop drawings for items which interconnect and/or are interdependent. It is the Contractor's responsibility to assemble the shop drawings for all such interconnecting and/or interdependent items, check them and then make one submittal to the Engineer along with Contractor's comments as to compliance, non compliance or features requiring special attention.
- E. Schedule of Submittals
1. Within 30 days of Contract award and prior to any shop drawing submittal, the Contractor shall submit a schedule showing the estimated date of submittal and the desired approval date for each shop drawing anticipated. A reasonable period shall be scheduled for review and comments. Time lost due to unacceptable submittals shall be the Contractor's responsibility and some time allowance for resubmittal shall be provided. The schedule shall provide for submittal of items which relate to one another to be submitted concurrently.

### **3.02 Timing of Submittals**

- A. Make all submittals far enough in advance of scheduled dates for installation to provide all required time for reviews, for securing necessary approvals, for possible revision and resubmittal, and for placing orders and securing delivery.

- B. In scheduling, allow sufficient time for the Engineer's review following the receipt of the submittal.

### **3.03 Reviewed Shop Drawings**

#### **A. Engineer Review**

1. Allow a minimum of 30 days for the Engineer's initial processing of each submittal requiring review and response, except allow longer periods where processing must be delayed for coordination with subsequent submittals. The Engineer will advise the Contractor promptly when it is determined that a submittal being processed must be delayed for coordination. Allow a minimum of two weeks for reprocessing each submittal. Advise the Engineer on each submittal as to whether processing time is critical to progress of the Work, and therefore the Work would be expedited if processing time could be foreshortened.
  2. Acceptable submittals will be marked "No Exceptions Taken". A minimum of three copies will be retained by the Engineer for Engineer's and the Owner's use and the remaining copies will be returned to the Contractor.
  3. Submittals requiring minor corrections before the product is acceptable will be marked "Make Corrections Noted". The Contractor may order, fabricate and ship the items included in the submittals, provided the indicated corrections are made. Drawings must be resubmitted for review and marked "No Exceptions Taken" prior to installation or use of products.
  4. Submittals marked "Amend and Resubmit" must be revised to reflect required changes and the initial review procedure repeated.
  5. The "Rejected See Remarks" notation is used to indicate products which are not acceptable. Upon return of a submittal so marked, the Contractor shall repeat the initial review procedure utilizing acceptable products.
  6. Only two copies of items marked "Amend and Resubmit" and "Rejected See Remarks" will be reviewed and marked. One copy will be retained by the Engineer and the other copy with all remaining unmarked copies will be returned to the Contractor for resubmittal.
- B. No work or products shall be installed without a drawing or submittal bearing the "No Exceptions Taken" notation. The Contractor shall maintain at the job site a complete set of shop drawings bearing the Engineer's stamp.
  - C. Substitutions: In the event the Contractor obtains the Engineer's approval for the use of products other than those which are listed first in the Contract Documents, the Contractor shall, at the Contractor's own expense and using methods approved by the Engineer, make any changes to structures, piping and electrical work that may be necessary to accommodate these products.

- D. Use of the “No Exceptions Taken” notation on shop drawings or other submittals is general and shall not relieve the Contractor of the responsibility of furnishing products of the proper dimension, size, quality, quantity, materials and all performance characteristics, to efficiently perform the requirements and intent of the Contract Documents. The Engineer's review shall not relieve the Contractor of responsibility for errors of any kind on the shop drawings. Review is intended only to assure conformance with the design concept of the Project and compliance with the information given in the Contract Documents. The Contractor is responsible for dimensions to be confirmed and correlated at the job site. The Contractor is also responsible for information that pertains solely to the fabrication processes or to the technique of construction and for the coordination of the work of all trades.

### **3.04 Resubmission Requirements**

- A. Shop Drawings
1. Revise initial drawings as required and resubmit as specified for initial submittal, with the resubmittal number shown.
  2. Indicate on drawings all changes which have been made other than those requested by the Engineer.
- B. Project Data and Samples: Resubmit new data and samples as specified for initial submittal, with the resubmittal number shown.

END OF SECTION

**Part 1 General****1.01 Scope**

- A. This Section includes testing which the Owner may require, beyond that testing required of the manufacturer, to determine if materials provided for the Project meet the requirements of these Specifications.
- B. This work also includes all testing required by the Owner to verify work performed by the Contractor is in accordance with the requirements of these Specifications, i.e., concrete strength and slump testing, soil compaction, etc.
- C. This work does not include materials testing required in various sections of these Specifications to be performed by the manufacturer, e.g., testing of pipe.
- D. The testing laboratory or laboratories will be selected by the Owner. The testing laboratory or laboratories will work for the Owner.

**1.02 Payment for Testing Services**

- A. The cost of testing services required by the Contract to be provided by the Contractor shall be paid for by the Owner through the CASH ALLOWANCE, i.e., concrete testing, soil compaction, and asphalt testing.
- B. The cost of additional testing services not specifically required in the Specifications, but requested by the Owner or Engineer, shall be paid for by the Owner through the CASH ALLOWANCE.
- C. The cost of material testing described in various sections of these Specifications or as required in referenced standards to be provided by a material manufacturer, shall be included in the price bid for that item and shall not be paid for by the Owner.
- D. The cost of retesting any item that fails to meet the requirements of these Specifications shall be paid for by the Contractor. Retesting shall be performed by the testing laboratory working for the Owner.

**1.03 Laboratory Duties**

- A. Cooperate with the Owner, Engineer and Contractor.
- B. Provide qualified personnel promptly on notice.
- C. Perform specified inspections, sampling and testing of materials.
  - 1. Comply with specified standards, ASTM, other recognized authorities, and as specified.
  - 2. Ascertain compliance with requirements of the Contract Documents.
- D. Promptly notify the Engineer and Contractor of irregularity or deficiency of work which are observed during performance of services.

- E. Promptly submit three copies (two copies to the Engineer and one copy to the Contractor) of report of inspections and tests in addition to those additional copies required by the Contractor with the following information included:
1. Date issued
  2. Project title and number
  3. Testing laboratory name and address
  4. Name and signature of inspector
  5. Date of inspection or sampling
  6. Record of temperature and weather
  7. Date of test
  8. Identification of product and Specification section
  9. Location of Project
  10. Type of inspection or test
  11. Results of test
  12. Observations regarding compliance with the Contract Documents
- F. Perform additional services as required.
- G. The laboratory is not authorized to release, revoke, alter or enlarge on requirements of the Contract Documents, or approve or accept any portion of the Work.

#### **1.04 Contractor Responsibilities**

- A. Cooperate with laboratory personnel, provide access to Work and/or manufacturer's requirements.
- B. Provide to the laboratory, representative samples, in required quantities, of materials to be tested.
- C. Furnish copies of mill test reports.
- D. Furnish required labor and facilities to:
1. Provide access to Work to be tested;
  2. Obtain and handle samples at the site;
  3. Facilitate inspections and tests;

4. Build or furnish a holding box for concrete cylinders or other samples as required by the laboratory.
- E. Notify the laboratory sufficiently in advance of operation to allow for the assignment of personnel and schedules of tests.
- F. Laboratory Tests: Where such inspection and testing are to be conducted by an independent laboratory agency, the sample(s) shall be selected by such laboratory or agency, or the Engineer, and shipped to the laboratory by the Contractor at Contractor's expense.
- G. Copies of all correspondence between the Contractor and testing agencies shall be provided to the Engineer.

#### **1.05 Quality Assurance**

Testing shall be in accordance with all pertinent codes and regulations and with procedures and requirements of the American Society for Testing and Materials (ASTM).

#### **1.06 Product Handling**

Promptly process and distribute all required copies of test reports and related instructions to insure all necessary retesting or replacement of materials with the least possible delay in the progress of the Work.

#### **1.07 Furnishing Materials**

The Contractor shall be responsible for furnishing all materials necessary for testing.

#### **1.08 Code Compliance Testing**

Inspections and tests required by codes or ordinances or by a plan approval authority, and made by a legally constituted authority, shall be the responsibility of, and shall be paid for by the Contractor, unless otherwise provided in the Contract Documents.

#### **1.09 Contractor's Convenience Testing**

Inspection or testing performed exclusively for the Contractor's convenience shall be the sole responsibility of the Contractor.

#### **1.10 Schedules for Testing**

##### **A. Establishing Schedule**

1. The Contractor shall, by advance discussion with the testing laboratory selected by the Owner, determine the time required for the laboratory to perform its tests and to issue each of its findings, and make all arrangements for the testing laboratory to be on site to provide the required testing.

2. Provide all required time within the construction schedule.
- B. When changes of construction schedule are necessary during construction, coordinate all such changes of schedule with the testing laboratory as required.
  - C. When the testing laboratory is ready to test according to the determined schedule, but is prevented from testing or taking specimens due to incompleteness of the Work, all extra costs for testing attributable to the delay will be back charged to the Contractor and shall not be borne by the Owner.

#### **1.11 Taking Specimens**

Unless otherwise provided in the Contract Documents, all specimens and samples for tests will be taken by the testing laboratory or the Engineer.

#### **1.12 Transporting Samples**

The Contractor shall be responsible for transporting all samples, except those taken by testing laboratory personnel, to the testing laboratory.

END OF SECTION

**Part 1 General****1.01 Scope**

- A. Temporary facilities required for this work include, but are not necessarily limited to:
  - 1. Temporary utilities such as water and electricity.
  - 2. First aid facilities.
  - 3. Sanitary facilities.
  - 4. Potable water.
  - 5. Temporary enclosures and construction facilities.
- B. Temporary utilities for field offices shall be as specified in Section 01590 of these Specifications.

**1.02 General**

- A. First aid facilities, sanitary facilities and potable water shall be available on the Project site on the first day that any activities are conducted on site. The other facilities shall be provided as the schedule of the Project warrants.
- B. Maintenance: Use all means necessary to maintain temporary facilities in proper and safe condition throughout progress of the Work. In the event of loss or damage, immediately make all repairs and replacements necessary, at no additional cost to the Owner.
- C. Removal: Remove all such temporary facilities and controls as rapidly as progress of the Work will permit.

**1.03 Temporary Utilities**

- A. General
  - 1. Provide and pay all costs for all water, electricity and other utilities required for the performance of the Work.
  - 2. Pay all costs for temporary utilities until Project completion.
  - 3. Costs for temporary utilities shall include all power, water and the like necessary for testing equipment as required by the Contract Documents.
- B. Temporary Water: Provide all necessary temporary piping, and upon completion of the Work, remove all such temporary piping. Provide and remove water meters.
- C. Temporary Electricity

1. Provide all necessary wiring for the Contractor's use.
2. Furnish, locate and install area distribution boxes such that the individual trades may use, their own construction type extension cords to obtain adequate power, and artificial lighting at all points where required by inspectors and for safety.

#### **1.04 First Aid Facilities**

The Contractor shall provide a suitable first aid station, equipped with all facilities and medical supplies necessary to administer emergency first aid treatment. The Contractor shall have standing arrangements for the removal and hospital treatment of any injured person. All first aid facilities and emergency ambulance service shall be made available by the Contractor to the Owner and the Engineer's personnel.

#### **1.05 Sanitary Facilities**

Prior to starting the Work, the Contractor shall furnish, for use of Contractor's personnel on the job, all necessary toilet facilities which shall be secluded from public observation. These facilities shall be either chemical toilets or shall be connected to the Owner's sanitary sewer system. All facilities, regardless of type, shall be kept in a clean and sanitary condition and shall comply with the requirements and regulations of the area in which the Work is performed. Adequacy of these facilities will be subject to the Engineer's review and maintenance of same must be satisfactory to the Engineer at all times.

#### **1.06 Potable Water**

The Contractor shall be responsible for furnishing a supply of potable drinking water for employees, subcontractors, inspectors, engineers and the Owner who are associated with the Work.

#### **1.07 Enclosures and Construction Facilities**

Furnish, install and maintain for the duration of construction, all required scaffolds, tarpaulins, canopies, steps, bridges, platforms and other temporary construction necessary for proper completion of the Work in compliance with all pertinent safety and other regulations.

#### **1.08 Parking Facilities**

Parking facilities for the Contractor's and Contractor's subcontractors' personnel shall be the Contractor's responsibility. The storage and work facilities provided by the Owner will not be used for parking by the Contractor's or subcontractor's personnel.

END OF SECTION

**Part 1 General****1.01 Barricades, Lights and Signals**

- A. The Contractor shall furnish and erect such barricades, fences, lights and danger signals and shall provide such other precautionary measures for the protection of persons or property and of the Work as necessary. Barricades shall be painted in a color that will be visible at night. From sunset to sunrise, the Contractor shall furnish and maintain at least one light at each barricade and sufficient numbers of barricades shall be erected to keep vehicles from being driven on or into any Work under construction.
- B. The Contractor will be held responsible for all damage to the Work due to failure of barricades, signs and lights and whenever evidence is found of such damage, the Contractor shall immediately remove the damaged portion and replace it at Contractor's cost and expense. The Contractor's responsibility for the maintenance of barricades, signs and lights shall not cease until the Project has been accepted by the Owner.

END OF SECTION

**Part 1 General****1.01 Scope**

- A. Limit blowing dust caused by construction operations by applying water or employing other appropriate means or methods to maintain dust control, subject to the approval of the Owner. As a minimum, this may require the use of a water wagon twice a day to suppress dusty conditions.
- B. Excavated material stored overnight shall be covered with a heavy duty tarp and kept moist to control dust.

**1.02 Protection of Adjacent Property**

- A. The Bidders shall visit the site and note the buildings, landscaping, roads, parking areas and other facilities near the Work site that may be damaged by their operations. The Contractor shall make adequate provision to fully protect the surrounding area and will be held fully responsible for all damages resulting from Contractor's operations.
- B. Protect all existing facilities (indoors or out) from damage by dust, fumes, spray or spills (indoors or out). Protect motors, bearings, electrical gear, instrumentation and building or other surfaces from dirt, dust, welding fumes, paint spray, spills or droppings causing wear, corrosion, malfunction, failure or defacement by enclosure, sprinkling or other dust palliatives, masking and covering, exhausting or containment.

END OF SECTION

**Part 1 General****1.01 Scope**

- A. The work under this Section shall include maintaining up to four Project signs for the duration of the project. Maintenance of the signs shall include:
1. Erecting the signs in the current work area
  2. Moving signs as the work area shifts, and as directed by the  
Engineer
- B. The project signs will be approximately 36-inches by 48-inches, metal, DOT type.
- C. The Contractor shall provide steel mounting posts and bolts appropriate for supporting the project signs for the duration of the project.

END OF SECTION

## **Part 1 General**

### **1.01 Scope**

This Section outlines the restrictions and requirements for substitutions, product and manufacturer options, and construction method options.

### **1.02 Definitions**

A. For the purposes of these Contract Documents, a “substitute item” shall be defined as one of the following:

1. A product or manufacturer offered as a replacement to a specified product or manufacturer.
2. A product or manufacturer offered in addition to a specified product or manufacturer.

B. For the purposes of these Contract Documents, a “substitute construction method” shall be defined as one of the following:

1. A mean, method, technique, sequence or procedure of construction offered as a replacement for a specified mean, method, technique, sequence or procedure of construction.
2. A mean, method, technique, sequence or procedure of construction offered in addition to a specified mean, method, technique, sequence or procedure of construction.

### **1.03 General**

A. An item or construction method, which is offered where no specific product, manufacturer, mean, method, technique, sequence or procedure of construction is specified or shown on the Drawings, shall not be considered a substitute and shall be at the option of the Contractor, subject to the provisions in the Contract Documents for that item or construction method.

B. For products specified only by a referenced standard, the Contractor may select any product by any manufacturer, which meets the requirements of the Specifications, unless indicated otherwise in the Contract Documents.

C. If the manufacturer is named on the Drawings or in the Specifications as an acceptable manufacturer, products of that manufacturer meeting all requirements of the Specifications and Drawings are acceptable.

D. Whenever the Engineer's design is based on a specific product of a particular manufacturer, that manufacturer will be shown on the Drawings and/or listed first in the list of approved manufacturers in the Specifications. Any Bidder intending to furnish products of other than the first listed manufacturer, or furnish substitute items, shall

1. Verify that the item being furnished will fit in the space allowed, perform the same functions and have the same capabilities as the item specified.
  2. Include in its Bid the cost of all accessory items which may be required by the other listed substitute product,
  3. Include the cost of any architectural, structural, mechanical, piping, electrical or other modifications required, and
  4. Include the cost of required additional work by the Engineer, if any, to accommodate the item.
- E. Whenever a product is identified on the Drawings or in the Specifications by reference to manufacturers or vendors names, trade names, catalog numbers, etc., it is intended only to denote the quality standard of product desired and that they do not restrict Bidders to a specific brand, make, manufacturer or specific name. These listings and citations are used only to set forth and convey to Bidders the general style, type, character and quality of product desired. Equivalent products will be acceptable, subject to the substitution provisions of this Section.
- ? F. Whenever a product specification includes minimum experience requirements which the manufacturer selected by the Contractor cannot meet, the manufacturer shall furnish the Owner with a cash deposit, or bond acceptable to the Owner in an amount equal to the cost of the product, which shall remain in effect until the experience requirement has been met.

#### **1.04 Approvals**

Approval, of a substitution as an acceptable manufacturer, of the Engineer is dependent on determination that the product offered is essentially equal in function, performance, quality of manufacture, ease of maintenance, reliability, service life and other criteria to that on which the design is based; and will require no major modifications to structures, electrical systems, control systems or piping systems.

#### **1.05 Substitutions and Options**

- Form.
- A. No substitutions will be considered for the manufacturers listed in the Bid
  - B. After Notice to Proceed
    1. Substitute items will be considered only if the term “equal to” precedes the names of acceptable manufacturers in the Specification.

2. Where items are specified by referenced standard or specified as indicated in Article 1.03, Paragraph A. above, such items shall be submitted to the Engineer for review.
  3. The Contractor shall submit shop drawings on the substitute item for the Engineer's review in accordance with the Section 01340.
- C. Prior to Opening of Bids
1. No consideration or approvals will be made for products specified by a referenced standard, or specified as indicated in Article 1.02, Paragraph A. above. Such consideration may occur only after the Notice to Proceed.
  2. No consideration or approvals will be made for products being offered where the term "equal to" precedes the name of an approved product. Such substitution consideration may occur only after the Notice to Proceed.
  3. If the term "or equal" follows the names of acceptable manufacturers, then other manufacturers desiring approval as an acceptable manufacturer may submit the product information to the Engineer for approval during the bidding phase, as indicated below. With the exception of where the phrase "no substitutions" is associated with a list of manufacturers, where a list of acceptable manufacturers is not preceded by the phrase "equal to", the list of acceptable manufacturers shall be considered as having the phrase "or equal" following the list, and the list being subject to the "or equal" provisions of this section.
  4. The manufacturer shall include the following items in its "or equal" submittal:
    - a. Descriptive literature including information on materials used, minimum design standards, standard design features, manufacturing processes and facilities, and similar information which will indicate experience and expertise in the manufacture of the product being evaluated.
    - b. Performance specifications applicable to the manufacturer's standard design which indicates the level of performance to be expected from the product.
    - c. A complete set of submittal drawings of similar products which have been completed and placed into operation.
    - d. A list of existing installations of products similar in type and size, information required to satisfy specified experience requirements, or a copy of the bond to be submitted in lieu of experience.

- e. Evidence of technical ability of the manufacturer to design and manufacture products meeting Project requirements.
  - f. Evidence submitted shall include, as a minimum, descriptions of engineering and manufacturing staff capabilities.
  - g. A copy of the manufacturer's most recent annual business report. Include a statement comparing the present net worth of the manufacturer in comparison to the total value of all products proposed to be furnished. Net worth must exceed the total value of all products proposed.
  - h. A complete description of field service capabilities, including the location of field service facilities which would serve the proposed facility and the number and qualifications of personnel working from that location.
  - i. A complete list of all requirements of the Drawings and Specifications with which the manufacturer cannot conform, including reasons why alternate features are considered equivalent.
  - j. If descriptive literature or drawings illustrate standard products with design features or materials not in compliance with Project requirements then these exceptions must be specifically listed. Failure to do so will indicate intent by the manufacturer to modify design features and alter materials to meet Project requirements.
  - k. Where additional information is submitted to supplement the submittal, all changes to the list of exceptions shall be specifically noted.
  - l. All other information necessary to fully evaluate the product for consideration.
5. This “or equal” submittal shall reach the Engineer no later than 14 days prior to the Bid date. Submittals which do not include a complete list of exceptions to Project requirements, or the statement “No exceptions to the Specifications will be taken”, will automatically be rejected by the Engineer. Manufacturers will be advised of approval or rejection in writing no later than 10 days prior to the Bid date. Rejected submittals may be supplemented with additional information and resubmitted no later than five days prior to the Bid date. Manufacturers making supplementary submittals will be advised of approval or rejection in writing no later than one day prior to the Bid date.

6. Bids based on products which have not received the approval of the Engineer may be determined non-responsive by the Owner and rejected.

END OF SECTION

**Part 1 General****1.01 Scope**

This Section covers the general cleaning which the Contractor shall be required to perform both during construction and before final acceptance of the Project unless otherwise shown on the Drawings or specified elsewhere in these Specifications.

**1.02 Quality Assurance**

- A. Daily, and more often if necessary, conduct inspections verifying that requirements of cleanliness are being met.
- B. In addition to the standards described in this Section, comply with all pertinent requirements of governmental agencies having jurisdiction.

**1.03 Hazardous Material and Waste**

- A. The Contractor shall handle hazardous waste and materials in accordance with applicable local, state, and federal regulations. Waste shall also be disposed of in approved landfills as applicable.
- B. The Contractor shall prevent accumulation of wastes which create hazardous conditions.
- C. Burning or burying rubbish and waste materials on the site shall not be allowed.
- D. Disposal of hazardous wastes or materials into sanitary or storm sewers shall not be allowed.

**1.04 Disposal of Surplus Materials**

Unless otherwise shown on the Drawings, specified or directed, the Contractor shall legally dispose off the site all surplus materials and equipment from demolition and shall provide suitable off site disposal site, or utilize a site designated by the Owner.

**Part 2 Products****2.01 Cleaning Materials and Equipment**

Provide all required personnel, equipment and materials needed to maintain the specified standard of cleanliness.

**2.02 Compatibility**

Use only the cleaning materials, methods and equipment which are compatible with the surface being cleaned, as recommended by the manufacturer of the material or as approved by the Engineer.



**Part 3 Execution****3.01 Progress Cleaning****A. General**

1. Do not allow the accumulation of scrap, debris, waste material and other items not required for construction of this Work.
2. At least each week, and more often if necessary, completely remove all scrap, debris and waste material from the job site.
3. Provide adequate storage for all items awaiting removal from the job site, observing all requirements for fire protection and protection of the environment.

**B. Site**

1. Daily, and more often if necessary, inspect the site and pick up all scrap, debris and waste material. Remove all such items to the place designated for their storage.
2. Restack materials stored on site weekly.
3. At all times maintain the site in a neat and orderly condition which meets the approval of the Engineer.

**3.02 Final Cleaning**

- A. **Definitions:** Unless otherwise specifically specified, “clean” for the purpose of this Article shall be interpreted as the level of cleanliness generally provided by commercial building maintenance subcontractors using commercial quality building maintenance equipment and materials.
- B. **General:** Prior to completion of the Work, remove from the job site all tools, surplus materials, equipment, scrap, debris and waste. Conduct final progress cleaning as described in 3.01 above.
- C. **Site:** Unless otherwise specifically directed by the Engineer, hose down all paved areas on the site and all public sidewalks directly adjacent to the site; rake clean other surfaces of the grounds. Completely remove all resultant debris.
- D. **Post Construction Cleanup:** All evidence of temporary construction facilities, haul roads, work areas, structures, foundations of temporary structures, stockpiles of excess or waste materials, or any other evidence of construction, as directed by the Engineer.
- E. **Restoration of Landscape Damage:** Any landscape feature damaged by the Contractor shall be restored as nearly as possible to its original

condition at the Contractor's expense. The Engineer will decide what method of restoration shall be used.

- F. Timing: Schedule final cleaning as approved by the Engineer to enable the Owner to accept the Project.

### **3.03 Cleaning During Owner's Occupancy**

Should the Owner occupy the Work or any portion thereof prior to its completion by the Contractor and acceptance by the Owner, responsibilities for interim and final cleaning of the occupied spaces shall be as determined by the Engineer in accordance with the Supplementary Conditions of the Contract Documents.

END OF SECTION

**Part 1 General****1.01 Scope**

- A. The work under this Section includes, but is not necessarily limited to, the compiling, maintaining, recording and submitting of project record as-built documents as herein specified.
- B. Record documents include, but are not limited to:
  - 1. Drawings;
  - 2. Specifications;
  - 3. Change orders and other modifications to the Contract;
  - 4. Engineer field orders or written instructions, including Requests for Information (RFI) and Clarification Memorandums;
  - 5. Reviewed shop drawings, product data and samples;
  - 6. Test records.
- C. The Contractor shall maintain on the Project site throughout the Contract Time an up to date set of Record Drawings.

**1.02 Maintenance of Documents and Samples**

- A. Storage
  - 1. Store documents and samples in the Contractor's field office, apart from documents used for construction.
  - 2. Provide files and racks for storage of documents.
  - 3. Provide locked cabinet or secure storage space for storage of samples.
- B. File documents and samples in accordance with format of these Specifications.
- C. Maintenance
  - 1. Maintain documents in a clean, dry, legible condition and in good order.
  - 2. Do not use record documents for construction purposes.
  - 3. Maintain at the site for the Owner one copy of all record documents.

- D. Make documents and samples available at all times for inspection by Engineer.
- E. Failure to maintain the Record Documents in a satisfactory manner may be cause for withholding of a certificate for payment.

### **1.03 Quality Assurance**

- A. Unless noted otherwise, Record Drawings shall provide dimensions, distances and coordinates to the nearest 0.1 foot.
- B. Unless noted otherwise, Record Drawings shall provide elevations to the nearest 0.01 foot for all pertinent items constructed by the Contractor.
- C. Record Drawings shall be approved by the Engineer prior to final submittal.

### **1.04 Recording**

- A. Label each document "Project Record" in neat, large printed letters.
- B. Recording
  - 1. Record information concurrently with construction progress.
  - 2. Do not conceal any work until required information is recorded.

### **1.05 Record Drawings**

- A. The Contractor shall provide two sets of full size marked up Contract drawings, with all changes recorded in each set. Additionally, two CDs of Record Drawing AutoCAD files shall be provided to the Owner. The original project AutoCAD files will be made available to the Contractor for use in creating the Record Drawings.
- B. Legibly mark drawings to record actual construction, including:
  - 1. All Construction
    - a. Changes of dimension and detail.
    - b. Changes made by Requests for Information (RFI), field order, clarification memorandums or by change order.
    - c. Details not on original Drawings.
  - 2. Site Improvements, Including Underground Utilities
    - a. Horizontal and vertical locations of all exposed and underground utilities and appurtenances, both new

- facilities constructed and those utilities encountered, referenced to permanent surface improvements.
- b. Location of and dimensions of roadways and parking areas, providing dimensions to back of curb when present.
  - c. The locations shall be referenced to at least two easily identifiable, permanent landmarks (e.g., power poles, valve markers, etc.) or benchmarks.
  - d. The Record Drawings shall include the horizontal angle and distance between manhole covers.
3. Structures (When applicable)
- a. Depths of various elements of foundation in relation to finish first floor datum or top of wall.
  - b. Location of internal and buried utilities and appurtenances concealed in the construction, referenced to visible and accessible features of the structure.

#### **1.06 Specifications**

- A. Legibly mark each section to record:
1. Manufacturer, trade name, catalog number, and supplier of each product and item of equipment actually installed.
  2. Changes made by Requests for Information (RFI), field order, clarification memorandums, or by change order.

#### **1.07 Submittal**

- A. At contract closeout, deliver Record Documents to the Engineer for the Owner.
- B. Accompany submittal with transmittal letter, in duplicate, containing:
1. Date
  2. Project title and number
  3. Contractor's name and address
  4. Title and number of each record document
  5. Signature of Contractor or Contractor's authorized representative

END OF SECTION

## Part 1 General

### 1.01 Project Maintenance and Warranty

- A. Maintain and keep in good repair the Work covered by these Drawings and Specifications until acceptance by the Owner.
- B. The Contractor shall warrant for a period of one year from the date of Owner's written acceptance of certain segments of the Work and/or Owner's written final acceptance of the Project, as defined in the Contract Documents, that the completed Work is free from all defects due to faulty products or workmanship and the Contractor shall promptly make such corrections as may be necessary by reason of such defects. The Owner will give notice of observed defects with reasonable promptness. In the event that the Contractor should fail to make such repairs, adjustments or other work that may be made necessary by such defects, the Owner may do so and charge the Contractor the cost thereby incurred. The Performance Bond shall remain in full force and effect throughout the warranty period.
- C. The Contractor shall not be obligated to make replacements which become necessary because of ordinary wear and tear, or as a result of improper operation or maintenance, or as a result of improper work or damage by another Contractor or the Owner, or to perform any work which is normally performed by a maintenance crew during operation.
- D. In the event of multiple failures of major consequences prior to the expiration of the one year warranty described above, the affected unit shall be disassembled, inspected and modified or replaced as necessary to prevent further occurrences. All related components which may have been damaged or rendered non serviceable as a consequence of the failure shall be replaced. A new 12 month warranty against defective or deficient design, workmanship, and materials shall commence on the day that the item is reassembled and placed back into operation. As used herein, multiple failure shall be interpreted to mean two or more successive failures of the same kind in the same item or failures of the same kind in two or more items. Major failures may include, but are not limited to, cracked or broken housings, piping, or vessels, excessive deflections, bent or broken shafts, broken or chipped gear teeth, premature bearing failure, excessive wear or excessive leakage around seals. Failures which are directly and clearly traceable to operator abuse, such as operations in conflict with published operating procedures or improper maintenance, such as substitution of unauthorized replacement parts, use of incorrect lubricants or chemicals, flagrant over or under lubrication and using maintenance procedures not conforming with published maintenance instructions, shall be exempted from the scope of the one year warranty. Should multiple failures occur in a given item, all products of the same size and type shall be disassembled, inspected, modified or replaced as necessary and rewarranted for one year.

- E. The Contractor shall, at Contractor's own expense, furnish all labor, materials, tools and equipment required and shall make such repairs and removals and shall perform such work or reconstruction as may be made necessary by any structural or functional defect or failure resulting from neglect, faulty workmanship or faulty materials, in any part of the Work performed by the Contractor. Such repair shall also include refilling of trenches, excavations or embankments which show settlement or erosion after backfilling or placement.
- F. Except as noted on the Drawings or as specified, all structures such as embankments and fences shall be returned to their original condition prior to the completion of the Contract. Any and all damage to any facility not designated for removal, resulting from the Contractor's operations, shall be promptly repaired by the Contractor at no cost to the Owner.
- G. The Contractor shall be responsible for all road and entrance reconstruction and repairs and maintenance of same for a period of one year from the date of final acceptance. In the event the repairs and maintenance are not made immediately and it becomes necessary for the owner of the road to make such repairs, the Contractor shall reimburse the owner of the road for the cost of such repairs.
- H. In the event the Contractor fails to proceed to remedy the defects upon notification within 15 days of the date of such notice, the Owner reserves the right to cause the required materials to be procured and the work to be done, as described in the Drawings and Specifications, and to hold the Contractor and the sureties on Contractor's bond liable for the cost and expense thereof.
- I. Notice to Contractor for repairs and reconstruction will be made in the form of a registered letter addressed to the Contractor at Contractor's home office.
- J. Neither the foregoing paragraphs nor any provision in the Contract Documents, nor any special guarantee time limit implies any limitation of the Contractor's liability within the law of the place of construction.

END OF SECTION

## Part 1 General

### 1.01 Project Maintenance and Warranty

- A. Maintain and keep in good repair the Work covered by these Drawings and Specifications until acceptance by the Owner.
- B. The Contractor shall warrant for a period of one year from the date of Owner's written acceptance of certain segments of the Work and/or Owner's written final acceptance of the Project, as defined in the Contract Documents, that the completed Work is free from all defects due to faulty products or workmanship and the Contractor shall promptly make such corrections as may be necessary by reason of such defects. The Owner will give notice of observed defects with reasonable promptness. In the event that the Contractor should fail to make such repairs, adjustments or other work that may be made necessary by such defects, the Owner may do so and charge the Contractor the cost thereby incurred. The Performance Bond shall remain in full force and effect throughout the warranty period.
- C. The Contractor shall not be obligated to make replacements which become necessary because of ordinary wear and tear, or as a result of improper operation or maintenance, or as a result of improper work or damage by another Contractor or the Owner, or to perform any work which is normally performed by a maintenance crew during operation.
- D. In the event of multiple failures of major consequences prior to the expiration of the one year warranty described above, the affected unit shall be disassembled, inspected and modified or replaced as necessary to prevent further occurrences. All related components which may have been damaged or rendered non serviceable as a consequence of the failure shall be replaced. A new 12 month warranty against defective or deficient design, workmanship, and materials shall commence on the day that the item is reassembled and placed back into operation. As used herein, multiple failure shall be interpreted to mean two or more successive failures of the same kind in the same item or failures of the same kind in two or more items. Major failures may include, but are not limited to, cracked or broken housings, piping, or vessels, excessive deflections, bent or broken shafts, broken or chipped gear teeth, premature bearing failure, excessive wear or excessive leakage around seals. Failures which are directly and clearly traceable to operator abuse, such as operations in conflict with published operating procedures or improper maintenance, such as substitution of unauthorized replacement parts, use of incorrect lubricants or chemicals, flagrant over or under lubrication and using maintenance procedures not conforming with published maintenance instructions, shall be exempted from the scope of the one year warranty. Should multiple failures occur in a given item, all products of the same size and type shall be disassembled, inspected, modified or replaced as necessary and rewarranted for one year.

- E. The Contractor shall, at Contractor's own expense, furnish all labor, materials, tools and equipment required and shall make such repairs and removals and shall perform such work or reconstruction as may be made necessary by any structural or functional defect or failure resulting from neglect, faulty workmanship or faulty materials, in any part of the Work performed by the Contractor. Such repair shall also include refilling of trenches, excavations or embankments which show settlement or erosion after backfilling or placement.
- F. Except as noted on the Drawings or as specified, all structures such as embankments and fences shall be returned to their original condition prior to the completion of the Contract. Any and all damage to any facility not designated for removal, resulting from the Contractor's operations, shall be promptly repaired by the Contractor at no cost to the Owner.
- G. The Contractor shall be responsible for all road and entrance reconstruction and repairs and maintenance of same for a period of one year from the date of final acceptance. In the event the repairs and maintenance are not made immediately and it becomes necessary for the owner of the road to make such repairs, the Contractor shall reimburse the owner of the road for the cost of such repairs.
- H. In the event the Contractor fails to proceed to remedy the defects upon notification within 15 days of the date of such notice, the Owner reserves the right to cause the required materials to be procured and the work to be done, as described in the Drawings and Specifications, and to hold the Contractor and the sureties on Contractor's bond liable for the cost and expense thereof.
- I. Notice to Contractor for repairs and reconstruction will be made in the form of a registered letter addressed to the Contractor at Contractor's home office.
- J. Neither the foregoing paragraphs nor any provision in the Contract Documents, nor any special guarantee time limit implies any limitation of the Contractor's liability within the law of the place of construction.

END OF SECTION

## **Part 1 General**

### **1.01 Scope**

A. Clearing and grubbing includes, but is not limited to, removing from the Project site, trees, stumps, roots, brush, structures, abandoned utilities, trash, debris and all other materials found on or near the surface of the ground in the construction area and understood by generally accepted engineering practice not to be suitable for construction of the type contemplated. Precautionary measures that prevent damage to existing features including trees, to remain is part of the Work.

B. Clearing and grubbing operations shall be coordinated with temporary and permanent erosion and sedimentation control requirements.

### **1.02 Quality Assurance**

A. The Contractor shall comply with applicable codes, ordinances, rules, regulations and laws of local, municipal, state or federal authorities having jurisdiction over the Project. All required permits of a temporary nature shall be obtained for construction operations by the Contractor.

### **1.03 Job Conditions**

Location of the Work: The area to be cleared and grubbed is shown schematically on the Drawings or specified here. It includes all areas designated for construction, which is limited to no more than 6-feet width along the water main alignment.

## **Part 2 Products**

### **2.01 Equipment**

The Contractor shall furnish equipment of the type normally used in clearing and grubbing operations including, but not limited to, tractors, trucks, loaders and root rakes.

## **Part 3 Execution**

### **3.01 Scheduling of Clearing**

A. The Contractor shall clear at each construction site only that length of the right-of-way, permanent or construction easement which would be the equivalent of two week's pipe laying. This length shall be determined from the Contractor's Progress Schedule.

B. The Engineer may permit clearing for additional lengths of the pipe line provided that temporary erosion and sedimentation controls are in place and a satisfactory stand of temporary grass is established. Should a satisfactory stand of grass not be possible, no additional clearing shall be permitted beyond that specified above.

C. A satisfactory stand of grass shall have no bare spots larger than one square yard. Bare spots shall be scattered and the bare area shall not comprise more than one percent of any given area.

### **3.02 Clearing and Grubbing**

A. Clear and grub no more than 3 feet on each side of the pipeline centerline before excavating. Remove all trees, growth, debris, stumps and other objectionable matter. Clear the construction easement or road right-of-way only if necessary.

B. Materials to be cleared, grubbed and removed from the Project site include, but are not limited to, all trees, stumps, roots, brush, trash, organic matter, paving, miscellaneous structures, houses, debris and abandoned utilities.

C. Grubbing shall consist of completely removing roots, stumps, trash and other debris from all graded areas so that topsoil is free of roots and debris. Topsoil is to be left sufficiently clean so that further picking and raking will not be required.

D. All stumps, roots, foundations and planking embedded in the ground shall be removed and disposed of. Piling and butts of utility poles shall be removed to a minimum depth of two feet below the limits of excavation for structures, trenches and roadways or two feet below finish grade, whichever is lower.

E. Landscaping features shall include, but are not necessarily limited to, fences, cultivated trees, cultivated shrubbery, property corners, man-made improvements, subdivision and other signs within the right-of-way and easement. The Contractor shall take extreme care in moving landscape features and promptly re-establishing these features.

F. Surface rocks and boulders shall be grubbed from the soil and removed from the site if not suitable as rip rap.

G. Where the tree limbs interfere with utility wires, or where the trees to be felled are in close proximity to utility wires, the tree shall be taken down in sections to eliminate the possibility of damage to the utility. Contact city of Alpharetta's arborist prior to cutting any tree limbs.

H. Any work pertaining to utility poles shall comply with the requirements of the appropriate utility.

I. All fences adjoining any excavation or embankment that, in the Contractor's opinion, may be damaged or buried, shall be carefully removed, stored and replaced. Any fencing that, in the Engineer's opinion, is significantly damaged shall be replaced with new fence material.

J. The Contractor shall exercise special precautions for the protection and preservation of trees, cultivated shrubs, sod, fences, etc. situated within the limits of the construction area. The Contractor shall be held liable for any damage the Contractor's operations have inflicted on such property. No trees shall be cut without consultation with and approval of the Engineer and the City of Alpharetta's arborist.

K. The Contractor shall be responsible for repairs and/or replacement of all damages to existing improvements resulting from Contractor's operations.

### **3.03 Disposal of Debris**

A. The debris resulting from the clearing and grubbing operation shall be hauled to a disposal site secured by the Contractor and shall be disposed of in accordance with all requirements of

federal, state, county and municipal regulations. No debris of any kind shall be deposited in any stream or body of water, or in any street or alley. No debris shall be deposited upon any private property except with written consent of the property owner. In no case shall any material or debris be left on the Project, shoved onto abutting private properties or buried on the Project site.

END OF SECTION

## **Part 1 General**

### **1.01 Scope**

A. The Work specified in this Section consists of providing and maintaining temporary and permanent erosion and sedimentation controls as shown on the Drawings. This Section also specifies the subsequent removal of temporary erosion and sedimentation controls.

B. Temporary and permanent erosion and sedimentation controls include grassing and mulching of disturbed areas and structural barriers at those locations which will ensure that erosion during construction will be maintained within acceptable limits. Acceptable limits are as established by the Georgia Erosion and Sedimentation Control Act of 1975, as amended, Section 402 of the Federal Clean Water Act, and applicable codes, ordinances, rules, regulations, and laws of local, state, and municipal authorities having jurisdiction.

C. Land disturbance activity shall not commence until the Land Disturbance Permit has been issued.

### **1.02 Submittals**

Submit product data in accordance with the requirements of Section 01340 of these Specifications.

### **1.03 Quality Assurance**

A. The temporary and permanent erosion and sedimentation control measures shown on the Drawings are minimum suggested requirements. Any additional erosion and sedimentation control measures required by the Contractor's means, methods, techniques, and sequence of operation will be installed by the Contractor at no additional cost to the Owner.

B. Perform all Work under this Section in accordance with all pertinent rules and regulations including, but not necessarily limited to, those stated in these Specifications. Where provisions of pertinent rules and regulations conflict with these Specifications the more stringent provisions shall govern.

C. Provide all materials and promptly take all actions necessary to achieve effective erosion and sedimentation control in accordance with the Georgia Erosion and Sedimentation Control Act of 1975 as amended (OCGA §12-7-1, et. seq.), local ordinances, other permits, local enforcing agency guidelines, and these Specifications.

#### **D. Basic Principles:**

1. Coordinate the land disturbance activities to fit the topography, soil types, and conditions.
2. Minimize the disturbed area and the duration of exposure to erosive elements.
3. Provide temporary or permanent stabilization to disturbed areas immediately after rough grading is complete.

4. Safely convey run-off from the site to a stable outlet to prevent flooding and damage to downstream facilities resulting from increased runoff from the site.
5. Retain sediment on-site that was generated on-site.
6. Minimize encroachment upon watercourses.

E. Implementation:

1. The Contractor is solely responsible for the control of erosion within the Project site and the prevention of sedimentation from leaving the Project site or entering waterways.
2. The Contractor shall install temporary and permanent erosion and sedimentation controls which will ensure that runoff from the disturbed area of the Project site shall pass through a filter system before exiting the Project site.
3. The Contractor shall provide temporary and permanent erosion and sedimentation control measures to prevent silt and sediment from entering the waterways and designated wetland areas. The Contractor shall maintain an undisturbed vegetative buffer a minimum of 25 feet from the top of the bank.
4. The Contractor shall limit land disturbance activity to those areas shown on the Drawings.
5. The Contractor shall maintain erosion and sedimentation control measures within disturbed areas on the entire site at no additional cost to the Owner until the final acceptance of the Project. Maintenance shall include mulching, re-seeding, clean-out of sediment barriers and sediment ponds, replacement of washed-out or undermined rip rap and erosion control materials, to the satisfaction of the Owner and Engineer.
6. All fines imposed for improper erosion and sedimentation control shall be paid by the Contractor.

## **Part 2 Products**

### **2.01 Sediment Barrier**

A. Silt Fence:

1. Type C Silt Fence is a combination of Type A silt Fence with woven wire reinforcement. Type C Silt Fence reinforcement shall meet the requirements of Section 171 of Georgia D.O.T. Specifications.
2. Silt fence fabric shall be an approved product on the Georgia DOT Qualified Product List No. 36, latest edition.

B. Hay Bales: Hay bales shall be clean, seed-free cereal hay, rectangular in shape, and contain five cubic feet or more of material.

C. Concrete Blocks: Concrete blocks shall be hollow, non-load-bearing type.

? D. Plywood shall be 3/4-inch thick exterior type.

## **2.02 Construction Exit Stone**

Use sound, tough, durable stone resistant to the action of air and water. Slabby or shaley pieces will not be acceptable. Aggregate size shall be in accordance with the National Stone Association Size R-2 (1.5 to 3.5-inch stone) or Type 3 rip rap stone conforming to Section 805.01 of the Georgia Department of Transportation Standard Specifications.

## **??2.03 Concrete**

Concrete shall conform to the requirements specified in Section 02225 of these Specifications for 3000 psi concrete.

## **2.04 Rip Rap**

A. Stone Rip Rap: Use sound, tough, durable stones resistant to the action of air and unless noted otherwise, stone rip rap shall be Type 1.

1. Type 1 Rip Rap: Rip rap size and gradation shall conform to Section 805.01 of the Georgia Department of Transportation Standard Specification for Type 1 Stone Dumped Rip Rap.
2. Type 3 Rip Rap: Rip rap size and gradation shall conform to Section 805.01 of the Georgia Department of Transportation Standard Specifications for Type 3 Stone Dumped Rip Rap.

B. Sand Cement Bag Rip Rap: Sand cement bag rip rap shall conform to the Georgia Department of Transportation Standard Specifications, Section 603.

## **2.05 Plastic Filter Fabric**

A. Plastic filter fabric shall conform to the Georgia Department of Transportation Standard Specifications, Section 881, for filter fabrics.

B. Plastic filter fabric shall be an approved product on the Georgia Department of Transportation Qualified Product List No. 28, latest edition.

## **2.06 Grassing**

A. Grassing materials shall meet the requirements of the Georgia Department of Transportation Standard Specifications, latest edition; as shown in the table:

Material	Section No.
Topsoil	893.01
Seed and Sod	890
Fertilizer	891.01
Agricultural Lime	882.02
Mulch	893.02
Inoculants	893.04

B. Seed species shall be provided as shown on the Drawings.

C. Mulch Binder: Mulch on slopes exceeding 3 (horizontal) to 1 (vertical) shall be held in place by the use of a mulch binder, as approved by the Engineer. The mulch binder shall be non-toxic to plant and animal life and shall be approved by the Engineer.

D. Water: Water shall be free of excess and harmful chemicals, organisms, and substances which may be harmful to plant growth or obnoxious to traffic. Salt or brackish water shall not be used. Water shall be furnished by the Contractor.

### **Part 3 Execution**

#### **3.01 General**

A. Temporary and permanent erosion and sedimentation control measures shall prevent erosion and prevent sediment from exiting the site. If, in the opinion of the Owner, Engineer, or state inspector, the Contractor's temporary erosion and sedimentation control measures are inadequate, the Contractor shall provide additional maintenance for existing measures or additional devices to control erosion and sedimentation on the site at no additional cost to the Owner.

B. All erosion and sedimentation control devices and structures shall be inspected by the Contractor at least once a week and immediately after each rainfall occurrence. Any device or structure found to be damaged shall be repaired or replaced by the end of the day.

C. All erosion and sedimentation control measures and devices shall be constructed and maintained as indicated on the Drawings or specified herein until adequate permanent disturbed area stabilization has been provided and accepted by the Engineer. Once adequate permanent stabilization has been provided and accepted by the Engineer, all temporary erosion and sedimentation control structures and devices shall be removed.

#### **3.02 Sediment Control**

A. Construction Exit:

1. Construction exit(s) shall be placed as shown on the Drawings and as directed by the Engineer. A construction exit shall be located at any point traffic will be leaving a disturbed area to a public right-of-way, street, alley, sidewalk, or parking area.

2. Placement of Construction Exit Material: The ground surface upon which the construction exit material is to be placed shall be prepared to a smooth condition free from obstructions, depressions or debris. The plastic filter fabric shall be placed to provide a minimum number of overlaps and a minimum width of one foot of overlap at each joint. The stone shall be placed with its top elevation conforming to the surrounding ground elevations. The stone shall be dropped from no more than a three feet height during construction.
3. Construction Exit Maintenance: The Contractor shall regularly maintain the exit with the top dressing of stone to prevent tracking or flow of soil onto public rights-of-way and paved surfaces as directed by the Engineer.
4. Construction Exit Removal: Construction exit(s) shall be removed and properly disposed of when the disturbed area has been properly stabilized, the tracking or flow of soil onto public rights-of-way or paved surfaces has ceased and as directed by the Engineer.

B. Sediment Barriers:

1. Sediment barriers shall include, but are not necessarily limited to, silt fences, hay bales, and any device which prevents sediment from exiting the disturbed area.
2. Silt fences and hay bales shall not be used in any flowing stream, creek, or river.
3. Sediment barriers shall be installed as shown on the Drawings and as directed by the Owner or Engineer.
4. Sediment barriers shall be maintained to ensure the depth of impounded sediment is no more than one-half of the original height of the barrier or as directed by the Engineer. Torn, damaged, destroyed, or washed-out barriers shall be repaired, reinforced, or replaced with new material and installed as shown on the Drawings and as directed by the Owner or Engineer.
5. Accumulated sediment shall be removed from the barrier and replaced and stabilized on-site as directed by the Owner or Engineer.
6. Sediment barrier shall be removed once the disturbed area has been stabilized with a permanent vegetative cover and the sediment barrier is no longer required as directed by the Engineer.
7. All non-biodegradable parts of the barrier shall be disposed of properly.
8. The disturbed area created by barrier removal shall be permanently stabilized.

C. Sediment Boxes: All inlet grates shall be covered with sediment boxes during grading operations and shall remain so covered until all open areas are permanently stabilized against erosion.

### **3.03 Erosion Control**

#### **A. Rip Rap**

1. Rip rap shall be placed as shown on the Drawings and as directed by the Engineer. Rip rap shall be placed at all points where natural vegetation is disturbed on the banks of active streams. Compact backfill and place rip rap to prevent subsequent settlement and erosion. This requirement applies equally to construction alongside a stream as well as crossing a stream or drainage ditch.
2. When trenching across a stream or drainage ditch, place rip rap over the entire disturbed area upstream and downstream of the trench excavation. Place rip rap across creek bottom, across creek banks, and extend rip rap placement five feet beyond the top of each creek bank.
3. Preparation of Foundations: The ground surface upon which the rip rap is to be placed shall be brought to the correct lines and grades before placement is commenced. Where filling of depressions is required, the new material shall be compacted with hand or mechanical tampers. Unless at creek banks or otherwise shown or specified, rip rap shall begin in a toe ditch constructed in original ground around the toe of the fill or the cut slope. The toe ditch shall be two feet deep in original ground, and the side next to the fill or cut shall have that same slope. After the rip rap is placed, the toe ditch shall be backfilled and the excess dirt spread neatly on the site.
4. Placement of Plastic Filter Fabric:
  - a. Plastic filter fabric shall be placed under all rip rap unless shown or specified otherwise.
  - b. Filter fabric shall not be placed under rip rap on stream or drainage ditch crossings.
  - c. The surface to receive filter fabric shall be prepared to a smooth condition free from obstructions, depressions, and debris. The filter fabric shall be installed with the long dimension running up the slope and shall be placed to provide a minimum number of overlaps. The fabric shall be placed to provide a minimum width of one foot of overlap at each joint. The fabric shall be placed so that the upstream strip overlaps the downstream strip. The fabric shall be anchored in place with securing pins of the type recommended by the fabric manufacturer. Pins shall be placed on or within 3-inches of the centerline of the overlap. The fabric shall be placed loosely to avoid stretching and tearing during placement of the stone. The fabric shall be protected at all times during construction from clogging due to clay, silts, chemicals, or other contaminants. Contaminated fabric or fabric damaged during installation or during placement of rip rap shall be removed and replaced with uncontaminated and undamaged fabric at no additional cost to the Owner.

5. Placement of Rip Rap: Rip rap shall be placed on a 6-inch layer of soil, crushed stone or sand overlaying the filter fabric. Rip rap shall be placed with its top elevation conforming with the finished grade or the natural existing slope of the stream bank and stream bottom. The stone shall be dropped from no more than a three foot height during construction. Stone rip rap shall be placed to provide a uniform surface to the thickness shown on the Drawings. The thickness tolerance for the course shall be -3 inches and +6 inches.
- B. Grassing:
1. Temporary Stabilization: Temporary stabilization shall be provided as shown on the Drawings and conforming to these Specifications to control erosion on the site. Temporary stabilization shall be provided to any area that will not receive permanent stabilization within the next 14 calendar days. Partial payment requests may be withheld for those portions of the Project not complying with this requirement.
  2. Permanent Stabilization:
    - a. Permanent stabilization shall be provided as shown on the Drawings and conforming to these Specifications to control erosion on the site. Permanent stabilization shall be provided to all areas of land disturbance within seven calendar days of the completion of land disturbance for any area greater than 0.25 acre.
    - b. Where permanent stabilization cannot be immediately established because of an inappropriate season, the Contractor shall provide temporary stabilization. The Contractor shall return to the site at the appropriate season to provide permanent stabilization in areas that received only temporary stabilization.
  3. Grassing shall meet the requirements of Section 700 of the Georgia Department of Transportation Standard Specifications, latest edition, unless specified otherwise.
  4. Seed rate, fertilization and other requirements shall be provided as shown on the Drawings.

### **3.04 Clean-Up**

- A. Dispose of all excess erosion and sedimentation control materials in a manner satisfactory to the Owner and Engineer.
- B. Final clean-up shall be performed in accordance with the requirements of these Specifications and to the satisfaction of the Owner and Engineer.

END OF SECTION

## Part 1 General

### 1.01 Scope

A. The work under this Section consists of furnishing all labor, equipment and materials and performing all operations in connection with the trench excavation and backfill required to install the water lines as shown on the Drawings and as specified.

B. Excavation shall include the removal of any trees, stumps, brush, debris or other obstacles which remain after the clearing and grubbing operations, which may obstruct the work, and the excavation and removal of all earth, rock or other materials to the extent necessary to install the pipeline and appurtenances in conformance with the lines and grades shown on the Drawings and as specified.

C. Backfill shall include the refilling and compaction of the fill in the trenches and excavations up to the surrounding ground surface or road grade at crossing.

D. The trench is divided into five specific areas:

1. Foundation: The area beneath the bedding, sometimes also referenced to as trench stabilization.
2. Bedding: The area above the trench bottom (or foundation) and below the bottom of the barrel of the pipe.
3. Haunching: The area above the bottom of the barrel of the pipe up to a specified height above the bottom of the barrel of the pipe.
4. Initial Backfill: The area above the haunching material and below a plane 18 inches above the top of the barrel of the pipe.
5. Final Backfill: The area above a plane 18-inches above the top of the barrel of the pipe.

E. The choice of method, means, techniques and equipment rests with the Contractor. The Contractor shall select the method and equipment for trench excavation and backfill depending upon the type of material to be excavated and backfilled, the depth of excavation, the amount of space available for operation of equipment, storage of excavated material, proximity of man-made improvements to be protected, available easement or right-of-way and prevailing practice in the area.

### 1.02 Quality Assurance

A. Density: All references to "maximum dry density" shall mean the maximum dry density defined by the "Maximum Density-Optimum Moisture Test", ASTM D 698, except that for non-cohesive materials "maximum dry density" shall mean the maximum index density as determined by the "Maximum Index Density of Soils Using a Vibratory Table", ASTM D 4253. Determination of the density of foundation, bedding, haunching, or backfill materials in place shall meet with the requirements of ASTM D 1556, "Density of Soil In Place by the Sand Cone Method", ASTM D 2937, "Density of Soil In Place by the Drive-Cylinder Method" or ASTM D 2922, "Density of Soil and Soil-Aggregate In Place by Nuclear Methods (Shallow Depth)".

B. Sources and Evaluation Testing: Testing of materials to certify conformance with the Specifications shall be performed by an independent testing laboratory in accordance with Section 01410 of these Specifications. All imported fill materials shall meet the requirements of on-site fill materials.

### **1.03 Safety**

Perform all trench excavation and backfilling activities in accordance with the Occupational Safety and Health Act of 1970 (PL 91-596), as amended. The Contractor shall pay particular attention to the Safety and Health Regulations Part 1926, Subpart P "Excavation, Trenching & Shoring" as described in OSHA publication 2226.

## **Part 2 Products**

### **2.01 Trench Foundation Materials**

A. Crushed stone shall be utilized for trench foundation (trench stabilization) and shall meet the requirements of the Georgia Department of Transportation Specification 800.2.01, Group I (limestone, marble or dolomite) or Group II (quartzite, granite or gneiss). Stone size shall be between No. 57 and No. 4, inclusive.

### **2.02 Bedding and Haunching Materials**

A. Unless specified otherwise, bedding and haunching materials shall be crushed stone as specified below.

B. Crushed stone utilized for bedding and haunching shall meet the requirements of the Georgia Department of Transportation Specification 800.01, Group I (limestone, marble or dolomite) or Group II (quartzite, granite or gneiss). Stone size shall be between No. 57 and No. 4, inclusive.

C. Earth materials utilized for bedding and haunching shall be suitable materials selected from materials excavated from the trench. Suitable materials shall be clean and free of rock larger than 2-inches at its largest dimension, organics, cinders, stumps, limbs, frozen earth or mud, man-made wastes and other unsuitable materials. Should the material excavated from the trench be saturated, the saturated material may be used as earth material, provided it is allowed to dry properly and it is capable of meeting the specified compaction requirements. When necessary, earth bedding and haunching materials shall be moistened to facilitate compaction by tamping. If materials excavated from the trench are not suitable for use as bedding or haunching material, provide select material conforming to the requirements of this Section at no additional cost to the Owner.

D. Filter Fabric Woven Type

1. Filter fabric associated with bedding shall be a polypropylene woven fabric. The fabric shall be a high modulus type with good separation capabilities. The fabric shall be inert to biological degradation and naturally occurring chemicals, alkalies and acids.

2. The fabric shall have an equivalent opening size EOS of 20 to 45. The fabric shall also conform to the minimum property values listed in the following table:

Fabric Property	Unit	Test Method	Minimum Value
Grab Tensile Strength	lbs.	ASTM D 4632	200
Grab Tensile Elongation	%	ASTM D 4632	30 (max.)
Mullen Burst Strength	psi	ASTM D 3786	400
Trapezoid Tear Strength	lbs.	ASTM D 4533	75
Puncture Strength	lbs.	ASTM D 3787	75

3. If ordered by the Engineer, the filter fabric manufacturer shall furnish the services of a competent factory representative to supervise and/or inspect the installation of pipe. This service will be furnished for a minimum of 10 days during initial pipe installation.
4. Filter fabric shall be Mirafi 500X, Amoco 2002 or Exxon GTF-200.

### **2.03 Initial Backfill**

A. Initial backfill material shall be crushed stone or earth materials as specified for bedding and haunching materials.

B. When necessary, initial backfill materials shall be moistened to facilitate compaction by tamping. If materials excavated from the trench are not suitable for use as initial backfill material, provide select material conforming to the requirements of this Section at no additional cost to the owner.

### **2.04 Final Backfill**

A. Final backfill material shall be general excavated earth materials, shall not contain rock larger than 2-inches at its greatest diameter, cinders, stumps, limbs, man-made wastes and other unsuitable materials. If materials excavated from the trench are not suitable for use as final backfill material, provide select material conforming to the requirements of this Section.

### **2.05 Select Backfill**

Select backfill shall be materials which meet the requirements as specified for bedding, haunching or initial backfill materials, including compaction requirements.

### **2.06 Concrete**

A. Concrete for bedding, haunching, initial backfill or encasement shall have a compressive strength of not less than 3,000 psi, with not less than 5.5 bags of cement per cubic yard and a

slump between 3 and 5-inches. Ready-mixed concrete shall be mixed and transported in accordance with ASTM C 94. Reinforcing steel shall conform to the requirements of ASTM A 615, Grade 60.

### **Part 3 Execution**

#### **3.01 Trench Excavation**

A. Topsoil and grass shall be stripped a minimum of 6-inches over the trench excavation site and stockpiled separately for replacement over the finished grading areas.

B. Trenches shall be excavated to the lines and grades shown on the Drawings with the centerlines of the trenches on the centerlines of the pipes and to the dimensions which provide the proper support and protection of the pipe and other structures and accessories.

#### **C. Trench Width for Pipelines**

1. The sides of all trenches shall be vertical to a minimum of one foot above the top of the pipe. Unless otherwise indicated on the Drawings, the maximum trench width shall be equal to the sum of the outside diameter of the pipe plus two feet. The minimum trench width shall be that which allows the proper consolidation of the haunching and initial backfill material.
2. Excavate the top portion of the trench to any width within the construction easement or right-of-way which will not cause unnecessary damage to adjoining structures, roadways, pavement, utilities, trees or private property. Where necessary to accomplish this, provide sheeting and shoring.
3. Where rock is encountered in trenches, excavate to remove boulders and stones to provide a minimum of 9-inches clearance between the rock and any part of the pipe barrel or manhole.
4. Wherever the prescribed maximum trench width is exceeded, the Contractor shall use the next higher Class or Type of bedding and haunching as shown on the Drawings for the full trench width as actually cut. The excessive trench width may be due to unstable trench walls, inadequate or improperly placed bracing and sheeting which caused sloughing, accidental over-excavation, intentional over-excavation necessitated by the size of the Contractor's tamping and compaction equipment, intentional over-excavation due to the size of the Contractor's excavation equipment, or other reasons beyond the control of the Engineer or Owner.

#### **D. Depth**

1. The trenches shall be excavated to the required depth or elevation which allow for the placement of the pipe and bedding to the dimensions shown on the Drawings.
2. Where rock is encountered in trenches for pipelines, excavate to the minimum depth which will provide clearance below the pipe barrel of 8-inches for pipe

21-inches in diameter and smaller and 12-inches for larger pipe, valves and manholes.

#### E. Excavated Materials

1. Excavated materials shall be placed adjacent to the work to be used for backfilling as required. Top soil shall be carefully separated and lastly placed in its original location.
2. Excavated material shall be placed sufficiently back from the edge of the excavation to prevent caving of the trench wall, to permit safe access along the trench and not cause any drainage problems. Excavated material shall be placed so as not to damage existing landscape features or man-made improvements.

### **3.02 Sheeting, Bracing and Shoring**

#### A. Sheeting, bracing and shoring shall be installed in the following instances:

1. Where sloping of the trench walls does not adequately protect persons within the trench from slides or cave-ins.
2. In caving ground.
3. In wet, saturated, flowing or otherwise unstable materials.
4. Where necessary to prevent damage to adjoining buildings, structures, roadways, pavement, utilities, trees or private properties which are required to remain.
5. Where necessary to maintain the top of the trench within the available construction easement or right-of-way.

B. In all cases, excavation protection shall strictly conform to the requirements of the Occupational Safety and Health Act of 1970, as amended.

C. Timber: Timber for shoring, sheeting, or bracing shall be sound and free of large or loose knots and in good, serviceable condition. Size and spacing shall be in accordance with OSHA regulations.

D. Steel Sheeting and Sheet Piling: Steel sheet piling shall be the continuous interlock type. The weight, depth and section modulus of the sheet piling shall be sufficient to restrain the loads of earth pressure and surcharge from existing foundations and live loads. Procedure for installation and bracing shall be so scheduled and coordinated with the removal of the earth that the ground under existing structures shall be protected against lateral movement at all times. The Contractor shall provide closure and sealing between sheet piling and existing facilities.

E. Trench Shield: A trench shield or box may be used to support the trench walls. The use of a trench shield does not necessarily preclude the additional use of bracing and sheeting. When trench shields are used, care must be taken to avoid disturbing the alignment and grade of the pipe or disrupting the haunching of the pipe as the shield is moved. When the bottom of the

trench shield extends below the top of the pipe, the trench shield will be raised in 6-inch increments with specified backfilling occurring simultaneously. At no time shall the trench shield be "dragged" with the bottom of the shield extending below the top of the pipe or utility.

F. Remove bracing and sheeting in units when backfill reaches the point necessary to protect the pipe and adjacent property. Leave sheeting in place when in the opinion of the Engineer it cannot be safely removed or is within three feet of an existing structure, utility, or pipeline. Cut off any sheeting left in place at least two feet below the surface.

G. Sheet piling within three feet of an existing structure or pipeline shall remain in place, unless otherwise directed by the Engineer.

### **3.03 Rock Excavation**

A. Definition of Rock: Any material which cannot be excavated with conventional excavating equipment, and is removed by drilling and blasting, and occupies an original volume of at least one-half cubic yard.

B. Blasting: Provide licensed, experienced workmen to perform blasting. Conduct blasting operations in accordance with all existing ordinances and regulations. Protect all buildings and structures from the effects of the blast. Repair any resulting damage. If the Contractor repeatedly uses excessive blasting charges or blasts in an unsafe or improper manner, the Engineer may direct the Contractor to employ an independent blasting consultant to supervise the preparation for each blast and approve the quantity of each charge.

C. Removal of Rock: Dispose of rock off site that is surplus or not suitable for use as rip rap or backfill.

D. The Contractor shall notify the Engineer prior to any blasting. Additionally, the Contractor shall notify the Engineer and local fire department before any charge is set.

E. Following review by the Engineer regarding the proximity of permanent buildings and structures to the blasting site, the Engineer may direct the Contractor to employ an independent, qualified specialty sub-contractor, approved by the Engineer, to monitor the blasting by use of seismograph, identify the areas where light charges must be used, conduct pre-blast and post-blast inspections of structures, including photographs or videos, and maintain a detailed written log.

### **3.04 Dewatering Excavations**

A. Dewater excavation continuously to maintain a water level two feet below the bottom of the trench.

B. Control drainage in the vicinity of excavation so the ground surface is properly pitched to prevent water running into the excavation.

C. There shall be sufficient pumping equipment, in good working order, available at all times, to remove any water that accumulates in excavations. Where the utility crosses natural drainage channels, the work shall be conducted in such a manner that unnecessary damage or delays in the prosecution of the work will be prevented. Provision shall be made for the satisfactory disposal of surface water to prevent damage to public or private property.

D. In all cases, accumulated water in the trench shall be removed before placing bedding or haunching, laying pipe, placing concrete or backfilling.

E. Where dewatering is performed by pumping the water from a sump, crushed stone shall be used as the medium for conducting the water to the sump. Sump depth shall be at least two feet below the bottom of the trench. Pumping equipment shall be of sufficient quantity and/or capacity to maintain the water level in the sump two feet below the bottom of the trench. Pumps shall be a type such that intermittent flows can be discharged. A standby pump shall be required in the event the operating pump or pumps clog or otherwise stop operation.

F. Dewater by use of a well point system when pumping from sumps does not lower the water level two feet below the trench bottom. Where soil conditions dictate, the Contractor shall construct well points cased in sand wicks. The casing, 6 to 10-inches in diameter, shall be jetted into the ground, followed by the installation of the well point, filling casing with sand and withdrawing the casing.

### **3.05 Trench Foundation and Stabilization**

A. The bottom of the trench shall provide a foundation to support the pipe and its specified bedding. The trench bottom shall be graded to support the pipe and bedding uniformly throughout its length and width.

B. If, after dewatering as specified above, the trench bottom is spongy, or if the trench bottom does not provide firm, stable footing and the material at the bottom of the trench will still not adequately support the pipe, the trench will be determined to be unsuitable and the Engineer shall then authorize payment for trench stabilization.

C. Should the undisturbed material encountered at the trench bottom constitute, in the opinion of the Engineer, an unstable foundation for the pipe, the Contractor shall be required to remove such unstable material and fill the trench to the proper subgrade with crushed stone as directed by the Engineer.

D. Where the replacement of unsuitable material with crushed stone does not provide an adequate trench foundation, the trench bottom shall be excavated to a depth of at least two feet below the specified trench bottom. Place filter fabric in the bottom of the trench and support the fabric along the trench walls until the trench stabilization, bedding, haunching and pipe have been placed at the proper grade. The ends of the filter fabric shall be overlapped by one foot above the pipe.

E. Where trench stabilization is provided, the trench stabilization material shall be compacted to at least 90 percent of the maximum dry density, unless shown or specified otherwise.

### **3.06 Bedding and Haunching**

A. Prior to placement of bedding material, the trench bottom shall be free of any water, loose rocks, boulders or large dirt clods.

B. Bedding material shall be placed to provide uniform support along the bottom of the pipe and to place and maintain the pipe at the proper elevation. The initial layer of bedding placed to receive the pipe shall be brought to the grade and dimensions indicated on the Drawings. All

bedding shall extend the full width of the trench bottom. The pipe shall be placed and brought to grade by tamping the bedding material or by removal of the excess amount of the bedding material under the pipe. Adjustment to grade line shall be made by scraping away or filling with bedding material. Wedging or blocking up of pipe shall not be permitted. Applying pressure to the top of the pipe, such as with a backhoe bucket, to lower the pipe to the proper elevation or grade shall not be permitted. Each pipe section shall have a uniform bearing on the bedding for the length of the pipe, except immediately at the joint.

C. At each joint, excavate bell holes of ample depth and width to permit the joint to be assembled properly and to relieve the pipe bell of any load.

D. After the pipe section is properly placed, add the haunching material to the specified depth. The haunching material shall be shovel sliced, tamped, vigorously chinked or otherwise consolidated to provide uniform support for the pipe barrel and to fill completely the voids under the pipe, including the bell hole. Prior to placement of the haunching material, the bedding shall be clean and free of any water, loose rocks, boulders or dirt clods.

#### E. Water Mains

##### 1. Ductile Iron Pipe

- a. Unless otherwise shown on the Drawings or specified, utilize earth materials for bedding and haunching. Type 2, 3, 4 and 5 bedding shall be as detailed on the Drawings.
- b. Unless specified or shown otherwise, bedding shall meet the requirements for Type 2 Pipe Bedding. Unless specified or shown otherwise for restrained joint pipe and fittings, bedding shall meet the requirements for Type 4 Pipe Bedding.
- c. Where the depth of cover over the piping exceeds 9 feet, the pipe bedding shall meet the requirements of Type 4 Pipe Bedding. Where the depth of cover over the piping exceeds 14 feet, the pipe bedding shall meet the requirements of Type 5 Pipe Bedding.
- d. Type 4 or Type 5 Pipe Bedding called for on the Drawings, specified or ordered by the Engineer, shall meet requirements for Type 4 or Type 5 Pipe Bedding, utilizing crushed stone bedding and haunching material.

F. Manholes: Excavate to a minimum of 12-inches below the planned elevation of the base of the manhole. Place and compact crushed stone bedding material to the required grade before installing the manhole.

#### G. Excessive Width and Depth

1. Water Mains: If the trench is excavated to excess width, provide the next higher type or class of pipe bedding, but a minimum of Type 4, as detailed on the Drawings.

2. If the trench is excavated to excessive depth, provide crushed stone to place the bedding at the proper elevation or grade.

H. Compaction: Bedding and haunching materials under pipe, manholes and accessories shall be compacted to a minimum of 90 percent of the maximum dry density, unless shown or specified otherwise.

### **3.07 Initial Backfill**

A. Initial backfill shall be placed to anchor the pipe, protect the pipe from damage by subsequent backfill and ensure the uniform distribution of the loads over the top of the pipe.

B. Place initial backfill material carefully around the pipe in uniform layers to a depth of at least 18-inches above the pipe barrel or duct bank. Layer depths shall be a maximum of 6-inches for pipe 18-inches in diameter and smaller and a maximum of 12-inches for pipe larger than 18-inches in diameter.

C. Backfill on both sides of the pipe simultaneously to prevent side pressures.

D. Compact each layer thoroughly with suitable hand tools or tamping equipment.

E. Initial backfill shall be compacted to a minimum 90 percent of the maximum dry density, unless shown or specified otherwise.

F. If materials excavated from the trench are not suitable for use as backfill materials, provide select backfill material conforming to the requirements of this Section.

### **3.08 Concrete Encasement for Pipelines**

Where concrete encasement is shown on the Drawings for pipelines, excavate the trench to provide a minimum of 6-inches clearance from the bell of the pipe. Lay the pipe to line and grade on concrete blocks. In lieu of bedding, haunching and initial backfill, place concrete to the full width of the trench and to a height of not less than 12-inches above the pipe bell. Do not backfill the trench for a period of at least 24 hours after concrete is placed.

### **3.09 Final Backfill**

A. Backfill carefully to restore the ground surface to its original condition.

B. The top 6-inches shall be topsoil obtained as specified in "Trench Excavation" of this Section.

C. Excavated material which is unsuitable for backfilling, and excess material, shall be disposed of, at no additional cost to the Owner, in a manner approved by the Engineer. Surplus soil may be neatly distributed and spread over the site, if approved by the Engineer. If such spreading is allowed, the site shall be left in a clean and sightly condition and shall not affect pre-construction drainage patterns. Surplus rock from the trenching operations shall be removed from the site.

D. If materials excavated from the trench are not suitable for use as backfill materials, provide select backfill material conforming to the requirements of this Section.

E. After initial backfill material has been placed and compacted, backfill with final backfill material. Place backfill material in uniform layers, compacting each layer thoroughly as follows:

1. In 6-inch layers, if using light power tamping equipment, such as a "jumping jack".
2. In 12-inch layers, if using heavy tamping equipment, such as hammer with tamping feet.
3. In 24-inch layers, if using a hydra-hammer.

F. Settlement: If trench settles, re-fill and grade the surface to conform to the adjacent surfaces.

G. Final backfill shall be compacted to a minimum 90 percent of the maximum dry density, unless specified otherwise.

### **3.10 Additional Material**

Where final grades above the pre-construction grades are required to maintain minimum cover, additional fill material will be as shown on the Drawings. Utilize excess material excavated from the trench, if the material is suitable. If excess excavated materials are not suitable, or if the quantity available is not sufficient, provide additional suitable fill material at no cost to the owner.

### **3.11 Backfill Under Roads**

Compact backfill underlying pavement and sidewalks, and backfill under dirt and gravel roads to a minimum 95 percent of the maximum dry density. The top 12-inches shall be compacted to a minimum of 98 percent of the maximum dry density.

### **3.12 Backfill Within Georgia DOT Right-of-Way**

Backfill within the Georgia DOT right-of-way shall meet the requirements stipulated in the "Utility Accommodation Policy and Standards", published by the Georgia Department of Transportation.

### **3.13 Backfill Along Restrained Joint Pipe**

Backfill along restrained joint pipe shall be compacted to a minimum 90 percent of the maximum dry density.

### **3.14 Testing and Inspection**

A. The soils testing laboratory is responsible for the following:

1. Compaction tests in accordance with Article 1.02 of this Section.

2. Field density tests for each two feet of lift, one test for each 500 feet of pipe installed or more frequently if ordered by the Engineer.
3. Inspecting and testing stripped site, subgrades and proposed fill materials.

B. The Contractor's duties relative to testing include:

1. Notifying laboratory of conditions requiring testing.
2. Coordinating with laboratory for field testing.
3. Paying costs for additional testing performed beyond the scope of that required and for re-testing where initial tests reveal non-conformance with specified requirements.
4. Providing excavation as necessary for laboratory personnel to conduct tests.

C. Inspection

1. Earthwork operations, acceptability of excavated materials for bedding or backfill, and placing and compaction of bedding and backfill is subject to inspection by the Engineer.

D. Comply with applicable codes, ordinances, rules, regulations and laws of local, municipal, state or federal authorities having jurisdiction.

END OF SECTION

## **Part 1 General**

### **1.01 Scope**

A. The work covered by this Section includes furnishing all labor, materials and equipment required to bore and jack casings and to properly complete pipeline construction as described herein and/or shown on the Drawings.

B. Supply all materials and perform all work in accordance with applicable American Society for Testing and Materials (ASTM), American Water Works Association (AWWA), American National Standards Institute (ANSI) or other recognized standards. Latest revisions of all standards are applicable. If requested by the Engineer, submit evidence that manufacturer has consistently produced products of satisfactory quality and performance over a period of at least two years.

### **1.02 Submittals**

A. Submit shop drawings, product data and experience in accordance with the requirements of Section 01340 of these Specifications.

B. Material Submittals: The Contractor shall provide shop drawings and other pertinent specifications and product data as follows:

1. Shop drawings for casing pipe showing sizes and connection details.
2. Design mixes for concrete and grout.

C. Experience Submittals

1. Boring and jacking casings is deemed to be specialty contractor work. If the Contractor elects to perform the work, the Contractor shall provide evidence as required by the General Conditions. A minimum of five continuous years of experience in steel casing construction is required of the casing installer. Evidence of this experience must be provided with the shop drawings for review by the Engineer.

### **1.03 Storage and Protection**

All materials shall be stored and protected in accordance with the manufacturer's recommendations and as approved by the Engineer.

## **Part 2 Products**

### **2.01 Materials and Construction**

A. Casing

1. The casing shall be new and unused pipe. The casing shall be made from steel plate having minimum yield strength of 35,000 psi. The steel plate shall also meet the chemical requirements of one of the following: ASTM A36; ASTM A139, Grade B, C, D or E; ASTM A53, Type S or Type E, Grade A or B.

2. The thicknesses of casing shown in paragraph B. below are minimum thicknesses. Actual thicknesses shall be determined by the casing installer, based on an evaluation of the required forces to be exerted on the casing when jacking. Any buckling of the casing due to jacking forces shall be repaired at no additional cost to the Owner.

3. The diameters of casing shown in paragraph B. below and shown on the Drawings are the minimum required. Larger casings, with the Engineer's approval, may be provided at no additional cost to the Owner, for whatever reasons the Contractor may decide, whether casing size availability, line and grade tolerances, soil conditions, etc.

#### B. Casing Sizes

UNDER HIGHWAYS/ROADWAYS		
Pipe Diameter, inches	Casing Diameter, inches	Wall Thickness, inches
12	18	0.350
42	60	0.500
54	72	0.531

C. Carrier Pipe: Carrier pipes shall meet requirements as specified in Section 02665 of these Specifications. All water pipe shall be ductile iron pipe.

D. Surface Settlement Markers: Surface settlement markers within pavement areas shall be P.K. nails. Surface settlement markers within non-paved areas shall be wooden hubs.

#### E. Grout and Cover Materials

1. Soil backfill for trench approaches and pits to finish grade shall be type as specified in Section 02225.
2. Fill and seal group at pipe ends using one of the following methods:
  - a. Brick and mortar with type I or Type II cement conforming to ASTM C150, clean fresh water, sand conforming to ASTM C404, size No. 1. Grout shall have a minimum compressive strength of 1,000 psi, attained within 24 hours.
  - b. End seals constructed of 1/8" thick neoprene rubber with 1/2" thick T304 stainless steel bandings and 100% non-

magnetic worm gear mechanisms. Casing end seals shall be Advance Products & Systems, Inc. Model AW.

3. Cement grout mix shall be one part Portland cement, and 6 parts mortar sand mixed with fresh, clean water to consistency applicable grouting.
  - a. Mortar sand shall meet the requirements of ASTM C404, size no. 1.
  - b. Portland cement shall meet the requirements of ASTM C1560, Type I or II.

F. Casing spacers: Casing spacers shall be a two-piece shell fabricated from T-304 stainless steel of a minimum 14 gauge thickness. Each shell section shall be lined with a 0.090-inch thick, ribbed PVC extrusion with a retaining section overlapping the edges of the shell. Bearing surfaces (runners) shall be attached to support sections at positions to properly support the carrier pipe with the casing. The runners shall be mechanically bolted to the riser. Risers shall be made of T-304 stainless steel of a maximum 10 gauge. All risers shall be welded to the shell. Casing spacers shall be manufactured by Cascade Waterworks Manufacturing Company.

## **2.02 Equipment**

- A. A cutting head shall be attached to a continuous auger mounted inside the casing pipe.
- B. The steering head shall be controlled manually from the bore pit. The grade indicator shall consist of a water level attached to the casing which would indicate the elevation of the front end of the casing or some other means for grade indication approved by the Engineer.

## **Part 3 Execution**

### **3.01 General**

- A. Interpretation of soil investigation reports and data, investigating the site and determination of the site soil conditions prior to bidding is the sole responsibility of the Contractor. Any subsurface investigation by the Bidder or Contractor must be approved by the appropriate authority having jurisdiction over the site. Rock and/or water, if encountered, shall not entitle the Contractor to additional compensation.
- B. Casing construction shall be performed so as not to interfere with, interrupt or endanger roadway surface and activity thereon, and minimize subsidence of the surface, structures, and utilities above and in the vicinity of the casing. Support the ground continuously in a manner that will prevent loss of ground and keep the perimeters and face of the casing, passages and shafts stable. The Contractor shall be responsible for all settlement resulting from casing operations and shall repair and restore damaged property to its original or better condition at no cost to the Owner.
- C. The Contractor shall locate, identify, and protect utilities indicated to remain from damage. Utility companies shall be notified to locate existing utilities.

D. Plant life, lawns, and other features remaining as portion of final landscaping shall be protected during the execution of work.

E. The Contractor shall protect bench marks, survey control points, existing structures, fences, sidewalks, paving, and curbs from excavating equipment and vehicular traffic.

F. The Contractor shall notify the Engineer in the event of utility conflicts and when minimum separation from existing utilities is not possible.

G. Face Protection: The face of the excavation shall be protected from the collapse of the soil into the casing.

H. Casing Design: Design of the bore pit and required bearing to resist jacking forces is the responsibility of the Contractor. The excavation method selected shall be compatible with expected ground conditions. The lengths of the casing shown on the Drawings are the minimum lengths required. The length of the casing may be extended for the convenience of the Contractor, at no additional cost to the Owner. Due to restrictive right-of-way and construction easements, boring and jacking casing lengths less than the nominal 20 foot length may be necessary.

#### I. Roadway Crossings

1. The Contractor shall be held responsible and accountable for the coordinating and scheduling of all construction work within the roadway right-of-way.

2. Work along or across the roadway department rights-of-way shall be subject to inspection by GDOT, Fulton County and/or the City of Alpharetta.

3. All installations shall be performed to leave free flows in drainage ditches, pipes, culverts or other surface drainage facilities of the roadway, street or its connections.

4. No excavated material or equipment shall be placed on the pavement or shoulders of the roadway without the express approval of the Engineer and the City of Alpharetta roadway department.

5. In no instance will the Contractor be permitted to leave equipment (trucks, backhoes, etc.) on the pavement or shoulder overnight. Construction materials to be installed, which are placed on the right-of-way in advance of construction, shall be placed in such a manner as not to interfere with the safe operation of the roadway.

6. The Contractor shall be responsible for providing the Owner sufficient information to obtain a blasting permit in a timely manner.

### **3.02 Groundwater Control**

A. The Contractor shall control the groundwater throughout the construction of the casing.

B. Methods of dewatering shall be at the option and responsibility of the Contractor. Maintain close observation to detect settlement or displacement of surface facilities due to dewatering. Should settlement or displacement be detected, notify the Engineer immediately and take such action as necessary to maintain safe conditions and prevent damage.

C. When water is encountered, provide and maintain a dewatering system of sufficient capacity to remove water on a 24 hour basis keeping excavations free of water until the backfill operation is in progress. Dewatering shall be performed in such a manner that removal of soil particles is held to a minimum. Dewater into a sediment trap and comply with requirements specified in Section 02125 of these Specifications.

### **3.03 Safety**

A. Provide all necessary bracing, bulkheads and shields to ensure complete safety to all traffic, persons and property at all times during the work. Perform the work in such a manner as to not permanently damage the roadbed or interfere with normal traffic over it.

B. Observe all applicable requirements of the regulations of the authorities having jurisdiction over this site. Conduct the operations in such a manner that all work will be performed below the level of the roadbed.

C. Perform all activities in accordance with the Occupational Safety and Health Act of 1970 (PL-596), as amended, applicable regulations of the Federal Government, OSHA 29CFR 1926 and applicable criteria of ANSI A10.16-81, "Safety Requirements for Construction of Tunnel Shafts and Caissons".

### **3.04 Surface Settlement Monitoring**

A. Provide surface settlement markers, placed as specified and as directed by the Engineer. The Contractor shall place settlement markers outside of pavement area, along the centerline of the casing at 10 foot intervals and offset 10 feet each way from the centerline. Markers shall also be placed at each shoulder of the roadway, at each edge of pavement, at the centerline of the pavement and at 10 and 25 feet in each direction from the centerline of the casing. Tie settlement markers to bench marks and indices sufficiently removed as not to be affected by the casing operations.

B. Make observations of surface settlement markers, placed as required herein, at regular time intervals acceptable to the Engineer. In the event settlement or heave on any marker exceeds 1-inch, the Contractor shall immediately cease work and using a method approved by the Engineer and the authority having jurisdiction over the project site, take immediate action to restore surface elevations to that existing prior to start of casing operations.

C. Take readings and permanently record surface elevations prior to start of dewatering operations and/or shaft excavation. The following schedule shall be used for obtaining and recording elevation readings: all settlement markers, once a week; all settlement markers within 50 feet of the casing heading, at the beginning of each day; more frequently at the Engineer's direction if settlement is identified. Make all elevation measurements to the nearest 0.01 foot.

D. The Contractor shall cooperate fully with jurisdictional personnel. Any settlement shall be corrected by, and at the expense of, the Contractor.

E. Promptly report any settlement and horizontal movement immediately to the Engineer and take immediate remedial action.

### **3.05 Boring and Jacking**

#### **A. Shaft**

1. Conduct boring and jacking operations from a shaft excavated at one end of the section to be bored. Where conditions and accessibility are suitable, place the shaft on the downstream end of the bore.

2. The shaft shall be rectangular and excavated to a width and length required for ample working space. If necessary, sheet and shore shaft properly on all sides. Shaft sheeting shall be timber or steel piling of ample strength to safely withstand all structural loadings of whatever nature due to site and soil conditions. Keep preparations dry during all operations. Perform pumping operations as necessary.

3. The bottom of the shaft shall be firm and unyielding to form an adequate foundation upon which to work. In the event the shaft bottom is not stable, excavate to such additional depth as required and place a gravel sub-base or a concrete sub-base if directed by the Engineer due to soil conditions.

#### **B. Jacking Rails and Frame**

1. Set jacking rails to proper line and grade within the shaft. Secure rails in place to prevent settlement or movement during operations. The jacking rails shall cradle and hold the casing pipe on true line and grade during the progress of installing the casing.

2. Place backing between the heels of jacking rails and the rear of the shaft. The backing shall be adequate to withstand all jacking forces and loads.

3. The jacking frame shall be of adequate design for the magnitude of the job. Apply thrust to the end of the pipe in such a manner to impart a uniformly balanced load to the pipe barrel without damaging the joint ends of the pipe.

C. Boring and jacking of casing pipes shall be accomplished by the dry auger boring method without jetting, sluicing or wetboring.

D. Auger the hole and jack the casing through the soil simultaneously.

E. Bored installations shall have a bored-hole diameter essentially the same as the outside diameter of the casing pipe to be installed.

F. Execute boring ahead of the casing pipe with extreme care, commensurate with the rate of casing pipe penetration. Boring may proceed slightly in advance of the penetrating pipe and shall be made in such a manner to prevent any voids in the earth around the outside perimeter

of the pipe. Make all investigations and determine if the soil conditions are such as to require the use of a shield.

G. As the casing is installed, check the horizontal and vertical alignment frequently. Make corrections prior to continuing operation. For casing pipe installations over 100 feet in length, the auger shall be removed and the alignment and grade checked at minimum intervals of 60 feet.

H. Any casing pipe damaged in jacking operations shall be repaired, if approved by the Engineer, or removed and replaced at Contractor's own expense.

I. Lengths of casing pipe, as long as practical, shall be used except as restricted otherwise. Joints between casing pipe sections shall be butt joints with complete joint penetration, single groove welds, for the entire joint circumference, in accordance with AWS recommended procedures. Prior to welding the joints, the Contractor shall ensure that both ends of the casing sections being welded are square.

J. The Contractor shall prepare a contingency plan which will allow the use of a casing lubricant, such as bentonite, in the event excessive frictional forces jeopardize the successful completion of the casing installation.

K. Once the jacking procedure has begun, it should be continued without stopping until completed, subject to weather and conditions beyond the control of the Contractor.

L. Care shall be taken to ensure that casing pipe installed by boring and jacking method will be at the proper alignment and grade.

M. The Contractor shall maintain and operate pumps and other necessary drainage system equipment to keep work dewatered at all times.

N. Adequate sheeting, shoring and bracing for embankments, operating pits and other appurtenances shall be placed and maintained to ensure that work proceeds safely and expeditiously. Upon completion of the required work, the sheeting, shoring and bracing shall be left in place, cut off or removed, as designated by the Engineer.

O. Trench excavation, all classes and type of excavation, the removal of rock, muck, debris, the excavation of all working pits and backfill requirements of Section 02225 are included under this Section.

P. All surplus material shall be removed from the right-of-way and the excavation finished flush with the surrounding ground.

Q. Grout backfill shall be used for unused holes or abandoned pipes.

### **3.06 Free Boring**

A. Where the Drawings or Specifications indicate a pipeline or service connection is to be installed by boring without casing or where ordered by the Engineer, the Contractor shall install the pipe by the free bore method. The allowed free bore method will be dry auger boring, without jetting, sluicing, or wet boring.

- B. The diameter of the free bore shall not exceed the pipe bell outside diameter or the pipe barrel outside diameter plus 1-inch, whichever is greater.
- C. The Contractor shall be responsible for any settlement of the surface (roadway, driveway, or otherwise) caused by the free bore construction activities.
- D. Where the Drawings or Specifications indicate a free bore or where ordered to use the free bore method to install a segment of pipe, the Contractor may elect to install the pipe by the conventional bore and jack casing method instead.
- E. If the Contractor elects to free bore, and an acceptable installation does not result for any reason, the Contractor shall install a casing pipe by the bore and jack method at no additional cost to the Owner.
- F. The Contractor may elect to free bore other portions of the project in lieu of open cut installation. However, no additional payment for free bore will be made if the Contractor exercises this option.

### **3.07 Rock Excavation**

- A. In the event that rock is encountered during the installation of the casing pipe which, in the opinion of the Engineer, cannot be removed through the casing, the Engineer may authorize the Contractor to complete the crossing by a method established in a change order.
- B. At the Contractor's option, the Contractor may continue to install the casing and remove the rock through the casing at no additional cost to the Owner.

### **3.08 Installation of Carrier Pipe**

- A. After the casing pipe has been installed, the alignment and elevations shall be verified and submitted to the Engineer for approval, prior to the installation of the carrier pipe.
- B. The carrier pipe shall be installed centered within the casing pipe, and shall be supported by casing spacers, centered on 10-foot intervals and as shown on the Drawings.
- C. The Contractor shall exercise care to prevent damage to pipe joints when carrier pipe is placed in casing.
- D. Support the pipeline within casing so no external loads are transmitted to carrier pipe. Attach supports to barrel of carrier pipe; do not rest carrier pipe on bells. A minimum clearance of 1-inch shall be maintained between the pipe bell and casing pipe.
- E. The ends of the casing shall be sealed by either grouting or installing casing end seals.

### **3.09 Sheeting Removal**

Remove sheeting used for shoring from the shaft and off the job site. The removal of sheeting, shoring and bracing shall be done in such a manner as not to endanger or damage either new or existing structures, private or public properties and also to avoid cave-ins or sliding in the banks.

END OF SECTION

**Part 1 General****1.01 Scope**

A. The work to be performed under this Section shall consist of removing and replacing existing pavement, sidewalks and curbs in paved areas where necessary for construction of water lines and all other water appurtenances and structures.

**1.02 Submittals**

A. Certificates: Provide certificates stating that materials supplied comply with Specifications. Certificates shall be signed by the asphalt producer and the Contractor.

**1.03 Conditions**

A. Weather Limitations

1. Apply bituminous prime and tack coats only when the ambient temperature has been at least 55 degrees F for 12 hours immediately prior to application.
2. Do not conduct paving operations when surface is wet or contains excess of moisture which would prevent uniform distribution and required penetration.
3. Construct asphaltic courses only when atmospheric temperature in the shade is above 40 degrees F, when the underlying base is dry and when weather is not rainy.
4. Place base course when air temperature is above 35 degrees F and rising.

B. Grade Control: Establish and maintain the required lines and grades for each course during construction operations.

**Part 2 Products****2.01 Materials and Construction**

A. Graded Aggregate Base Course: Graded aggregate base course shall be of uniform quality throughout and shall meet the requirements of Section 815.01 of the Georgia Department of Transportation Standard Specifications.

B. Black Base: Black base course shall be of uniform quality throughout and shall conform to the requirements of Section 828 of the Georgia Department of Transportation Standard Specifications.

C. Binder Course: The binder course of all paved roadways shall conform to the requirements of Section 400, Type "B" of the Georgia Department of Transportation Standard Specifications.

D. Surface Course: The surface course for all pavement, including prime or tack coat when required by the Engineer, shall conform to the requirements of Section 400, Type "E" of the Georgia Department of Transportation Standard Specifications.

E. Concrete: Provide concrete and reinforcing for concrete pavement or base courses in accordance with the requirements of the Georgia Department of Transportation Standard Specifications, Section 430. Concrete shall be of the strength classifications shown on the Drawings.

F. Special Surfaces: Where driveways or roadways are disturbed or damaged which are constructed of specialty type surfaces, e.g., brick or stone, these driveways and roadways shall be restored utilizing similar, if not original, materials. Where the nature of these surfaces dictate, a specialty contractor shall be used to restore the surfaces to their previous or better condition. Special surfaces shall be removed and replaced to the limits to which they were disturbed.

## **2.02 Types of Pavements**

A. General: All existing pavement removed, destroyed or damaged by construction shall be replaced with the same type and thickness of pavement as that existing prior to construction, unless otherwise directed by the Engineer. Materials, equipment and construction methods used for paving work shall conform to the Georgia Department of Transportation specifications applicable to the particular type required for replacement, repair or new pavements.

B. Aggregate Base: Aggregate base shall be constructed in accordance with the requirements of Section 310 of the Georgia Department of Transportation Standard Specifications. The maximum thickness to be laid in a single course shall be 6-inches compacted. If the design thickness of the base is more than 6-inches, it shall be constructed in two or more courses of approximate equal thickness. After the material placed has been shaped to line, grade and cross-section, it shall be rolled until the course has been uniformly compacted to at least 100 percent of the maximum dry density when Group 2 aggregate is used, or to at least 98 percent of maximum dry density when Group 1 aggregate is used.

C. Concrete Pavement: Concrete pavement or base courses shall be replaced with concrete. The surface finish of the replaced concrete pavement shall conform to that of the existing pavement. The surface of the replaced concrete base course shall be left rough. The slab depth shall be equivalent to the existing concrete pavement or base course, but in no case less than 6-inches thick. Transverse and longitudinal joints removed from concrete pavement shall be replaced at the same locations and to the same types and dimensions as those removed. Concrete pavements or concrete base courses shall be reinforced.

D. Asphaltic Concrete Base, Binder and Surface Course: Asphaltic concrete base, binder and surface course construction shall conform to Georgia Department of Transportation Standard Specifications, Section 400. The pavement mixture shall not be spread until the designated surface has been previously cleaned and prepared, is intact, firm, properly cured, dry and the tack coat has been applied. Apply and compact the base in maximum layer thickness by asphalt spreader equipment of design and operation approved by the Engineer. After compaction, the black base shall be smooth and true to established profiles and sections. Apply and compact binder and the surface course in a manner approved by the Engineer. Immediately correct any high, low or defective areas by cutting out the course, replacing with

fresh hot mix, and immediately compacting to conform and thoroughly bond to the surrounding area.

E. Surface Treatment Pavement: Bituminous penetration surface treatment pavement shall be replaced with a minimum thickness of 1-inch conforming to Section 424, Georgia Department of Transportation Standard Specifications.

F. Gravel Surfaces: Existing gravel road, drive and parking area replacement shall meet the requirements of graded aggregate base course. This surfacing may be authorized by the Engineer as a temporary surface for paved streets until replacement of hard surfaced pavement is authorized.

G. Temporary Measures: During the time period between pavement removal and complete replacement of permanent pavement, maintain highways, streets and roadways by the use of steel running plates anchored to prevent movement. The backfill above the pipe shall be compacted, as specified in Section 02225 of these Specifications, up to the existing pavement surface to provide support for the steel running plates. All pavement shall be replaced within seven calendar days of its removal.

### **Part 3            Execution**

#### **3.01            Locations for Pavement Replacement**

Pavement shall be removed and replaced with similar type and thickness as the original pavement, for the entire length of pipe laying and up to required trench width as per details shown on drawings.

#### **3.02            Removing Pavement**

A. General: Remove existing pavement as necessary for installing the pipe line and appurtenances.

B. Marking: Before removing any pavement, mark the pavement neatly paralleling pipe lines and existing street lines. Space the marks the width of the trench.

C. Breaking: Break asphalt pavement along the marks using pavement shearing equipment, jack hammers or other suitable tools. Break concrete pavement along the marks by scoring with a rotary saw and breaking below the score by the use of jack hammers or other suitable tools.

D. Machine Pulling: Do not pull pavement with machines until the pavement is completely broken and separated from pavement to remain.

E. Damage to Adjacent Pavement: Do not disturb or damage the adjacent pavement. If the adjacent pavement is disturbed or damaged, remove and replace the damaged pavement.

F. Sidewalk: Remove and replace any sidewalks disturbed by construction for their full width and to the nearest undisturbed joint.

G. Curbs: Tunnel under or remove and replace any curb disturbed by construction to the nearest undisturbed joint.

### 3.03 Replacing Pavement

A. Preparation of Subgrade: Upon completion of backfilling and compaction of the backfill, arrange to have the compaction tested by an independent testing laboratory approved by the Engineer. After compaction testing has been satisfactorily completed, replace all pavements, sidewalks and curbs removed.

1. The existing street pavement or surface shall be removed along the lines of the work for the allowable width specified for the trench or structure. After the installation of the water works facilities and after the backfill has been compacted suitably, the additional width of pavement to be removed, as shown on the Drawings, shall be done immediately prior to replacing the pavement.
2. Trench backfill shall be compacted for the full depth of the trench as specified in Section 02225 of these Specifications.
3. Temporary trench backfill along streets and driveways shall include 6-inches of crushed stone or cherty clay as a temporary surfacing of the trenches. This temporary surface shall be maintained carefully at grade and dust-free by the Contractor until the backfill of the trench has thoroughly compacted in the opinion of the Engineer and permission is granted to replace the street pavement.
4. When temporary crushed stone or chert surface is considered by the Engineer to be sufficient surface for gravel pavement, the surface shall be graded smooth and to an elevation that will make the final permanent surfacing level with the adjacent surfacing that was undisturbed.

#### B. Pavement Replacement

1. Prior to replacing pavement, make a final cut in concrete pavement 12-inches back from the edge of the damaged pavement with a concrete saw. Remove asphalt pavement 12-inches back from the edge of the damaged pavement using pavement shearing equipment, jack hammers or other suitable tools.
2. Replace all street and roadway pavement as shown on the Drawings. Replace driveways, sidewalks and curbs with the same material, to nearest existing undisturbed construction joint and to the same dimensions as those existing.
3. If the temporary crushed stone or chert surface is to be replaced, the top 6-inches shall be removed and the crushed stone surfacing for unpaved streets or the base for the bituminous surface shall be placed.
4. Following this preparation, the chert or crushed stone base shall be primed with a suitable bituminous material and surfaced with the proper type of bituminous surface treatment.

5. Where the paved surface is to be replaced with asphaltic concrete pavement, concrete pavement or with a concrete base and a surface course, the temporary chert or crushed stone surface and any necessary backfill material, additional existing paving and new excavation shall be removed to the depth and width shown on the Drawings. All edges of the existing pavement shall be cut to a straight, vertical edge. Care shall be used to get a smooth joint between the old and new pavement and to produce an even surface on the completed street. Concrete base slabs and crushed stone bases, if required, shall be placed and allowed to cure for three days before bituminous concrete surface courses are applied. Expansion joints, where applicable, shall be replaced in a manner equal to the original joint.
6. Where driveways or roadways, constructed of specialty type surfaces, e.g., brick or stone are disturbed or damaged, these driveways and roadways shall be restored utilizing similar materials. Where the nature of these surfaces dictate, a specialty contractor shall be used to restore the surfaces to their previous or better condition. Special surfaces shall be removed and replaced to the limits to which they were disturbed.

C. Pavement Resurfacing: Certain areas to be resurfaced are specified or noted on the Drawings. After all pipe line installations are complete and existing pavement has been removed and the trench route has been repaired, mill entire area to be resurfaced 1-1/2 inches, then apply tack coat and 1-1/2 inches of Type E surface course as specified. Where pavement to be resurfaced has been damaged with potholes, the Contractor shall remove all existing loose pavement material and fill the hole with black base, as specified, to the level of the existing pavement.

D. Pavement Striping: Pavement striping removed or paved over shall be replaced with the same type, dimension and material as original unless directed otherwise by the Engineer.

### **3.04 Sidewalk and Curb Replacement**

#### **A. Construction**

1. All concrete sidewalks and curbs shall be replaced with concrete.
2. Prefomed joints shall be 1/2-inch thick, conforming to the latest edition of AASHTO M59 for sidewalks and AASHTO M 123 for curbs.
3. Forms for sidewalks shall be of wood or metal, shall be straight and free from warp, and shall be of sufficient strength, when in place, to hold the concrete true to line and grade without springing or distorting.
4. Forms for curbs shall be metal and of an approved section. They shall be straight and free from distortions, showing no vertical variation greater than 1/8-inch in 10 feet and no lateral variation greater than 1/4-inch in 10 feet from the true plain surface on the vertical face of the form. Forms shall be of the full depth of the structure and constructed such to permit the inside forms to be securely fastened to the outside forms.

5. Wood forms may be used on sharp turns and for special sections, as approved by the Engineer. Where wooden forms are used, they shall be free from warp and shall be the nominal depth of the structure.
6. All mortar and dirt shall be removed from forms and all forms shall be thoroughly oiled or wetted before any concrete is deposited.

B. When a section is removed, the existing sidewalk or curb shall be cut to a neat line, perpendicular to both the centerline and the surface of the concrete slab. Existing concrete shall be cut along the nearest existing construction joints; if such joints do not exist, the cut shall be made at minimum distances shown on the Drawings.

C. Existing concrete sidewalks and curbs that have been cut and removed for construction purposes shall be replaced with the same width and surface as the portion removed. Sidewalks shall have a minimum uniform thickness of 4-inches. The new work shall be neatly jointed to the existing concrete so that the surface of the new work shall form an even, unbroken plane with the existing surfaces.

D. The subgrade shall be formed by excavating to a depth equal to the thickness of the concrete, plus 2-inches. Subgrade shall be of such width as to permit the proper installation and bracing of the forms. Subgrades shall be compacted by hand tamping or rolling. Soft, yielding or unstable material shall be removed and backfilled with satisfactory material. Place 2-inches of porous crushed stone under all sidewalks and curbs and compacted thoroughly, then finish to a smooth, unyielding surface at proper line, grade and cross section.

E. Joint for Curbs

1. Joints shall be constructed as indicated on the Drawings and as specified. Construct joints true to line with their faces perpendicular to the surface of the structure and within  $\frac{1}{4}$ -inch of their designated position.
2. Thoroughly spade and compact the concrete at the faces of all joints filling all voids.
3. Install expansion joint materials at the point of curve at all street returns. Install expansion joint material behind the curb at abutment to sidewalks and adjacent structures.
4. Place contraction joints every 10 feet along the length of the curbs and gutters. Form contraction joints using steel templates or division plates which conform to the cross section of the structure. Leave the templates in place until the concrete has set sufficiently to hold its shape, but remove them while the forms are still in place. Contraction joint templates or plates shall not extend below the top of the steel reinforcement or they shall be notched to permit the reinforcement to be continuous through the joint. Contraction joints shall be a minimum of 1-1/2-inches deep.

F. Expansion joints shall be required to replace any removed expansion joints or in new construction wherever shown on the Drawings. Expansion joints shall be true and even, shall present a satisfactory appearance, and shall extend to within  $\frac{1}{2}$ -inch of the top of finished concrete surface.

### G. Finishing

1. Strike off the surface with a template and finish the surface with a wood float using heavy pressure, after which, contraction joints shall be made and the surface finished with a wood float or steel trowel.
2. Finish the face of the curbs at the top and bottom with an approved finishing tool of the radius indicated on the Drawings.
3. Finish edges with an approved finishing tool having a ¼-inch radius.
4. Provide a final broom finish by lightly combing with a stiff broom after troweling is complete.
5. The finished surface shall not vary more than 1/8-inch in 10 feet from the established grade.

### H. Driveway and Sidewalk Ramp Openings

1. Provide driveway openings of the widths and at the locations indicated on the Drawings and as directed by the Engineer.
2. Provide sidewalk ramp openings as indicated on the Drawings, in conformance with the applicable regulations and as directed by the Engineer.

I. Concrete shall be suitably protected from freezing and excessive heat. It shall be kept covered with burlap or other suitable material and kept wet until cured. Provide necessary barricades to protect the work. All damage caused by people, vehicles, animals, rain, the Contractor's operations and the like shall be repaired by the Contractor, at no additional expense to the Owner.

## **3.05 Maintenance**

The Contractor shall maintain the surfaces of roadways built and pavements replaced until the acceptance of the Project. Maintenance shall include replacement, scraping, reshaping, wetting and rerolling as necessary to prevent raveling of the road material, the preservation of reasonably smooth surfaces and the repair of damaged or unsatisfactory surfaces, to the satisfaction of the Engineer. Maintenance shall include sprinkling as may be necessary to abate dust from the gravel surfaces.

## **3.06 Supervision and Approval**

A. Pavement restoration shall meet the requirements of the regulatory agency responsible for the pavement. Obtain agency approval of pavement restorations before requesting final payment.

B. Obtain the Engineer's approval of restoration of pavement, such as private roads and drives, that are not the responsibility of a regulatory agency.

C. Complete pavement restoration as soon as possible after backfilling.

D. Failure of Pavement: Should any pavement restoration or repairs fail or settle during the life of the Contract, including the bonded period, promptly restore or repair defects.

### **3.07 Cleaning**

The Contractor shall remove all surplus excavation materials and debris from the street surfaces and rights-of-way and shall restore street, roadway or sidewalk surfacing to its original condition.

END OF SECTION

## **Part 1 General**

### **1.01 Scope**

A. This Section describes products to be incorporated into the water mains and requirements for the installation and use of these items. Furnish all products and perform all labor necessary to fulfill the requirements of these Specifications.

B. Supply all products and perform all work in accordance with applicable American Society for Testing and Material (ASTM), American Water Works Association (AWWA), American National Standards Institute (ANSI), or other recognized standards. Latest revisions of all standards are applicable.

### **1.02 Qualifications**

If requested by the Engineer, submit evidence that manufacturers have consistently produced products of satisfactory quality and performance for a period of at least two years.

### **1.03 Submittals**

A. Complete shop drawings, product data and engineering data for all products shall be submitted to the Engineer in accordance with the requirements of Section 01340 of these Specifications.

B. Traffic Control Plan shall be submitted at least 14 days prior to beginning any on-site work.

### **1.04 Transportation and Handling**

A. Unloading: Furnish equipment and facilities for unloading, handling, distributing and storing pipe, fittings, valves and accessories. Make equipment available at all times for use in unloading. Do not drop or dump materials. Any materials dropped or dumped will be subject to rejection without additional justification. Pipe handled on skids shall not be rolled or skidded against the pipe on the ground.

B. Handling: Handle pipe, fittings, valves and accessories carefully to prevent shock or damage. Handle pipe by rolling on skids, forklift, or front end loader. Do not use material damaged in handling. Slings, hooks or pipe tongs shall be padded and used in such a manner as to prevent damage to the exterior coatings or internal lining of the pipe.

### **1.05 Storage and Protection**

A. Store all pipe which cannot be distributed along the route. Make arrangements for the use of suitable storage areas.

B. Stored materials shall be kept safe from damage. The interior of all pipe, fittings and other appurtenances shall be kept free from dirt or foreign matter at all times. Valves and hydrants shall be drained and stored in a manner that will protect them from damage by freezing.

C. Pipe shall not be stacked higher than the limits recommended by the manufacturer. The bottom tier shall be kept off the ground on timbers, rails or concrete. Pipe in tiers shall be alternated: bell, plain end; bell, plain end. At least two rows of timbers shall be placed between

tiers and chocks, affixed to each other in order to prevent movement. The timbers shall be large enough to prevent contact between the pipe in adjacent tiers.

D. Stored mechanical and push-on joint gaskets shall be placed in a cool location out of direct sunlight. Gaskets shall not come in contact with petroleum products. Gaskets shall be used on a first-in, first-out basis.

E. Mechanical-joint bolts shall be handled and stored in such a manner that will ensure proper use with respect to types and sizes.

## **1.06 Quality Assurance**

The manufacturer shall provide written certification to the Engineer that all products furnished comply with all applicable requirements of these Specifications.

## **Part 2 Products**

### **2.01 Piping Materials and Accessories**

- A. All water pipe shall be ductile iron pipe.
- B. Ductile Iron Pipe (DIP) and Appurtenances

Use ductile iron pipe that meets the requirements of ANSI/AWWA C151/A21.50 for the class and joint specified. Unless otherwise specified, ductile iron pipe shall be Pressure Class 250 and have nominal laying length of 20 feet.

#### **1. Fittings**

Use fittings that meet the requirements of ANSI/AWWA A21.10 or A21.53, a minimum rated working pressure of 250 psi and joint specified. Ends shall be flanged, restrained mechanical joint for pipes and fittings less than 24-inch diameter or restrained push-on to suit the conditions specified. Fittings shall be manufactured in the U.S. Fittings for pipe larger than 24-inches shall have restrained joints as specified below.

#### **2. Rubber Gasket Joints**

Use standard styrene butadiene rubber (SBR) gasket joints that meet the requirements of ANSI/AWWA A21.11 for push on mechanical joints.

#### **3. Unrestrained Joints**

Unrestrained joints, where specified, shall be the rubber ring compression, push-on type joint suitable for buried service. Unrestrained joints shall be the Fastite Joint as manufactured by U.S. Pipe, or equal. This joint is not permitted on fittings or specials, unless otherwise specified. Unless otherwise specified, joints shall have an allowable deflections up to one-half the manufacturer's allowable deflection. Joint assembly and field cut joints shall be made in strict conformance with AWWA C600 and manufacturer's allowable deflection. Joint assembly

and field cut joints shall be made in strict conformance with AWWA C600 and manufacturer's recommendations.

Where specified, mechanical joints for above or below ground service shall meet the requirements of ANSI/AWWA A21.10/C110 and ANSI/AWWA A21.11/C111. Gaskets and bolts and nuts shall comply with paragraphs 02665-2.01 B2 and 8 respectively.

#### 4. Restrained Joints

Restrained joints shall be provided as shown on the Drawings and where required for thrust restrain. Unless otherwise specified, restrained joints shall be flanged for exposed service and restrained push-on for buried services.

Restrained push-on joints shall be the Flex-Ring (up to 36-inch) or Lok-Ring Joint (42-inch to 64-inch) as manufactured by American Cast iron Pipe Company, TR Flex Joint as manufactured by U.S. Pipe, or equal. Restrained joints shall be capable of being deflected after full assembly. Joint assembly shall be in strict conformance with AWWA C600 and manufacturer's recommendations. No field cuts of restrained pipe are permitted without prior approval of the Engineer.

#### 5. Flanges

Use flanges that meet the requirements of ANSI/AWWA A21.11.

Unless otherwise specified, flanges shall be ductile iron and shall be threaded-on flanges conforming to ANSI/AWWA A21.15/C115 or cast-on flanges conforming to ANSI/AWWA A21.10/C110. Flanges shall be adequate for 250 psi working pressure. Bolt circle and bolt holes shall match those of ANSI B15.1, Class 125 flanges and ANSI B16.5, Class 150 flanges. Where specified, flanges shall be threaded-on or cast-on flanges conforming to ANSI B16.1, Class 250.

Flange assembly bolts shall be ANSI B18.2.1 standard square or hexagon head bolts with ANSI B18.2.2 standard hexagon nuts. Threads shall be ANSI B1.1, standard coarse thread series; bolts shall be Class 2A, nuts shall be Class 2B. Bolt length shall conform to ANSI B16.5.

Unless otherwise specified, bolts shall be carbon steel machined bolts with hot pressed hexagon nuts. Where washers are required, they shall be of the same material as the associated bolts.

Gaskets for plain faced flanges shall be the full fact type. Thickness shall be 1/16-inch for pipe 10-inches and less in diameter and 1/8-inch for pipe 12-inches and larger in diameter. Unless otherwise specified, gaskets for raised face flanges shall match the raised face and shall be 1/16-inch thick for pipe 3-1/2-inches and less in diameter and 1/8-inch thick for pipe 4-inches and larger.

## 6. Mechanical Joint Fittings

Restraint devices for mechanical joint fittings shall be Megalug Series 1100 as manufactured by EBAA Iron, Inc., or equal.

Locked mechanical hydrant tees, bends and adapters are in acceptable substitute for anchoring fire hydrants and valves to the pipe main.

## 7. Ball and Socket Flexible Joint Pipe

Ball and socket flexible joint pipe shall be the boltless type and shall allow a maximum joint deflection of 15 degrees. Each joint shall be provided with a retainer lock to prevent rotation after assembly. Joints shall be the Flex-Lok Joint as manufactured by American Cast Iron Pipe Company, USflex as manufactured by U.S. Pipe, or equal.

## 8. Bolts and Nuts

a. Provide the necessary bolts for connections. All bolts and nuts shall be threaded in accordance with ANSI B1.1, Coarse Thread Series, Class 2A external and 2B internal fit. All bolts and nuts shall be made in the U.S.A.

b. Bolts and nuts for mechanical joints shall be Tee Head Bolts and nuts of high strength low-alloy steel in accordance with ASTM A 242 to the dimensions shown in AWWA C111/ANSI A21.11.

c. Bolts for exposed service shall be zinc plated, cold pressed, steel machine bolts conforming to ASTM A 307, Grade B. Nuts for exposed service shall be zinc plated, heavy hex conforming to ASTM A 563. Zinc plating shall conform to ASTM B 633, Type II.

## 9. Grooved End Couplings

Plain end ductile iron pipe may be joined with grooved end couplings and shoulder joints if they meet the requirements of AWWA C606.

Grooved end flexible-type couplings shall be Victaulic Style 77 or equal. Grooved end rigid-type couplings shall be Victaulic Style 07 or equal. Flexible-type couplings shall be used for all piping greater than 12 inches in diameter; for pipe 12 inches in diameter and less in rack-mounted tunnel piping applications; and for grooved joints adjacent to pump suction and discharge where grooved couplings are used for noise and vibration control. All other applications for piping 12 inches in diameter and less shall utilize rigid-type couplings. Grooved end flanged coupling adapters shall be either Victaulic Style 741 or equal. Snap-joint grooved end couplings shall be Victaulic Style 78 or equal. Cut grooves are not permitted on fabricated or lightwall pipe.

Unless otherwise specified, bolts and nuts shall comply with AWWA C606. Bolts for submerged service shall be Type 316 stainless steel in

conformance with ASTM F593, marking F593F. Nuts for submerged service shall be made of copper-silicon alloy bronze conforming to ASTM B98, alloy C65100, designation H04 or alloy C65500, designation H04. Bolts and nuts for buried service shall be made of noncorrosive high-strength, low-alloy steel having the characteristics specified in ANSI/AWWA C111/A21, regardless of any other protective coating. Where washers are required, they shall be of the same material as the associated bolts.

Gaskets shall be as specified in AWWA C 606.

#### 10. Pipe Coating

Unless otherwise specified, pipe and fittings shall be coated with asphaltic material as specified in AWWA C1512.

#### 11. Polyethylene Tube

Polyethylene encasement shall be used where specified. Installation of polyethylene shall be as specified in AWWA C105 and these specifications. Pipe, fittings, valves and couplings shall be wrapped. Fittings that require concrete backing shall be wrapped prior to placing the concrete.

The polyethylene tube seams and overlaps shall be wrapped and held in place by means of a 2 inch wide plastic backed adhesive tape. The tape shall be as recommended by the manufacturer of the pipe and polyethylene tubing. The tape shall be such that the adhesive shall bond securely to both metal surfaces and polyethylene film. Bedding and initial backfill for polyethylene wrapped pipe shall be a well-graded granular material which will not cut or damage the polyethylene tube during placement and backfilling. Sharp angular material over 0.5 inch shall not be used with polyethylene encasement.

#### 12. Pipe Lining

Unless otherwise specified, all interior surfaces of pipe and fittings shall be cement mortar lined in accordance with AWWA C104. Cement shall be ASTM C150, Type II or V, low alkali, containing less than 0.60 percent alkalies.

#### 13. Welded-On Outlets

Welded-on outlets shall be provided where specified. All welded-on outlets shall be rated for a working pressure of 250 psi and shall have a minimum safety factor of 2.0. Welded-on outlets may be provided as a radial (tee) outlet, a tangential outlet, or a lateral outlet. Parent pipe and branch pipe shall meet hydrostatic test requirements in accordance with AWWA C151, section 51-9, prior to fabrication.

All joints on welded-on branch outlets shall be provided in accordance with the latest revision of ANSI/AWWA C111/A21.11 and/or ANSI/AWWA C115/A21.15, as applicable. All outlets shall be fabricated from centrifugally cast ductile iron pipe designed in accordance with ANSI/AWWA C150/A21.50 and manufactured in accordance with ANSI/AWWA C151/A21.51.

All welds must be produced using 55% nickel iron welding rod or wire. Carbon steel electrodes will not be acceptable. Both branch and parent outlet pipe shall be class 53. After fabrication each outlet pipe shall be air tested to 15 psi to insure weld integrity. A soap and water solution shall be applied during the testing procedure to inspect the weld for leakage. Any welds that show air seepage shall be re-fabricated and retested. Welded-on bosses will not be permitted. All welded-on outlets shall be done at manufacturer's plant.

The type of pipe end for the branch outlet shall be as specified or indicated on the drawings. The maximum size and laying length of the welded-on branch outlet shall be recommended by the pipe manufacturer and acceptable to the Engineer for the field conditions and connecting pipe or valve. Pipe embedment material and trench backfill shall be placed and compacted under and around each side of the outlet to hold the pipe in proper position and alignment during subsequent pipe jointing, embedment, and backfilling operations.

14. Thrust collars shall be welded-on ductile iron body type designed to withstand thrust due to 250 psi internal pressure on a dead end.

15. Acceptance will be on the basis of the Engineer's inspection and the manufacturer's written certification that the pipe was manufactured and tested in accordance with the applicable standards.

## **2.02 Valves**

### **A. Gate Valves (GV)**

1. 4-Inches and larger in Diameter: Gate valves shall be resilient wedge type conforming to the requirements of AWWA C509 or AWWA C515 rated for 250 psi working pressure.

a. Valves shall be provided with two O-ring stem seals with one O-ring located above and one O-ring below the stem collar. The area between the O-rings shall be filled with lubricant to provide lubrication to the thrust collar bearing surfaces each time the valve is operated. At least one anti-friction washer shall be utilized to further minimize operating torque. All seals between valve parts, such as body and bonnet, bonnet and bonnet cover, shall be flat gaskets or O-rings.

b. The valve gate shall be made of cast or ductile iron having a vulcanized, synthetic rubber coating, or a seat ring attached to the

disc with retaining screws. Sliding of the rubber on the seating surfaces to compress the rubber will not be allowed. The design shall be such that compression-set of the rubber shall not affect the ability of the valve to seal when pressure is applied to either side of the gate. The sealing mechanism shall provide zero leakage at the water working pressure when installed with the line flow in either direction.

c. All internal ferrous surfaces shall be coated with epoxy to a minimum thickness of 4 mils. The epoxy shall be non-toxic, impart no taste to the water and shall conform to AWWA C550.

d. Gate valves shall have a 2-inch square operating nut.

e. Valve ends shall be mechanical joint except where shown otherwise.

f. Manually operated valves shall be non-rising stem type having O-ring seals.

g. Gate valves larger than 4-inches shall be manufactured by American Flow Control, Mueller or M & H Valve.

#### B. Butterfly Valves

1. Butterfly valves shall be as manufactured by the Henry Pratt Company, or equal.

2. Butterfly valves shall be constructed of the following materials unless otherwise specified:

Component	Material
Shaft	Stainless steel, ASTM A276, Type 304
Disc	ASTM A48, Class 40, or ASTM A126, Class B
Seat mating surface	Stainless steel, ASTM A276, Type 304, mounted in body or on disc edge
Seat surface sealing	EPDM or Buna N
Body	Cast iron, ASTM A126, Class B

3. Valves shall be the stub or through shaft design. Wafer type valves are not acceptable for buried service. Unless otherwise specified, valve flange drilling shall be per ANSI B16.1, Class 125. The stem to disc connection shall be made with pins of the same material as the stainless steel shaft.

4. Valves shall be designed in accordance with AWWA C504 Class 250. Shafts shall be turned, ground and polished. Shaft dimensions and operator torque shall be chosen for the pressure class as specified in AWWA C504. When carbon steel shafts and stainless steel journals are used, static seals shall be provided to isolate the interior of the disc and the shaft from the process fluid.
5. Valves shall have seats that are vulcanized, bonded, mechanically secured, or clamped to the body or disc. For valves, size 30 through 72 inches, valve seats shall be field adjustable and field replaceable. Discs for valves shall be of the flow-through Type with a 360-degree seating design.
6. Manual operators shall be of the traveling nut type with totally enclosed gearing between the valve and the operating wrench nut, meeting all torque and other requirements of Section 3.8.5 of AWWA C504. Operators shall be equipped with adjustable mechanical stop-limiting devices to prevent overtravel of the disc in the open and closed positions and shall be self-locking and designed to hold the valve in any intermediate position between full open and full closed. Valve operator components shall withstand an input torque of 300 ft-lbs at the extreme operator positions without damage.
7. Operator for buried service shall include an AWWA operating nut and shall be gasketed and grease packed for submerged operation at water pressures to 10 psig. Operators for exposed service shall include a handwheel and be gasketed for weatherproof service.
8. Affidavits of compliance with AWWA C504 shall be provided in accordance with Section 01340.
9. Hydrostatic and leakage tests shall be conducted in strict accordance with AWWA C 504, Section 5, except that leakage test will be performed after the operator has been mounted on the valve.
10. All surfaces of the valve shall be clean, dry and free from grease before painting. The interior and exterior valve surfaces except for disc, seating and finished portions shall receive two coats of asphalt varnish in accordance with Federal Specification TT-V-51C.

### **2.03 Fire Hydrants (FH)**

A. All fire hydrants shall conform to the requirements of AWWA C502 for 150 psi working pressure. Hydrants shall be the compression type, closing with line pressure. The valve opening shall not be less than 5-1/4-inches.

- B. In the event of a traffic accident, the hydrant barrel shall break away from the standpipe at a point above grade and in a manner which will prevent damage to the barrel and stem, preclude opening of the valve, and permit rapid and inexpensive restoration without digging or cutting off the water.
- C. The means for attaching the barrel to the standpipe shall permit facing the hydrant a minimum of eight different directions.
- D. Hydrants shall be fully bronze mounted with all working parts of bronze. Valve seat ring shall be bronze and shall screw into a bronze retainer.
- E. All working parts, including the seat ring shall be removable through the top without disturbing the barrel of the hydrant.
- F. The operating nut shall match those on the existing hydrants. The operating threads shall be totally enclosed in an operating chamber, separated from the hydrant barrel by a rubber O-ring stem seal and lubricated by a grease or an oil reservoir.
- G. Hydrant shall be a non-freezing design and be provided with a simple, positive, and automatic drain which shall be fully closed whenever the main valve is opened.
- H. Hose and pumper connections shall be breech-locked, pinned, or threaded and pinned to seal them into the hydrant barrel. Each hydrant shall have two 2-1/2-inch hose connections and one 4-1/2-inch pumper connection, all with National Standard threads and each equipped with cap and non-kinking chain.
- I. Hydrants shall be furnished with a mechanical joint connection to the spigot of the 6-inch hydrant lead.
- J. Minimum depth of bury shall be 4.5 feet. Provide extension section where necessary for proper vertical installation and in accordance with manufacturer's recommendations.
- K. All outside surfaces of the barrel above grade shall be painted with enamel equal to Koppers Glamortex 501, silver in color.
- L. Hydrants shall be traffic model and shall be Mueller Super Centurion 250/HS.

#### **2.04 Valve Boxes (VB) and Extension Stems**

- A. All valves shall be equipped with valve boxes. The valve boxes shall be cast iron two-piece screw type with drop covers. Valve boxes shall have a 5.25-inch inside diameter. Valve box covers shall weigh a minimum of 14 pounds. The valve boxes shall be adjustable to 6-inches up or down from the nominal required cover over the pipe. Valve boxes shall be of sufficient length that bottom flange of the lower belled portion of the box is below the valve operating nut. Ductile or cast iron extensions shall be provided as necessary. Covers shall have "WATER VALVE" or "WATER" cast into them. Valve boxes shall be manufactured in the United States.
- B. All valves shall be furnished with stainless steel extension stems, as necessary, to bring the operating nut to within 24-inches of the top of the valve box. Connection to the valve shall be with a wrench nut coupling and a set screw to secure the coupling to the valve's operating nut.

The coupling and square wrench nut shall be welded to the extension stem. Extension stems shall be equal to Mueller A-26441 or M & H Valve Style 3801.

### **2.05 Valve Markers (VM)**

The Contractor shall provide a concrete valve marker as detailed on the Drawings for each valve installed.

### **2.06 Tapping Sleeves and Valves (TS&V)**

Tapping sleeves shall be cast or ductile iron of the split-sleeve, mechanical joint type. The Contractor shall be responsible for determining the outside diameter of the pipe to be connected to prior to ordering the sleeve. Valves shall be gate valves furnished in accordance with the specifications shown above, with flanged connection to the tapping sleeve and mechanical joint connection to the branch pipe. The tapping sleeve and valve shall be supplied by the valve manufacturer. Tapping sleeves shall be equal to American Flow Control, Mueller or M & H Valve.

### **2.07 Manholes, Catch Basins, and Precast Concrete Products**

A. Provide precast concrete products in accordance with the following:

#### **1. Precast Concrete Sections**

a. Precast concrete sections shall meet the requirements of ASTM C 478. The minimum compressive strength of the concrete in precast sections shall be 4,000 psi. The minimum wall thickness shall be one-twelfth of the inside diameter of the base, riser or the largest cone diameter.

b. Transition slabs which convert bases larger than four feet in diameter to four foot diameter risers shall be designed by the precast concrete manufacturer to carry the live and dead loads exerted on the slab.

c. Seal joints between precast sections by means of rubber O-ring gaskets or flexible butyl rubber sealant. Butyl rubber sealants shall meet the requirements of AASHTO M-198. Sealant shall be pre-formed type with a minimum nominal diameter of 1-inch.

d. Butyl rubber sealant shall be equal to Kent Seal No. 2 or Concrete Sealants CS 202.

2. Brick and Mortar: Brick shall be whole and hardburned, conforming to ASTM C 32, Grade MS. Mortar shall be made of one part Portland cement and two parts clean sharp sand. Cement shall be Type 1 and shall conform to ASTM C 150. Sand shall meet ASTM C 144.

3. Iron Castings

a. Cast iron manhole frames, covers and steps shall meet the requirements of ASTM A 48 for Class 30 gray iron and all applicable local standards. All castings shall be tough, close grained, smooth and free from blow holes, blisters, shrinkage, strains, cracks, cold shots and other imperfections. No casting will be accepted which weighs less than 95 percent of the design weight. Shop drawings must indicate the design weight and provide sufficient dimensions to permit checking. All castings shall be thoroughly cleaned in the shop and given two coats of approved bituminous paint before rusting begins.

b. Manhole frames and covers shall be equal to the following:

Type	Design Weight	Manufacturer's Reference	
Bolt Down	400#	Neenah A-1916- F1	Vulcan V- 2358

c. All frames and covers shall have machined horizontal bearing surfaces.

4. Plastic Steps: Manhole steps of polypropylene, molded around a steel rod, equal to products of M.A. Industries may be used.

5. Catch Basins

- a. Where shown on the Drawings or as required, existing catch basins shall be replaced with a like kind catch basin (inlet). All new and replaced catch basins shall be constructed of reinforced precast concrete, four foot (4') diameter or larger.
- b. All catch basins shall be designed and constructed in compliance with Georgia D.O.T. specifications and shall be Georgia DOT 1033D or 1034D standard and shall require a reinforced precast "round to square adapter for additional throat support.
- c. In certain cases where rolled or "Hollywood" curb is utilized, the County Engineer (or field Inspector) may require the use of 1033F or 1034F catch basins.
- d. Frames, covers and gratings shall be ductile iron designed for heavy-duty traffic services, ASTM A534, Grade 60-40-18, 24-inch clear inside diameter with lettering "Storm Sewer" cast into cover. For structures, more than 5 feet deep, provide steps at 12-inch intervals.

7. Concrete Pipe: When crossing existing sanitary or storm sewer, if it is necessary to remove and replace or replace damaged pipe, as a minimum, replace with reinforced concrete pipe (RCP) conforming to the latest requirements of ASTM C76. Pipe shall be of the class III and shall have circular reinforcement for circular pipe.

## **2.08 Retainer Glands**

A. Retainer glands for ductile iron pipe shall be Megalug Series 1100, as manufactured by EBAA Iron, or Uni-Flange Series 1400, as manufactured by Ford Meter Box Company.

B. Retainer glands shall be provided at all mechanical joints, including fittings, valves, hydrants and other locations as shown on the Drawings.

## **2.09 Hydrant Tees**

Hydrant tees shall be equal to ACIPCO A10180 or U.S. Pipe U-592.

## **2.10 Anchor Couplings**

Lengths and sizes shall be as shown on the Drawings. Anchor couplings shall be equal to ACIPCO A10895 or U.S. Pipe U-591.

## **2.11 Concrete**

Concrete shall have a compressive strength of not less than 3,000 psi, with not less than 5.5 bags of cement per cubic yard and a slump between 3 and 5-inches unless shown or specified otherwise. For job mixed concrete, submit the concrete mix design for approval by the Engineer. Ready-mixed concrete shall be mixed and transported in accordance with ASTM C 94. Reinforcing steel shall conform to the requirements of ASTM A 615, Grade 60.

## **2.12 Electronic Markers**

A. Electronic markers shall be buried with utilities to serve as a locating device. Electronic markers shall be the "Ball" type for a depth up to 4-feet and the "Full Range" type for depths greater than 4-feet. Each marker shall be color coded in accordance with APWA standards and produce an industry specific frequency. Each marker shall contain a passive antenna that requires no internal power source. Markers shall be of water resistant polyethylene shells and impervious to minerals, chemicals, and underground temperature extremes. Electronic markers shall be compatible with 3M Dynatel 1420 EMS-iD programmable Marker Locator. Contractor shall supply one Marker Locator for use during installation and shall turn over Locator to County upon project completion. Markers shall be equal to 3M EMS 1423 XR/iD for water service.

B. Have available at all times an electronic pipe locator and a magnetic locator, in good working order, to aid in locating existing pipe lines or other obstructions.

## **2.13 Air Release and Vacuum Valves**

- A. Refer to the Valve Schedule in the drawings for valve type, size and location along the project area.
- B. Air release valves (ARV) shall have a small venting orifice to vent the accumulation of air and other gases with the line or system under pressure. Size and capacity shall be as specified.
- C. Air and vacuum valves (AVV) shall have a large venting orifice to permit the release of air as the line is filling or relieve the vacuum as the line is draining or is under negative pressure. Size and capacity shall be as specified.
- D. Combination air valves (CAV) shall have operating features of both the air and vacuum valve and the air release valve. They include both single- and dual-body construction. Size and capacity shall be as specified.
- E. Air release and vacuum valves shall be manufactured in compliance with ANSI/AWWA C512 and shall be APCO as manufactured by Valve and Primer Corporation, Crispin as manufactured by Multiplex Manufacturing Company, or equal, modified to provide the specified features and to meet the specified operating conditions.
- F. Materials specified below are considered the minimum acceptable for the purposes of durability, strength, and resistance to erosion and corrosion. The Contractor may propose alternative materials for the purpose of providing greater strength or to meet required stress limitations. However, alternative materials must provide at least the same qualities as those specified for the purpose.

Component	Material
Body, cover	Cast iron, ASTM A126, Grade B
Float	Type 316 SS, ASTM A240
Seat	Buna-N or Type 316 SS
Trim	Type 316 SS, ASTM A240

- G. Air release valves shall be float operated, compound lever type, except air release valves less than 1-inch may be simple lever type.
- H. Air and vacuum valves shall be designed to protect the float from direct contact of the rushing air and water to prevent the float from closing prematurely in the valve. The seat shall be fastened into the valve cover, and shall be easily removed if necessary. The float shall be center or peripheral guided for positive shutoff into the seat.
- I. Combination air valves, unless otherwise specified, shall be single-body construction in sizes 1- through 6-inch and dual-body

construction in sizes 8-inch and larger. Single-body construction shall be designed to provide all functions within one housing. The body inlet shall be baffled to protect the float and the large and small orifices shall be designed so that during large orifice closure, the small air release orifice will open to allow small amounts of air to escape. Dual-body construction shall combine one air and vacuum valve and one air release valve with interconnecting piping and gate valve.

J. Valves shall be suitable for pressures up to 250 psi.

K. Air release and vacuum valves shall be installed in accordance with the manufacturer's recommendations. Unless otherwise specified, isolation valves shall be provided below each air valve.

All materials/products that contact potable water must be third party certified as meeting the specifications of ANSI/NSF Standard 61. The certifying party shall be accredited by the ANSI.

### **Part 3 Execution**

#### **3.01 Existing Utilities and Obstructions**

A. The Drawings indicate utilities or obstructions that are known to exist according to the best information available to the Owner. The Contractor shall call the Utilities Protection Center (UPC) (404-325-5000 or 1-800-282-7411) as required by Georgia law (Code Section 25-9-1 through 25-9-13) and all utilities, agencies or departments that own and/or operate utilities in the vicinity of the construction work site at least 72 hours (three business days) prior to construction to verify the location of the existing utilities.

B. Existing Utility Location: The following steps shall be exercised to avoid interruption of existing utility service.

1. Provide the required notice to the utility owners and allow them to locate their facilities according to Georgia law. Field utility locations are valid for only 10 days after original notice. The Contractor shall ensure, at the time of any excavation, that a valid utility location exists at the point of excavation.

2. Expose the facility, for a distance of at least 200 feet in advance of pipeline construction, to verify its true location and grade. Repair, or have repaired, any damage to utilities resulting from locating or exposing their true location.

3. Avoid utility damage and interruption by protection with means or methods recommended by the utility owner.

4. Maintain a log identifying when phone calls were made, who was called, area for which utility relocation was requested and work order number issued, if any. The Contractor shall provide the Engineer an updated copy of the log bi-weekly, or more frequently if required.

### C. Conflict with Existing Utilities

1. Horizontal Conflict: Horizontal conflict shall be defined as when the actual horizontal separation between a utility, main, or service and the proposed water main does not permit safe installation of the water main by the use of sheeting, shoring, tying-back, supporting, or temporarily suspending service of the parallel or crossing facility. The Contractor may change the proposed alignment of the water main to avoid horizontal conflicts if the new alignment remains within the available right-of-way or easement, complies with regulatory agency requirements and after a written request to and subsequent approval by the Engineer. Where such relocation of the water main is denied by the Engineer, the Contractor shall arrange to have the utility, main, or service relocated.

2. Vertical Conflict: Vertical conflict shall be defined as when the actual vertical separation between a utility, main, or service and the proposed water main does not permit the crossing without immediate or potential future damage to the utility, main, service, or the water main. The Contractor may change the proposed grade of the water main to avoid vertical conflicts if the changed grade maintains adequate cover and complies with regulatory agencies requirements after written request to and subsequent approval by the Engineer. Where such relocation of the water main is denied by the Engineer, the Contractor shall arrange to have the utility, main, or service relocated.

D. Electronic Locator: Have available at all times an electronic pipe locator and a magnetic locator, in good working order, to aid in locating existing pipe lines or other obstructions.

### E. Water and Sewer Separation

1. Water mains should maintain a minimum 10 foot edge-to-edge separation from sewer lines, whether gravity or pressure. If the main cannot be installed in the prescribed easement or right-of-way and provide the 10 foot separation, the separation may be reduced, provided the bottom of the water main is a minimum of 18-inches above the top of the sewer. Should neither of these two separation criteria be possible, the water main shall be installed below the sewer with a minimum vertical separation of 18-inches. Where water mains cross the sewer, or storm drain, the pipe joint adjacent to the pipe crossing the sewer, or storm drain, shall be cut to provide maximum separation of the pipe joints from the sewer, or storm drain.

2. The water main, when installed within 18-inches below the sewer, or storm drain, shall be encased in concrete with a minimum 6-inch concrete depth to the first joint in each direction.

3. No water main shall pass through, or come in contact with, any part of a sanitary sewer manhole.

### 3.02 Construction Along Highways, Streets and Roadways

A. Install pipe lines and appurtenances along highways, streets and roadways in accordance with the applicable regulations of, and permits issued by, the Georgia Department of Transportation, City of Alpharetta, and Fulton County, with reference to construction operations, safety, traffic control, road maintenance and repair.

B. The Contractor shall prepare a Traffic Control Plan and submit the plan to the Engineer at least 14 days prior to on-site work. The Traffic Control Plan shall include all anticipated lane closures, placement of traffic control devices, barricades, lights, flagmen etc. to clearly show how traffic flow and safety will be maintained throughout the project.

#### C. Traffic Control

1. The Contractor shall provide, erect and maintain all necessary barricades, suitable and sufficient lights and other traffic control devices; provide qualified flagmen where necessary to direct traffic; take all necessary precautions for the protection of the work and the safety of the public. Flagmen shall be certified by a Georgia DOT approved training program.

2. Construction traffic control devices and their installation shall be in accordance with the current Manual On Uniform Traffic Control Devices for Streets and Highways.

3. Placement and removal of construction traffic control devices shall be coordinated with the City of Alpharetta and Fulton County a minimum of 48 hours in advance of the activity.

4. Placement of construction traffic control devices shall be scheduled ahead of associated construction activities. Construction time in street right-of-way shall be conducted to minimize the length of time traffic is disrupted. Construction traffic control devices shall be removed immediately following their useful purpose. Traffic control devices used intermittently, such as "Flagmen Ahead", shall be removed and replaced when needed.

5. Existing traffic control devices within the construction work zone shall be protected from damage. Traffic control devices requiring temporary relocation shall be located as near as possible to their original vertical and horizontal locations. Original locations shall be measured from reference points and recorded in a log prior to relocation. Temporary locations shall provide the same visibility to affected traffic as the original location. Relocated traffic control devices shall be reinstalled in their original locations as soon as practical following construction.

6. Construction traffic control devices shall be maintained in good repair and shall be clean and visible to affected traffic for daytime and nighttime operation. Traffic control devices affected by the construction work zone shall be inspected daily.

7. Construction warning signs shall be black legend on an orange background. Regulatory signs shall be black legend on a white background. Construction sign panels shall meet the minimum reflective requirements of the Georgia Department of Transportation and Fulton County. Sign panels shall be of durable materials capable of maintaining their color, reflective character and legibility during the period of construction.

8. Channelization devices shall be positioned preceding an obstruction at a taper length as required by the current Manual On Uniform Traffic Control Devices for Streets and Highways, as appropriate for the speed limit at that location. Channelization devices shall be patrolled to insure that they are maintained in the proper position throughout their period of use.

#### D. Construction Operations

1. Perform all work along highways, streets and roadways to minimize interference with traffic.

2. Stripping: Where the pipe line is laid along road right-of-way, strip and stockpile all sod, topsoil and other material suitable for right-of-way restoration.

3. Trenching, Laying and Backfilling: Do not open the trench any further ahead of pipe laying operations than is necessary. Backfill and remove excess material immediately behind laying operations. Complete excavation and backfill for any portion of the trench in the same day.

4. Shaping: Reshape damaged slopes, side ditches, and ditch lines immediately after completing backfilling operations. Replace topsoil, sod and any other materials removed from shoulders.

E. Excavated Materials: Do not place excavated material along highways, streets and roadways in a manner which obstructs more than one lane of traffic, as approved by the Engineer and the City of Alpharetta. Sweep all scattered excavated material off of the pavement at the end of each day.

F. Drainage Structures: Keep all side ditches, culverts, cross drains, and other drainage structures clear of excavated material. Care shall be taken to provide positive drainage to avoid ponding or concentration of runoff.

G. Landscaping Features: Landscaping features shall include, but are not necessarily limited to: fences; property corners; cultivated trees and shrubbery; manmade improvements; subdivision and other signs within the right-of-way and easement. The Contractor shall take extreme care in moving landscape features and promptly re-establishing these features.

#### H. Maintaining Highways, Streets, Roadways and Driveways

1. Maintain streets, highways, roadways and driveways in suitable condition for movement of traffic until completion and final acceptance of the Work.
2. During the time period between pavement removal and completing permanent pavement replacement, maintain highways, streets and roadways by the use of steel running plates. Running plate edges shall have asphalt placed around their periphery to minimize vehicular impact. The backfill above the pipe shall be compacted as specified elsewhere up to the existing pavement surface to provide support for the steel running plates.
3. Furnish a road grader or front-end loader for maintaining highways, streets, and roadways. The grader or front-end loader shall be available at all times.
4. Immediately repair all driveways that are cut or damaged. Maintain them in a suitable condition for use until completion and final acceptance of the Work.

### **3.03 Pipe Distribution**

- A. Pipe shall be distributed and placed in such a manner that will not interfere with traffic.
- B. No pipe shall be strung further along the route than 500 feet beyond the area in which the Contractor is actually working without written permission from the Owner. The Owner reserves the right to reduce this distance to a maximum distance of 200 feet in residential and commercial areas based on the effects of the distribution to the adjacent property owners.
- C. No street or roadway may be closed for unloading of pipe without first obtaining permission from the proper authorities. The Contractor shall furnish and maintain proper warning signs and obstruction lights for the protection of traffic along highways, streets and roadways upon which pipe is distributed.
- D. No distributed pipe shall be placed inside drainage ditches or gutters.
- E. Distributed pipe shall be placed as far as possible from the roadway pavement, but no closer than five feet from the roadway pavement, as measured edge-to-edge.

### **3.04 Location and Grade**

- A. The Drawings show the alignment of the water main and the location of valves, hydrants and other appurtenances.
- B. Construction Staking
  1. The base lines for locating the principal components of the work adjacent to the work are shown on the Drawings. Base lines shall be defined as the line to which the location of the water main is referenced, i.e., edge of pavement, road centerline, property line, right-of-way or survey line. The Contractor shall be responsible for performing all survey

work required for constructing the water main, including the establishment of base lines and any detail surveys needed for construction. This work shall include the staking out of permanent and temporary easements to insure that the Contractor is not deviating from the designated easements.

2. The level of detail of survey required shall be that which the correct location of the water main can be established for construction and verified by the Engineer. Where the location of components of the water main, e.g. tunnels and fittings, are not dimensioned, the establishment on the location of these components shall be based upon scaling these locations from the Drawings with relation to readily identifiable land marks, e.g., survey reference points, power poles, manholes, etc.

### C. Reference Points

1. The Contractor shall take all precautions necessary, which includes, but is not necessarily limited to, installing reference points, in order to protect and preserve the centerline or baseline established by the Engineer.

2. Reference points shall be placed, at or no more than three feet, from the outside of the construction easement or right-of-way. The location of the reference points shall be recorded in a log with a copy provided to the Engineer for use, prior to verifying reference point locations. Distances between reference points and the pipeline centerlines shall be accurately measured to 0.01 foot.

3. The Contractor shall give the Engineer reasonable notice that reference points are set. The reference point locations must be verified by the Engineer prior to commencing clearing and grubbing operations.

D. After the Contractor locates and marks the water main centerline or baseline, the Contractor shall perform clearing and grubbing.

E. Construction shall begin at a connection location and proceed without interruption. Multiple construction sites shall not be permitted without written authorization from the Engineer for each site.

F. The Contractor shall be responsible for any damage done to reference points, base lines, center lines and temporary bench marks, and shall be responsible for the cost of re-establishment of reference points, base lines, center lines and temporary bench marks as a result of the operations.

G. Construction Verification Survey allowance: The Construction Verification Survey cash allowance is solely for the use of the Engineer for verification of the Contractor's reference points, centerlines and work performed. The presence of this cash allowance in no way relieves the Contractor of the responsibility of installing reference points, centerlines, temporary bench marks, providing as-built drawings, or verifying that the work has been performed accurately.

### 3.05 Laying and Jointing Pipe and Accessories

A. Lay all pipe and fittings to accurately conform to the lines and grades established by the Engineer.

B. Pipe Installation

1. Proper implements, tools and facilities shall be provided for the safe performance of the Work. All pipe, fittings, valves and hydrants shall be lowered carefully into the trench by means of slings, ropes or other suitable tools or equipment in such a manner as to prevent damage to water main materials and protective coatings and linings. Under no circumstances shall water main materials be dropped or dumped into the trench.

2. All pipe, fittings, valves, hydrants and other appurtenances shall be examined carefully for damage and other defects immediately before installation. Defective materials shall be marked and held for inspection by the Engineer, who may prescribe corrective repairs or reject the materials.

3. All lumps, blisters and excess coating shall be removed from the socket and plain ends of each pipe, and the outside of the plain end and the inside of the bell shall be wiped clean and dry and free from dirt, sand, grit or any foreign materials before the pipe is laid. No pipe containing dirt shall be laid.

4. Foreign material shall be prevented from entering the pipe while it is being placed in the trench. No debris, tools, clothing or other materials shall be placed in the pipe at any time.

5. As each length of pipe is placed in the trench, the joint shall be assembled and the pipe brought to correct line and grade. The pipe shall be secured in place with approved backfill material.

6. It is not mandatory to lay pipe with the bells facing the direction in which work is progressing.

7. Applying pressure to the top of the pipe, such as with a backhoe bucket, to lower the pipe to the proper elevation or grade, shall not be permitted.

C. Alignment and Gradient

1. Lay pipe straight in alignment and gradient or follow true curves as nearly as practicable. Do not deflect any joint more than 4-degrees or the maximum deflection recommended by the manufacturer, whichever is less.

2. Maintain a transit, level and accessories on the job to lay out angles and ensure that deflection allowances are not exceeded.

D. Expediting of Work: Excavate, lay the pipe, and backfill as closely together as possible. Do not leave unjointed pipe in the trench overnight. Backfill and compact the trench as soon as possible after laying and jointing is completed. Cover the exposed end of the installed pipe each day at the close of work and at all other times when work is not in progress. If necessary to backfill over the end of an uncompleted pipe or accessory, close the end with a suitable plug, either push-on, mechanical joint, restrained joint or as approved by the Engineer.

#### E. Joint Assembly

1. Push-on, mechanical, flange and restrained type joints shall be assembled in accordance with the manufacturer's recommendations.
2. The Contractor shall inspect each pipe joint within 1,000 feet on either side of main line valves to insure 100 percent seating of the pipe spigot, except as noted otherwise.
3. Each restrained joint shall be inspected by the Contractor to ensure that it has been "homed" 100 percent.

F. Cutting Pipe: Cut ductile iron pipe using an abrasive wheel saw. The Contractor shall cut the pipe and bevel the end, as necessary, to provide the correct length of pipe necessary for installing the fittings, valves, accessories and closure pieces in the correct location. Only push-on and mechanical joint pipes shall be cut.

#### G. Valve and Fitting Installation

1. Prior to installation, valves shall be inspected for direction of opening, number of turns to open, freedom of operation, tightness of pressure-containing bolting and test plugs, cleanliness of valve ports and especially seating surfaces, handling damage and cracks. Defective valves shall be corrected or held for inspection by the Engineer. Valves shall be closed before being installed.
2. Valves, fittings, plugs and caps shall be set and joined to the pipe in the manner specified in this Section for cleaning, laying and joining pipe, except that 12-inch and larger valves shall be provided with special support, such as treated timbers, crushed stone, concrete pads or a sufficiently tamped trench bottom so that the pipe will not be required to support the weight of the valve. Valves shall be installed in the closed position.
3. A valve box shall be provided on each underground valve. They shall be carefully set, centered exactly over the operating nut and truly plumbed. The valve box shall not transmit shock or stress to the valve. The bottom flange of the lower belled portion of the box shall be placed below the valve operating nut. This flange shall be set on brick, so arranged that the weight of the valve box and superimposed loads will bear on the base and not on the valve or pipe. Extension stems shall be installed where depth of bury places the operating nut in excess of 48-inches beneath finished grade so as to set the top of the operating nut

24-inches below finished grade. The valve box cover shall be flush with the surface of the finished area or such other level as directed by the Engineer.

4. In no case shall valves be used to bring misaligned pipe into alignment during installation. Pipe shall be supported in such a manner as to prevent stress on the valve.

5. A valve marker shall be provided for each underground valve. Unless otherwise detailed on the Drawings or directed by the Engineer, valve markers shall be installed 6-inches inside the right-of-way or easement.

6. If a valve is located in the street and there is a curb, then a "V" mark shall be saw cut in the curb, in line with the valve location.

#### H. Hydrant Installation

1. Prior to installation, inspect all hydrants for direction of opening, nozzle threading, operating nut and cap nut dimensions, tightness of pressure-containing bolting, cleanliness of inlet elbow, handling damage and cracks. Defective hydrants shall be corrected or held for inspection by the Engineer.

2. All hydrants shall stand plumb and shall have their nozzles parallel with or at right angles to the roadway, with pumper nozzle facing the roadway, except that hydrants having two-hose nozzles 90 degrees apart shall be set with each nozzle facing the roadway at an angle of 45 degrees.

3. Hydrants shall be set to the established grade, with the centerline of the lowest nozzle at least 12-inches above the ground or as directed by the Engineer.

4. Each hydrant shall be connected to the main with a 6-inch branch controlled by an independent 6-inch valve. When a hydrant is set in soil that is pervious, drainage shall be provided at the base of the hydrant by placing coarse gravel or crushed stone mixed with coarse sand from the bottom of the trench to at least 6-inches above the drain port opening in the hydrant to a distance of 12-inches around the elbow.

5. When a hydrant is set in clay or other impervious soil, a 7 cubic yard drainage pit shall be excavated below each hydrant and filled with coarse gravel or crushed stone mixed with coarse sand under and around the elbow of the hydrant and to a level of 6-inches above the drain port.

6. Hydrants shall be located as shown on the Drawings or as directed by the Engineer. As all of the hydrants are intended to fail at the ground-line joint upon vehicle impact, specific care must be taken to provide adequate soil resistance to avoid transmitting shock moment to the lower barrel and inlet connection. Pour a concrete collar approximately

6-inches thick to a diameter of 24-inches at or near the ground line around the hydrant barrel as shown on the Drawings.

I. Polyethylene Encasement: Installation shall be in accordance with AWWA C105 and the manufacturer's instructions. All ends shall be securely closed with tape and all damaged areas shall be completely repaired to the satisfaction of the Engineer.

J. Electronic Markers

1. Electronic markers shall be buried with utilities to serve as a locating device. Electronic markers shall be the "Ball" type for a depth up to 4-feet and the "Full Range" type for depths greater than 4-feet. Each marker shall be color coded in accordance with APWA standards and produce an industry specific frequency. Each marker shall contain a passive antenna that requires no internal power source.
2. Electronic markers will be provided for all water mains. Electronic markers shall be installed every 100 linear feet and as needed to establish a change in direction.

### **3.06 Connections to Water Mains**

A. All connections shall be scheduled with the Engineer and Owner at least 48-hours in advance so as to permit supervision by the Owner (Contact: Mr. Keithly Wynter at 404-612-7556).

B. Make connections to existing pipe lines with tapping sleeves and valves, unless specifically shown otherwise on the Drawings.

C. Location: Before laying pipe, locate the points of connection to existing water mains and uncover as necessary for the Engineer to confirm the nature of the connection to be made.

D. Interruption of Services: Make connections to existing water mains only when system operations permit. Operate existing valves only with the specific authorization and direct supervision of the Owner.

E. Tapping Saddles and Tapping Sleeves

1. Holes in the new pipe shall be machine cut, either in the field or at the factory. No torch cutting of holes shall be permitted.
2. Prior to attaching the saddle or sleeve, the pipe shall be thoroughly cleaned, utilizing a brush and rag, as required.
3. Before performing field machine cut, the watertightness of the saddle or sleeve assembly shall be pressure tested. The interior of the assembly shall be filled with water. An air compressor shall be attached, which will induce a test pressure as specified in this Section. No leakage shall be permitted for a period of five minutes.

4. After attaching the saddle or sleeve to an existing main, but prior to making the tap, the interior of the assembly shall be disinfected. All surfaces to be exposed to potable water shall be swabbed or sprayed with a one percent sodium hypochlorite solution.

F. Connections Using Solid Sleeves: Where connections are shown on the Drawings using solid sleeves, the Contractor shall furnish materials and labor necessary to make the connection to the existing pipe line.

G. Connections Using Couplings: Where connections are shown on the Drawings using couplings, the Contractor shall furnish materials and labor necessary to make the connection to the existing pipe line, including all necessary cutting, plugging and backfill.

### **3.07 Thrust Restraint**

A. Provide restraint at all points where hydraulic thrust may develop.

B. Retainer Glands: Provide retainer glands where shown on the Drawings and on all mechanical joints and all associated fittings, valves and related piping. Retainer glands shall be installed in accordance with the manufacturer's recommendations, particularly, the required torque of the set screws. The Contractor shall furnish a torque wrench to verify the torque on all set screws which do not have inherent torque indicators.

C. Hydrants: Hydrants shall be attached to the water main by the following method:

1. The isolation valve shall be attached to the main by connecting the valve to the hydrant tee.
2. The isolation valve shall be attached to the hydrant by providing an anchor coupling between the valve and hydrant, if the hydrant and valve are less than two feet apart. Otherwise, provide ductile iron pipe with retainer glands on the hydrant and valve.

D. Thrust Collars: Collars shall be constructed as shown on the Drawings. Concrete and reinforcing steel shall meet the requirements as specified in this Section. The welded-on collar shall be designed to meet the minimum test pressure specified herein. The welded-on collar shall be attached to the pipe by the pipe manufacturer.

E. Concrete Blocking

1. Provide concrete blocking for all bends, tees, valves, and other points where thrust may develop, except where other exclusive means of thrust restraint are specifically shown on the Drawings.
2. Concrete shall be as specified in this Section.
3. Form and pour concrete blocking at fittings as shown on the Drawings and as directed by the Engineer. Pour blocking against undisturbed earth. Increase dimensions when required by over excavation.

### 3.08 Inspection and Testing

#### A. Pressure and Leakage Test

1. All sections of the water main subject to internal pressure shall be pressure tested in accordance with AWWA C600. A section of main will be considered ready for testing after completion of all thrust restraint and backfilling.
2. Each segment of water main between main valves shall be tested individually.
3. Test Preparation
  - a. For water mains less than 24-inches in diameter, flush sections thoroughly at flow velocities, greater than 2.5 feet per second, adequate to remove debris from pipe and valve seats. Partially open valves to allow the water to flush the valve seat.
  - b. Partially operate valves and hydrants to clean out seats.
  - c. Provide temporary blocking, bulkheads, flanges and plugs as necessary, to assure all new pipe, valves, and appurtenances will be pressure tested.
  - d. Before applying test pressure, air shall be completely expelled from the pipeline and all appurtenances. Insert corporation cocks at highpoints to expel air as main is filled with water as necessary to supplement automatic air valves. Corporation stops shall be constructed as detailed on the Drawings with a meter box.
  - e. Fill pipeline slowly with water. Provide a suitable pump with an accurate water meter to pump the line to the specified pressure.
  - f. The differential pressure across a valve or hydrant shall equal the maximum possible, but not exceed the rated working pressure. Where necessary, provide temporary backpressure to meet the differential pressure restrictions.
  - g. Valves shall not be operated in either the opening or closing direction at differential pressures above the rated pressure.
4. Test Pressure: Test the pipeline at 250 psi measured at the lowest point for at least two hours. Maintain the test pressure within 5 psi of the specified test pressure for the test duration. Should the pressure drop more than 5 psi at any time during the test period, the pressure shall be restored to the specified test pressure. Provide an accurate pressure gage with graduation not greater than 5 psi.
5. Leakage

a. Leakage shall be defined as the sum of the quantity of water that must be pumped into the test section, to maintain pressure within 5 psi of the specified test pressure for the test duration plus water required to return line to test pressure at the end of the test. Leakage shall be the total cumulative amount measured on a water meter.

b. The Owner assumes no responsibility for leakage occurring through existing valves.

6. Test Results: No test section shall be accepted if the leakage exceeds the limits determined by the following formula:

$$L = \frac{SD(P)^{1/2}}{133,200}$$

Where: L = allowable leakage, in gallons per hour

S = length of pipe tested, in feet

D = nominal diameter of the pipe, in inches

P = average test pressure during the leakage test, in pounds per square inch (gauge)

As determined under Section 4 of AWWA C600.

If the water main section being tested contains lengths of various pipe diameters, the allowable leakage shall be the sum of the computed leakage for each diameter. The leakage test shall be repeated until the test section is accepted. All visible leaks shall be repaired regardless of leakage test results.

7. Completion: After a pipeline section has been accepted, relieve test pressure. Record type, size and location of all outlets on record drawings.

### **3.09 Disinfecting Pipeline**

A. After successfully pressure testing each pipeline section, disinfect in accordance with AWWA C651 for the continuous-feed method and these Specifications.

B. Specialty Contractor: Disinfection shall be performed by an approved specialty contractor. Before disinfection is performed, the Contractor shall submit a written procedure for approval before being permitted to proceed with the disinfection. This plan shall also include the steps to be taken for the neutralization of the chlorinated water.

C. Chlorination

1. Apply chlorine solution to achieve a concentration of at least 25 milligrams per liter free chlorine in new line. Retain chlorinated water for 24 hours.

2. Chlorine concentration shall be recorded at every outlet along the line at the beginning and end of the 24 hour period.

3. After 24 hours, all samples of water shall contain at least 10 milligrams per liter free chlorine. Re-chlorinate if required results are not obtained on all samples.

D. Disposal of Chlorinated Water: Reduce chlorine residual of disinfection water to less than one milligram per liter if discharged directly to a body of water or to less than two milligrams per liter if discharged onto the ground prior to disposal. Treat water with sulfur dioxide or other reducing chemicals to neutralize chlorine residual. Flush all lines until residual is equal to existing system.

E. Bacteriological Testing: After final flushing and before the water main is placed in service, the Contractor shall collect samples from the line and have tested for bacteriological quality in accordance with the rules of the Georgia Department of Natural Resources, Environmental Protection Division. Testing shall be performed by a laboratory certified by the State of Georgia. Re-chlorinate lines until required results are obtained.

### **3.10 Protection and Restoration of Work Area**

A. General: Return all items and all areas disturbed, directly or indirectly by work under these Specifications, to their original condition or better, as quickly as possible after work is started.

1. The Contractor shall plan, coordinate, and prosecute the work such that disruption to personal property and business is held to a practical minimum.

2. All construction areas abutting lawns and yards of residential or commercial property shall be restored promptly. Backfilling of underground facilities, ditches, and disturbed areas shall be accomplished on a daily basis as work is completed. Finishing, dressing, and grassing shall be accomplished immediately thereafter, as a continuous operation within each area being constructed and with emphasis placed on completing each individual yard or business frontage. Care shall be taken to provide positive drainage to avoid ponding or concentration of runoff.

3. Handwork, including raking and smoothing, shall be required to ensure that the removal of roots, sticks, rocks, and other debris is removed in order to provide a neat and pleasing appearance.

4. The Department of Transportation's engineer shall be authorized to stop all work by the Contractor when restoration and cleanup are unsatisfactory and to require appropriate remedial measures.

B. Man-Made Improvements: Protect, or remove and replace with the Engineer's approval, all fences, walkways, mail boxes, pipe lines, drain culverts, power and telephone lines and cables, property pins and other improvements that may be encountered in the Work.

C. Cultivated Growth: Do not disturb cultivated trees or shrubbery unless approved by the Engineer. Any such trees or shrubbery which must be removed shall be heeled in and replanted under the direction of an experienced nurseryman.

D. Cutting of Trees: Do not cut trees for the performance of the work except as absolutely necessary. Protect trees that remain in the vicinity of the work from damage from equipment. Do not store spoil from excavation against the trunks. Remove excavated material stored over the root system of trees within 30 days to allow proper natural watering of the root system. Repair any damaged tree over 3-inches in diameter, not to be removed, under the direction of an experienced nurseryman. All trees and brush that require removal shall be promptly and completely removed from the work area and disposed of by the Contractor. No stumps, wood piles, or trash piles will be permitted on the work site.

E. Disposal of Rubbish: Dispose of all materials cleared and grubbed during the construction of the Project in accordance with the applicable codes and rules of the appropriate county, state and federal regulatory agencies.

### **3.11 Abandoning Existing Water Mains**

A. General: Abandon in place all existing water main segments indicated on the Drawings to be abandoned. Perform abandonment after the new water main has been placed in service and all water main services have been changed over to the new main.

B. Capping and Plugging: Disconnect by sawing or cutting and removing a segment of existing pipe where cutting and capping or plugging is shown on the Drawings or directed by the Engineer. Provide a watertight pipe cap or plug and concrete blocking for restraint to seal off existing mains indicated to remain in service. Seal ends of existing mains to be abandoned with a pipe cap or plug or with a masonry plug and minimum 6-inch cover of concrete on all sides around the end of the pipe. The Contractor shall be responsible for uncovering and verifying the size and material of the existing main to be capped or plugged.

C. Salvaging Materials: Salvage for the Owner existing fire hydrants, valve boxes, valve markers and other materials as indicated on the Drawings or located on water mains abandoned and deliver salvaged items in good condition to the Owner's storage yard. Coordinate delivery and placement of salvaged materials in advance with the Owner, information below.

Attn: Mr. Thomas Czeczil  
Department of Public Works  
North Fulton Water System  
11575-A Maxwell Road  
Alpharetta, GA 30004  
(770) 360-8853

END OF SECTION

**Part 1 General****1.01 Scope**

- A. The work covered by this Section includes furnishing all materials and equipment, providing all required labor and installing water meters, water service connections and all appurtenant work according to these Specifications and/or to the Water Connection Detail as shown schematically on the Drawings.
- B. Water meters are not to be furnished nor installed. However, the water meter connection must be compatible with the water meters currently used by the Fulton County.
- C. No galvanized pipe or fittings shall be used on water services.

**1.02 Locations**

Locations shall be as close to the existing location or as directed by the Engineer along the route of the water mains.

**1.03 Service Compatibility**

It is the intent of these Specifications that the water service connections shall duplicate those presently being provided by the Fulton County in order to be compatible with their service maintenance procedures.

**1.04 Quality Control**

All materials installed under this Section shall have the approval of the NSF for water services.

**Part 2 Products****2.01 Materials and Construction**

- A. Service Line
  - 1. Copper Tubing: Tubing shall be ASTM B 88, Type K, rolled type. Fittings shall be brass with flare connection inlets and outlets, ANSI B16.26. Where required, adapters shall be brass. Unions shall be cast bronze. Joints shall be flare type. All fittings shall be of bronze construction with flare type connections. Individual residential service lines shall be 1-inch copper tubing.
- B. Valves and Accessories
  - 1. Ball valves shall be full port bronze, heavy duty type. Valve ends shall be threaded. Valves shall have a minimum 200 psi working

pressure for water. Valves shall have stainless steel nut and handle. Valves shall be made in the U.S.A.

## 2. Corporation Cocks

a. Corporation cocks shall be ground key type, shall be made of bronze conforming to ASTM B61 or B62 and shall be suitable for the working pressure of the system. Ends shall be suitable for flare type joint. Coupling nut for connection to flared copper tubing shall conform to ANSI B16.26.

b. Corporation cocks shall be equal to Ford FB-600-4.

## Part 3 Execution

### 3.01 General

- A. Immediately following completion of the water main system, the Contractor shall install water taps and meter boxes as required. All taps shall remain exposed at the main until the system has been successfully inspected, disinfected and tested for pressure.
- B. Installation shall conform to the details for water service connections appearing schematically on the Drawings. Contractor shall provide any and all appurtenant work required to provide the intended water service connections.
- C. The Contractor shall be prepared to make emergency repairs to the water system, if necessary, due to damage by others working in the area. In conjunction with this requirement, the Contractor shall furnish and have available at all times, a tapping machine, for the purpose of making temporary water service taps or emergency repairs to damaged water services. The Contractor shall furnish the County a phone number of an individual with the authority to initiate emergency repair work. This number must be provided prior to starting work on the Project.

### 3.02 Tapping Main

- A. All services connected to water main shall be through a 1-inch direct tap, regardless of service and meter size.
- B. The water main shall be tapped with a tapping machine specifically designed for that purpose. The tap shall be a direct tap into the water main through a 1-inch brass corporation cock. All taps shall be supervised by the Fulton County engineer. All taps shall be made on the water main at a position so as not to be the top side of the pipe nor the bottom of the pipe. Distance between taps must be a minimum of 12-inches apart.

### 3.03 Relocation of Service Lines

- A. Existing service lines shall be field located by the Contractor. The Contractor shall be responsible for locating existing water meters and determining the existing size service line to reconnect the meters to the new water mains. All service lines installed under existing pavement, including streets, driveways and sidewalks, shall be installed by free boring. If deemed necessary and directed by the Engineer, the Contractor may be required to relocate the existing meters and meter boxes. Relocated meters and meter boxes shall conform to installation requirements for new meters as shown on the Drawings.
- B. Copper tubing (Type K) between tap and water meter shall be one continuous length of pipe with no intermediate joints or connections. The service line shall be placed without sharp turns or bends from the water main to the meter box.

#### **3.04 Transfer of Service**

- A. Immediately before connecting to the relocated or existing meter, all service lines shall be flushed to remove any foreign matter. Any special fittings required to reconnect the existing meter to the new copper service line, or the existing private service line, shall be provided by the Contractor. To minimize out of service time, the Contractor shall determine the connections to be made and have all the required pipe and fittings on hand before shutting off the existing service. After completing the connection, the new corporation stop shall be opened and all visible leaks shall be repaired.

#### **3.05 Maintenance and Repairs**

- A. The tap, service line and meter box shall remain under the Contractor's maintenance responsibility for the same warranty period as the water main. The contractor shall promptly repair any damage to the water system during the warranty period.

END OF SECTION

**Part 1                      General****1.01                              Scope**

A.                              The work covered by this Section includes furnishing all materials and equipment, providing all required labor and installing water meters, water service connections and all appurtenant work according to these Specifications and/or to the Water Connection Detail as shown schematically on the Drawings.

B.                              Water meters are not to be furnished nor installed. However, the water meter connection must be compatible with the water meters currently used by the Fulton County.

C.                              No galvanized pipe or fittings shall be used on water services.

**1.02                              Locations**

Locations shall be as close to the existing location or as directed by the Engineer along the route of the water mains.

**1.03                              Service Compatibility**

It is the intent of these Specifications that the water service connections shall duplicate those presently being provided by the Fulton County in order to be compatible with their service maintenance procedures.

**1.04                              Quality Control**

All materials installed under this Section shall have the approval of the NSF for water services.

**Part 2                              Products****2.01                              Materials and Construction**

A.                              Service Line

1.                              Copper Tubing: Tubing shall be ASTM B 88, Type K, rolled type. Fittings shall be brass with flare connection inlets and outlets, ANSI B16.26. Where required, adapters shall be brass. Unions shall be cast bronze. Joints shall be flare type. All fittings shall be of bronze construction with flare type connections. Individual residential service lines shall be 1-inch copper tubing.

B.                              Valves and Accessories

1.                              Ball valves shall be full port bronze, heavy duty type. Valve ends shall be threaded. Valves shall have a minimum 200 psi working pressure for water. Valves shall have stainless steel nut and handle. Valves shall be made in the U.S.A.

2.                              Corporation Cocks

- a. Corporation cocks shall be ground key type, shall be made of bronze conforming to ASTM B61 or B62 and shall be suitable for the working pressure of the system. Ends shall be suitable for flare type joint. Coupling nut for connection to flared copper tubing shall conform to ANSI B16.26.
- b. Corporation cocks shall be equal to Ford FB-600-4.

### **Part 3 Execution**

#### **3.01 General**

- A. Immediately following completion of the water main system, the Contractor shall install water taps and meter boxes as required. All taps shall remain exposed at the main until the system has been successfully inspected, disinfected and tested for pressure.
- B. Installation shall conform to the details for water service connections appearing schematically on the Drawings. Contractor shall provide any and all appurtenant work required to provide the intended water service connections.
- C. The Contractor shall be prepared to make emergency repairs to the water system, if necessary, due to damage by others working in the area. In conjunction with this requirement, the Contractor shall furnish and have available at all times, a tapping machine, for the purpose of making temporary water service taps or emergency repairs to damaged water services. The Contractor shall furnish the County a phone number of an individual with the authority to initiate emergency repair work. This number must be provided prior to starting work on the Project.

#### **3.02 Tapping Main**

- A. All services connected to water main shall be through a 1-inch direct tap, regardless of service and meter size.
- B. The water main shall be tapped with a tapping machine specifically designed for that purpose. The tap shall be a direct tap into the water main through a 1-inch brass corporation cock. All taps shall be supervised by the Fulton County engineer. All taps shall be made on the water main at a position so as not to be the top side of the pipe nor the bottom of the pipe. Distance between taps must be a minimum of 12-inches apart.

#### **3.03 Relocation of Service Lines**

- A. Existing service lines shall be field located by the Contractor. The Contractor shall be responsible for locating existing water meters and determining the existing size service line to reconnect the meters to the new water mains. All service lines installed under existing pavement, including streets, driveways and sidewalks, shall be installed by free boring. If deemed necessary and directed by the Engineer, the Contractor may be required to relocate the existing meters and meter boxes. Relocated meters and meter boxes shall conform to installation requirements for new meters as shown on the Drawings.

B. Copper tubing (Type K) between tap and water meter shall be one continuous length of pipe with no intermediate joints or connections. The service line shall be placed without sharp turns or bends from the water main to the meter box.

### **3.04 Transfer of Service**

A. Immediately before connecting to the relocated or existing meter, all service lines shall be flushed to remove any foreign matter. Any special fittings required to reconnect the existing meter to the new copper service line, or the existing private service line, shall be provided by the Contractor. To minimize out of service time, the Contractor shall determine the connections to be made and have all the required pipe and fittings on hand before shutting off the existing service. After completing the connection, the new corporation stop shall be opened and all visible leaks shall be repaired.

### **3.05 Maintenance and Repairs**

A. The tap, service line and meter box shall remain under the Contractor's maintenance responsibility for the same warranty period as the water main. The contractor shall promptly repair any damage to the water system during the warranty period.

END OF SECTION

**Part 1 General****1.01 Scope**

A. The extent of grassing consists of those areas which are disturbed by operations of the Contractor and are not covered over by improvements, except where specifically noted otherwise, together with any additional areas shown on the Drawings or authorized by the Engineer.

B. Types of work required include following:

1. Fine grading and preparing of lawn areas.
2. Furnishing and applying new topsoil.
3. Furnishing and applying soil amendments.
4. Furnishing and applying fertilizers.
5. Seeding lawn areas.
6. Sodding lawn areas.
7. Planting lawn areas with plugs.
8. Reconditioning existing lawn areas.
9. Replanting unsatisfactory or damaged lawns.

C. Use stripped and saved top soil where available. For additional quantity required, furnish topsoil as specified in 2.01.

**1.03 Submittals**

A. General: Submit the following in accordance with Section 01340 of these Specifications.

B. Certification of Grass Seed: Submit seed vendor's certified statement for each grass seed mixture required, stating botanical and common name, percentage by weight, and percentages of purity, germination rate (%), and weed seed for each grass seed species.

C. Sod Analysis: Notify Engineer of sod source, including name and telephone number of supplier, and seed mix of sod.

**1.04 Job Conditions**

Planting Time: Sow lawn seed only during normal planting seasons for each type of lawn work required. Correlate planting with specified maintenance periods to provide required maintenance from date of substantial completion.

Specified work is minimum required, and any and all necessary materials and operations including reworking, must be performed to obtain specified results.

## 1.05 Warranty

Warrant grassing through specified maintenance period and until final acceptance.

## Part 2 Products

### 2.01 New Topsoil

A. Provide topsoil that is fertile, friable, naturally loamy, surface soil; reasonably free of subsoil, clay lumps, brush, weeds, and other litter; and free of roots, stumps, stones larger than 1/2 inch in any dimension, and other extraneous or toxic matter harmful to plant growth.

B. Obtain topsoil from local sources or from areas having similar soil characteristics to that found at site of work. Obtain topsoil from naturally well-drained sites where topsoil occurs at least 4 inches deep; do not obtain from bogs or marshes.

### 2.02 Soil Amendments

A. Lime: Natural limestone containing at least 85 percent of total carbonates, ground to such fineness that at least 90 percent passes a 10-mesh sieve and at least 50 percent passes a 100-mesh sieve.

Provide lime in form of dolomitic limestone.

B. Fertilizer: Standard commercial grade fertilizer conforming to the standards of the Association of Official Agricultural Chemists. Provide either grade 4-12-12, 6-12-12 or 5-10-15 at Contractor's option.

C. Nitrogen: Standard commercial grade nitrogen conforming to state fertilizer laws. Provide in either granular or liquid form at Contractor's option.

D. Peat Humus: Finely divided or granular texture and with pH of 6.0 to 7.5 composed of moss peat (other than sphagnum), or peat humus, or reed-sedge peat.

E. Sawdust or Ground Bark: Provide type that is nontoxic to plants, of uniform texture, and subject to slow decomposition when mixed with soil. Provide nitrogen-treated sawdust or ground bark, or provide untreated and mix at site with at least 0.15 lbs. of ammonium nitrate or 0.25 lbs. of ammonium sulfate per cu. ft. of loose sawdust or ground bark.

### 2.03 Grass Materials

A. Seed, Sod, and Plugs will be the same species as the grass removed or damaged at any given location.

B. Grass Seed: Provide fresh, clean, new-crop seed complying with the tolerance for purity and germination established by the Official Seed Analysts of North America. Provide seed of the grass species, proportions and minimum percentages of purity, germination rate (%), and maximum percentage of weed seed, as detailed on the Drawings.

Seed shall bear the grower's analysis testing to 98 percent for purity and 90 percent for germination. At the discretion of the Engineer, samples of seed may be taken for verification against the grower's analysis.

C. Sod: Provide machine-cut, strongly rooted, certified turfgrass sod, at least 2 years old and free of weeds and undesirable native grasses. Provide sod capable of vigorous growth and development when planted (viable, not dormant) and complying with the following requirements:

Kentucky Bluegrass (*Poa pratensis*).  
Bermuda grass (*Cynodon dactylon*).  
St Augustinegrass (*Stenotaphrum secundatum*).  
Centipedegrass (*Eremochloa ophiuroides*).

1. Sod Pad Size: Uniform thickness of 5/8 inch, plus or minus 1/4 inch, measured at time of cutting and excluding top growth and thatch. Provide in supplier's standard size of uniform length and width with maximum 5 percent allowable deviation in either length or width. Broken or torn pads with uneven ends are not acceptable.

2. Sod Strength: Provide sod pads capable of supporting their own weight and retaining size and shape when supplier's standard size pad is suspended vertically from a firm grasp on upper 10 percent of the pad.

D. Sod Plugs: Provide strongly rooted certified sod at least 2 years old, free of weeds and undesirable native grasses and capable of growth and development when planted (viable, not dormant). Provide in form suitable for cutting into plugs at least 4 inches thick. Provide sod plugs composed principally of the following:

Manilagrass (*Zoysia matrella*).  
Carpetgrass (*Axonopus officinis*).  
Centipedegrass (*Eremochloa ophiuroides*).

#### **2.04 Mulch and Water**

A. Antierosion Mulch: Provide clean, seed-free, salt hay or threshed straw of wheat, rye, oats, or barley.

B. Seed Mulch: Provide peat moss in natural, shredded, or granulated form, of fine texture, with a pH of 4.0 to 6.0 and a water-absorbing capacity of 1,100 to 2,000 percent.

C. Water used to produce grass is to be free of excess and harmful chemicals, acids, alkalies and all other substances which are harmful to plant growth.

D. Asphalt: Homogeneous emulsified asphalt meeting ASTM D 977 which contains no agents harmful or toxic to plant growth.

### **Part 3 Execution**

#### **3.01 General**

A. Minimum Operations: These Specifications set forth minimum operations and material applications which are acceptable. However, a satisfactory stand of grass must be obtained by using supplemental methods and/or materials as may be required.

B. Grassing By Private Property: Where grassing is required between curbs and sidewalks or behind sidewalks in areas adjacent to private residential or commercial property, the Engineer may change the type of grassing specified to match any type of grass which may be planted and growing on the adjacent lawn. No modifications of the Contract Unit Price will be made for this substitution.

### **3.02 Soil Preparation**

A. Limit preparation to areas that will be planted in immediate future.

Loosen subgrade to a minimum depth of 4 inches. Remove stones bigger than 1-1/2 inches in any dimension and sticks, roots, rubbish, and other extraneous matter.

Clean topsoil of roots, plants, sods, stones, clay lumps, and other extraneous materials harmful to toxic to plant growth.

Mix soil amendments and fertilizers with topsoil at rates specified. Delay mixing of fertilizer if planting will not follow placing of topsoil mixture within a few days. Either mix soil before spreading or apply soil amendments on surface of spread topsoil and mix thoroughly into top 4 inches of topsoil before planting.

Mix lime with dry soil before mixing in fertilizer.

Apply phosphoric acid fertilizer (other than that constituting a portion of complete fertilizers) directly to subgrade before tilling.

Place approximately 1/2 of total amount of topsoil mixture required. Work into top of loosened subgrade to create a transition layer, and then place remainder of topsoil mixture.

Allow for sod thickness in areas to be sodded.

B. Lime and Fertilizer Application:

Spread lime uniformly over the ground surface at the rates detailed on the Drawings.

Spread fertilizer uniformly over the ground surface at the rates detailed on the Drawings.

### **3.03 Seeding Lawns**

A. Sow seed with a spreader or a seeding machine. Do not seed when wind velocity exceeds 5 miles per hour. Distribute seed evenly over entire area by sowing equal quantity in 2 directions at right angles to each other.

Do not use wet seed or seed that is moldy or otherwise damaged in transit or storage.

Sow no less than the quantity of seed specified.

B. Rake seed lightly into top 1/8 inch of soil, roll lightly, and water with fine spray.

C. Protect seeded slopes against erosion with jute mesh erosion netting or other similar coverings acceptable to Engineer.

D. Protect seeded areas against erosion by spreading specified lawn mulch after completion of seeding operations. Spread uniformly to form a continuous blanket at least 1-1/2 inches loose measurement over seeded areas. Spread by hand, blower, or other suitable equipment.

Anchor mulch by spraying with asphalt emulsion at the rate of 10 to 13 gallons per 1,000 sq. ft. Take precautions to prevent damage or staining of structures or other plantings adjacent to mulched areas. Immediately clean such areas where damage occurs.

E. Protect seeded areas against hot, dry weather or drying winds by applying specified mulch within 24 hours after completion of seeding operations. Presoak and scatter evenly to a depth of 1/8 inches to 3/16 inches thick and roll to a smooth surface. Do not mound.

### **3.04 Hydroseeding Lawns**

A. Mix specified seed, fertilizer, and pulverized mulch in water, using equipment specifically designed for hydroseed application. Continue mixing until uniformly blended into homogenous slurry suitable for hydraulic application.

B. Apply slurry uniformly to all areas to be seeded. Rate of application as required to obtain specified seed sowing rate.

### **3.05 Sodding Lawns**

A. Lay sod within 24 hours of stripping. Do not lay dormant sod or if ground is frozen.

B. Lay sod to form solid mass with tightly fitting joints. Butt ends and sides of sod strips; do not overlap. Stagger strips to offset joints in adjacent courses. Work from boards to avoid damage to subgrade or sod. Tamp or roll lightly to ensure contact with subgrade. Work sifted soil into minor cracks between pieces of sod; remove excess to avoid smothering adjacent grass.

C. Anchor sod on slopes with wood pegs as required to prevent slippage.

D. Water sod with fine spray immediately after planting. During first week, water daily or more frequently as necessary to maintain moist soil to depth of 4 inches.

### **3.06 Plug Sodding Lawns**

A. Cut plugs 2 inches to 4 inches square, retaining maximum amount of soil on roots. Do not tear or rip plug from sod mass. Keep roots moist and plant plugs immediately after cutting.

B. Plant plugs in holes on furrows. On slopes (if any), contour furrows to near level to prevent washing in heavy rains. Space plugs 12 inches apart in both directions.

### **3.07 Reconditioning Lawns**

A. Recondition existing lawn areas damaged by Contractor's operations including storage of materials or equipment and movement of vehicles. Also recondition lawn areas where settlement or washouts occur or where minor regrading is required. Recondition other existing lawn areas where indicated.

B. Provide fertilizer, seed or sod, and soil amendments as specified for new lawns and as required to provide satisfactorily reconditioned lawn. Provide new planting soil as required to fill low spots and meet new finish grades.

- C. Cultivate bare and compacted areas thoroughly to provide a good, deep planting bed.
- D. Remove diseased or unsatisfactory lawn areas; do not bury into soil. Remove topsoil containing foreign materials resulting from Contractor's operations including oil drippings, stone, gravel, and other construction materials; replace with new topsoil.
- E. Where substantial lawn remains (but is thin), mow, rake, aerate if compacted, fill low spots, remove humps, cultivate soil, fertilize, and seed. Remove weeds before seeding. If weeds are extensive, apply selective chemical weed killers as required. Apply a seedbed mulch, if required, to maintain moist condition.
- F. Water newly planted areas and keep moist until new grass is established.

### **3.08 Application of Nitrogen**

- A. Make two applications of nitrogen to all grassed areas using mechanical spreading equipment. Apply at a uniform rate of not less than 70 pounds per acre per application. Make both applications only when weather conditions will permit uniform and even distribution and when moisture conditions will not cause harm to grass.
- B. Place first application of nitrogen when young grass reaches a height of at least one inch. Make the second application of nitrogen between 30 and 45 days after the first application.

### **3.09 Protection**

Erect barricades and warning signs as required to protect newly planted areas from traffic. Maintain barricades throughout maintenance period until lawn is established.

### **3.10 Maintenance**

- A. Begin maintenance of lawns immediately after each area is planted and continue for the periods required to establish acceptable lawns, but no less than the following:
1. Seeded lawns, at least 60 days, after date of substantial completion.  

If seeded in fall and not given full 60 days of maintenance, or if not considered acceptable at that time, continue maintenance during following spring until acceptable lawn is established.
  2. Sodded lawns, at least 30 days after date of substantial completion.
  3. Sod plug lawns, at least 30 days after date of substantial completion.
- B. Maintain lawns by watering, fertilizing, weeding, mowing, trimming, and other operations such as rolling, regrading, replanting as required to establish a smooth, acceptable lawn, free of eroded or bare areas.
- C. Remulch with new mulch in areas where mulch has been disturbed by wind or maintenance operations sufficiently to nullify its purpose. Anchor as required to prevent displacement.
- D. Replant bare areas with same materials specified for lawns.

E. Watering: Provide and maintain temporary piping, hoses and lawn watering equipment to convey water from sources and to keep lawn areas uniformly moist as required for proper growth.

F. Lay out temporary lawn-watering system and arrange watering schedule to prevent puddling, water erosion, and displacement of seed or mulch (if any). Lay out temporary watering system to avoid necessity of walking over muddy or newly seeded areas.

G. Mow lawns as soon as there is enough top growth to cut with mower set at specified height for principal species planted. Repeat mowing as required to maintain specified height. Remove no more than 40 percent of grass leaf growth in initial or subsequent mowings. Do not delay mowing until grass blades bend over and become matted. Do not mow when grass is wet. Time initial and subsequent mowings to maintain following grass height:

Mow grass from 1-1/2 inches to 2 inches high. Do not mow to less than 1-1/2 inches.

H. Apply second fertilizer application after first mowing and when grass is dry.

Use fertilizer that will provide at least 1.0 lb. of actual nitrogen per 1,000 sq. ft. of lawn area.

### **3.11 Required Coverage**

A. Grassed areas will be considered acceptable when a viable stand of grass covers at least 98 percent of the total area with no bare spots exceeding one square foot and the ground surface is fully stabilized against erosion.

### **3.12 Acceptance**

A. When work is substantially completed, including maintenance, Engineer will, upon request, make an inspection to determine acceptability.

B. Lawn work may be inspected for acceptance in parts agreeable to Engineer, provided work offered for inspection is complete, including maintenance.

C. Replant rejected work and continue specified maintenance until reinspected by Engineer and found to be acceptable.

D. Seeded lawns will be acceptable provided requirements, including maintenance and coverage, have been met and healthy, uniform close stand of specified grass is established free of weeds, bare spots, and surface irregularities.

E. Sodded lawns will be acceptable provided requirements, including maintenance and coverage, have been met and required number of plugs are established as well-rooted, viable patches of grass and areas between plugs are free of weeds and other undesirable vegetation.

F. Plugged lawns will be acceptable, provided requirements, including maintenance and coverage, have been met and required number of plugs are established as well-rooted, viable patches of grass and areas between plugs are free of weeds and other undesirable vegetation.

### **3.13 Clean Up**

A. Promptly remove soil and debris created by lawn work from paved areas. Clean wheels of vehicles before leaving site to avoid tracking soil onto surface of roads, side walks, or other paved areas.

END OF SECTION

## **Part 1 General**

### **1.01 Scope**

A. The work specified in this Section includes furnishing all labor, equipment and material required to locate, identify, verify condition and remove or protect existing trees as shown on the Drawings and/or as directed by the Engineer.

B. The contractor shall install orange tree protection fencing (barrier) around each tree to be protected, as shown on the Drawings and as ordered by the Engineer.

C. No trees or vegetation shall be removed except as specifically exempted or approved by the Engineer

### **1.02 Reference**

“Trenching and Tunneling near Trees,” by James R. Fazio. Published by the National Arbor Day Foundation.

“Tree Preservation Ordinance and Administrative Guide Lines,” Fulton County (January 2000).

### **1.03 Qualifications**

Contractor shall have on staff for the project at least one person with a minimum of 5 years experience as nurseryman in planting and protecting trees.

### **1.04 Submittals**

A. Contractor shall walk the site with City of Alpharetta’s Arborist (678-297-6200), to understand (in more detail than shown on the Drawings) the scope and requirements of tree protection for this project. Prepare a Tree Protection Work Plan describing how tree protection will be handled during installation of the water lines. The Work Plan shall include, but is not limited to:

1. Confirmation of identification of specimen trees (shown on the Drawings) and other trees to be protected.
2. Scope of general protection of trees within right-of-ways and along the water line trench alignment.
3. Determination of drip line limits of protected trees and approximate free bore lengths.
4. Scope of general protection of trees outside right-of-ways but in close proximity to work areas.
5. Extent of approved or required tree limb cutting and trimming to make space for work area.
6. Extent of approved or required tree root cutting, if necessary within trench area.

7. Confirmation of the type of protective fencing, other protective measures as required, and installation details.

Contractor shall submit five copies of the Tree Protection Work Plan to the Engineer for approval. Contractor shall not begin any field activity prior to approval of this Work Plan by the Engineer and City Arborist.

## Part 2 Products

### 2.01 Products

#### A. Protective Fencing

1. Orange Safety Fencing: Minimum 4 feet in width and shall be made of high density polyethylene resin, extruded and stretched to provide a highly visible bright orange, non-fading fence. The fabric shall remain flexible from -60° F to 200° F and shall be inert to most chemicals and acids. The fabric pattern may vary from diamond to circular with a minimum unit weight of 0.4 lbs. and a maximum opening size of 2 inches. The fabric shall have a minimum tensile yield strength (horizontal) of 2000 psi and ultimate tensile strength of 2680 psi.
  2. The fencing material shall be supported by steel pipe tee posts or U posts, that are minimum 5 ½ feet in height and spaced no more than 8 feet on centers. The fabric shall be secured to post by bands or wire ties.
- B. Warning Signs: A weather proof warning sign shall be prominently displayed on each tree protection fence at 20-foot intervals. The sign shall be minimum 8.5-inches X 11-inches and clearly state in half inch tall letters: "Warning – Tree Protection Zone".
- C. Silt Fence (Type C): Silt fence shall be installed 2-feet from the outside of the tree protection fence where required or directed by the Engineer or City Arborist.
- D. Trunk Protection: When directed by the City Arborist, the tree trunk protection shall be provided using either 2x4-inch or 2x6-inch planking or plastic strapping.
- E. Tree Dressing: Dressing of any damaged areas shall be accomplished using any approved asphaltic tree wound paint immediately after damage occurs.

## Part 3 Execution

### 3.01 Execution

- A. Protective Fencing: All trees and shrubs in the proximity of the construction site shall be carefully checked for damage prior to initiation of any construction activity. All individual trees, shrubs, and natural areas scheduled for preservation shall be protected during construction with temporary fencing as indicated on the Drawings or directed by the City Arborist. Protective fences shall be installed prior to the start of any site preparation work (clearing, grubbing, or grading), and shall be maintained in functioning condition throughout all phases of the construction project. Protective fence locations in close proximity to intersecting streets or drives shall adhere to the site distance requirements.
- B. Protective fences shall be constructed around trees to be protected, at the locations (typically the outer limits of the Critical Root Zone) and with materials indicated on the Drawings to prevent the following:
1. Soil compaction in the root zone area resulting from vehicular traffic or storage of equipment or materials.
  2. Root zone disturbances due to grade changes greater than 6-inch cut or fill or trenching not reviewed and authorized by the City Arborist or the Engineer.
  3. Damage to exposed roots, trunks or limbs by mechanical equipment.
  4. Other activities detrimental to trees such as chemical storage, concrete truck cleaning, and fires.
- C. Exceptions to the installation of protective fences at the tree drip lines may be permitted in the following cases:
1. Where there is to be an approved grade change, impermeable paving surface, tree well, or other such site development, the fence shall be erected approximately 2 to 4 feet beyond the areas of disturbance.
  2. When permeable paving is to be installed within a tree drip line, the fence shall be erected at the outer limits of the permeable paving area prior to any site grading so that this enclosed area is graded separately to minimize root damage.
  3. When trees are located close to a proposed building or other construction activity, the fence shall be erected to allow 6 to 10 feet work space between the fence and the structure and apply organic mulch to a depth of (4) to six (6) inches in the unprotected root zone area;
  4. When there are street-side pedestrian walkways, fences shall be constructed in a manner that does not obstruct safe passage;

5. When there are severe space constraints due to tract size or other special requirements, the Contractor shall contact the Arborist or the Engineer to discuss alternatives.
  6. When any of the exceptions listed above will result in a fence being located closer than five (5) feet to a tree trunk, the Contractor shall also protect the trunk with strapped-on planking to a height of 8 feet or to the limits of lower branching in addition to the reduced fencing required.
- D. **Repair of Damage:** Tree roots scarred by equipment shall be cut cleanly and covered with topsoil. When tree roots are pruned, a comparable portion of selected branches shall be cut from the tree on the opposite side. Limb pruning shall be made at the branch collar. All limbs greater than 1-inch in diameter shall be precut in accordance with ANSI 300 pruning methods to prevent splitting. All cut limbs shall be treated with an approved tree dressing. Tools shall be disinfected with alcohol or 5 ppm chlorine solution between repairs to trees to prevent the transmission of diseases from one tree to another. All trees damaged during construction shall receive an application of fertilizer within the drip line at the rate of 4 pounds per caliper inch.
- E. **Cutting and Filling Around Trees:** When the depth of an excavation or embankment exceeds 6 inches of any tree with a diameter greater than 8 inches, a tree well shall be constructed to protect the tree.
- F. **Free Bore:** Where a pipe is to be installed within critical root zone (CRZ) and inside drip line area, installation of the pipe by free bore method is required to protect trees. The length of tree bore shall extend a minimum of five feet beyond drip line on both sides or as recommended length in the table provided on the Drawings, whichever is greater. The depth of free bore shall be such that there is a minimum of 4 feet of cover on top of pipe. The location and procedures shall be approved by the Engineer and City Arborist.
- G. **Paving Around Trees:** Where paving within the drip line of any tree greater than a 6 inch diameter is necessary, a permeable pavement and aeration system must be installed except for street construction.
- H. **Tree Removal:** Trees which directly interfere with construction may only be removed if approval of the Engineer and City Arborist has been obtained. When a tree or shrub is scheduled for removal, it shall be cut to a depth of 12 inches below the surrounding ground line. After removal, soil shall be placed in the hole to a depth matching the existing grade. The tree shall be cut into sections that can be managed, removed from the site and disposed of. All work shall be conducted in such a manner as to protect all facilities, improvements and vegetation in the work area. All damage resulting from tree removal or pruning shall be repaired at the Contractor's own expense.

- I. Final cleanup: All temporary tree and shrub preservation and protection measures shall be removed when the construction has been completed.
  
- J. Roots larger than 2-inch diameter shall not be cut without written permission from the City Arborist.

END OF SECTION

**Part 1 General****1.01 Description**

This section specifies reinforcing steel for use in reinforced concrete.

**1.02 Quality Assurance****A. References**

1. This section contains references to the following documents. They are a part of this section as specified and modified. Where a referenced document contains references to other standards, those documents are included as references under this section as if referenced directly. In the event of conflict between the requirements of this section and those of the listed documents, the requirements of this section shall prevail.
  
2. Unless otherwise specified, references to documents shall mean the documents in effect at the time of Bid. If referenced documents have been discontinued by the issuing organization, references to those documents shall mean the replacement documents issued or otherwise identified by that organization or, if there are no replacement documents, the last version of the document before it was discontinued. Where document dates are given in the following listing, references to those documents shall mean the specific document version associated with that date, regardless of whether the document has been superseded by a version with a later date, discontinued or replaced.

Reference	Title
ACI 315	Details and Detailing of Concrete Reinforcement
ASTM A82	Steel Wire, Plain, for Concrete Reinforcement
ASTM A185	Steel Welded Wire, Fabric, Plain for Concrete Reinforcement
ASTM A615/A615M REV B	Deformed and Plain Billet-Steel Bars for Concrete Reinforcement
ASTM A616/A616M	Rail-Steel Deformed and Plain Bars for Concrete Reinforcement
ASTM A617/A617M	Axle-Steel Deformed and Plain Bars for Concrete Reinforcement
ASTM A706/A706M REV B	Low-Alloy Steel Deformed Bars for Concrete Reinforcement
ASTM A775/A775M	Epoxy-Coated Reinforcing Steel Bars

Reference	Title
ASTM E329	Inspection and Testing Agencies for Concrete, Steel, and Bituminous Materials as Used in Construction
AWS D1.4	Structural Welding Code--Reinforcing Steel
CRSI-PRB	Placing Reinforcing Bars
CRSI-MSP 1	Manual of Standard Practice
FEDSPEC QQ-W-461H	Wire, Steel, Carbon (Round, Bare, and Coated)

### 1.03 Placing Drawings

The Contractor shall prepare reinforcement placing drawings conforming to the requirements of ACI 315. Placing drawings shall include bar lists, schedules, bending details, placing details, and placing plans and elevations as required to fully delineate this portion of the work.

The placing drawings shall be provided to the Engineer as product data for information only as specified in Section 01340. The placing drawings will not be reviewed for approval.

## Part 2 Products

### 2.01 Bar Reinforcement

Reinforcing bars shall be deformed billet steel in conformance with ASTM A615, including supplementary requirements. Bars shall be Grade 60, except ties or field-bent bars where specified shall be Grade 40. Bars to be welded shall be Grade 40 or shall be deformed billet steel conforming to ASTM A706. ASTM A616 or ASTM A617 steel shall not be used. Bars provided as dowels for future construction and bars where specified shall be epoxy-coated in conformance with ASTM A775.

### 2.02 Wire Fabric

Wire fabric shall be welded steel mesh conforming to ASTM A185.

### 2.03 Wire and Plain Bars

Wire used as reinforcement and bars used as spiral reinforcement in structures shall be cold drawn steel conforming to ASTM A82.

### 2.04 Tie Wire

The wire shall be minimum 16 gage annealed steel conforming to FEDSPEC QQ W 461H.

### 2.05 Bar Supports

Bar supports coming into contact with forms shall be CRSI Class 1 plastic protected or Class 2 stainless steel protected and shall be located in accordance with CRSI MSP-1 and placed in accordance with CRSI PRB. Concrete block supports shall be provided for footing and slabs on grade. Stainless steel or plastic protected plain steel supports shall be provided for other work.

## **2.06 Product Data**

The following information shall be provided prior to installation in accordance with Section 01340:

1. Certified mill test reports
2. Welder qualification certificate in accordance with AWS D1.4.
3. Reinforcement placing drawings conforming to the requirements of paragraph 03200 1.03.

## **Part 3 Execution**

### **3.01 Fabrication**

Reinforcing steel shall not be bent or straightened in a manner which will injure the material. Bars with kinks or with bends not shown shall not be used. Heating or welding bars shall be performed in accordance with AWS D1.4 and shall only be permitted where specified or approved by the Engineer. Bars shall not be welded at the bend.

### **3.02 Placement**

Reinforcing steel shall be placed in accordance with CRSI PRB and CRSI MSP-1.

Reinforcing steel shall be positioned accurately and secured against displacement by using annealed iron wire at intersections and shall be supported by concrete or metal chairs, spacers or metal hangers. Tack welding of cross bars is not acceptable. Bars shown on the drawings shall not be repositioned (buried) to act as support bars. Additional bars shall be provided as required for supports. Steel rods and pegs may be used to support reinforcing steel on rock foundations. Reinforcing steel shall be placed in such a manner as to not damage waterproofing membrane or plastic lining which has been previously applied or constructed. Reinforcing steel shall be shop-bent or slightly relocated where necessary to clear waterstop. Reinforcing steel shall not be placed on fresh concrete or forced into fresh concrete.

Supports for embedded items shall not be welded to the reinforcement. Additional reinforcement may be provided for this purpose.

### **3.03 Splicing**

Reinforcing steel shall be spliced as shown. Additional splices may be provided where approved by the Engineer.

In slabs, beams, girders and walls, reinforcing steel shall not be spliced in areas of maximum stress. Splices of adjacent bars shall be staggered at least one splice length, unless otherwise specified. Splices in welded wire fabric shall be at least 1 1/2 meshes wide.

### **3.04 Cleaning**

Reinforcing steel shall be cleaned of mill rust scale, dried concrete, or other coatings that may reduce bond. Reinforcement reduced in section is not acceptable. When concrete placement is delayed, reinforcement shall be cleaned by sandblasting if directed by the Engineer.

### **3.05 Epoxy Coating**

Epoxy coating damage need not be repaired in cases where the damaged area is 0.1 square inch or smaller. All damaged areas larger than 0.1 square inch shall be repaired in conformance with ASTM A775.

END OF SECTION

**Part 1 General****1.01 Description**

## A. Scope

This section specifies the materials and labor required for the manufacture and erection of precast concrete vault.

## B. Type

Precast concrete includes precast boxes, manholes and precast structural concrete.

**1.02 Quality Assurance**

## A. General

The General Contractor shall provide certification from the precast concrete manufacturer that the materials and manufacture of precast work supplied conforms to these specifications. The certification shall be signed by an officer of the manufacturer's corporation.

The responsibility for furnishing and installing precast concrete conforming to the specifications is solely that of the General Contractor.

## B. Testing Laboratory

All testing shall be performed by recognized independent laboratories specializing in the particular test to be performed, and conforming to the requirements of the National Bureau of Standards and ASTM E329.

## C. Reference Standards

The appropriate reference standards are specified in specification Sections 03200 of these Contract Documents, and the following documents. They are part of this section as specified and modified. In case of conflict between the requirements of this section and those of the listed documents, the requirements of this section shall prevail.

Reference	Title
ACI 318	Building Code Requirements for Reinforced Concrete
AWS D1.1	Structural Welding Code - Steel
AASHTO	Standard Specification for Highway Bridges
MNL-116	Prestressed Concrete Institute's Manual for Quality Control for Plants and Production of Precast and Prestressed Concrete Products, third edition

**1.03 SUBMITTALS**

In accordance with specification Section 01340 and in addition to the requirements of that section, the following submittals shall be provided:

#### A. Concrete Mix

Prior to casting any precast elements, concrete mix design shall be submitted to the Engineer for acceptance.

#### B. Shop Drawings

Three copies of shop drawings shall be provided showing product location, fabrication details, number identification marks, reinforcement, connection details including field installed anchor sizes and locations, if required, openings, loose or embedded items and inserts, dimensions and relationship to adjacent materials in sufficient detail to cover manufacture, handling, and erection. Shop drawings shall be accompanied by a letter signed by the manufacturer, certifying that, the shop drawings submitted represent construction which meets or exceeds the requirements of the Contract Documents and the requirements of codes and agencies having jurisdiction over the Work.

### **1.04 Labeling**

Each panel or member shall have an identification mark indicating its location in the structure as shown on the placing diagrams and date of casting.

### **1.05 Handling and Storage**

Unless specified otherwise herein, fabrication, handling and erection of precast elements shall be in accordance with the recommendations made by ACI 318 and ACI Committee 533.

Precast elements shall be properly supported off the ground to avoid damage during curing, storage, handling and hauling. Lateral support shall be sufficient to prevent bowing, warping, or permanent set due to creep. Edges of the units shall be adequately protected by padding or other means to prevent staining, chipping or spalling of concrete. Lifting devices shall have a minimum safety factor of 4.

## **Part 2 Products**

### **2.01 Performance and Design Requirements**

Concrete mix design and compressive strength shall meet 4000 psi at 28 days.

Design live loads shall be AASHTO H-20.

### **2.02 Precast Concrete Materials**

#### A. Cement

Concrete in contact with soil or liquids shall be formulated using Type II portland cement conforming to ASTM C150. Concrete not in contact with soil or liquids may be formulated using Type I or Type III portland cement. Cement shall contain less than 0.60 percent alkalis and shall be from one source throughout the entire project.

### B. Aggregates

Aggregates for normal weight concrete shall conform to ASTM C33 with a maximum size of 3/4 inch.

### C. Water

Water shall be clean, potable, and free from injurious amounts of oil, alkalis, organic materials and other deleterious substances.

### D. Admixture

Admixture shall be Pozzolith 300 R manufactured by Master Builders, Plastiment manufactured by Sika Chemical Corp., or equal. Admixture shall be used in strict accordance with manufacturer's recommendations. Calcium chloride or any admixture containing calcium chloride shall not be used.

### E. Reinforcing Steel

Reinforcing steel shall conform to ASTM A615, including supplementary requirements, and shall be Grade 60 except that bars to be welded shall be Grade 40 or ASTM A706.

### F. Embedded Items And Anchorage Devices

All embedded items, inserts, and anchorage devices exposed to view, moisture or weather shall be hot dipped galvanized steel. Anchorage devices shall be fabricated from ASTM A36 steel.

### G. Penetrations

All required penetrations and openings larger than 6 inches in diameter or 6 inches square shall be formed in place at the time of casting. Additional reinforcing shall be added where required to meet loading requirements. Openings and penetrations smaller than 6 inches may be core drilled.

### H. Molds

Material from which molds are to be fabricated shall be steel, concrete, fiberglass, reinforced plastic or wood. The selection of materials for molds shall be at the manufacturer's option, except that wood shall not be used without the express approval of the Engineer. All elements shall be cast in molds of rigid construction, accurate in detail with precise corners and arises, and designed to provide a close control of dimensions and details as indicated on the drawings.

Prior to casting of precast elements, molds shall have all surface joints, radii, corners, etc., filled, ground, filed, straightened or otherwise removed to provide a finished concrete surface that is smooth and dense, free of honeycombing, large air pockets, offsets, sinkages, or other irregularities.

### I. Parting Compound

All molds shall be coated with parting compound to facilitate removal of elements from molds. Parting compound shall be non petroleum, nonstaining and shall be of a nature and composition not deleterious to concrete.

#### J. Manhole Steps

Manhole steps shall be the cast aluminum type or extruded aluminum type.

### Part 3 Execution

#### 3.01 Installation

##### A. Casting

Casting shall be accomplished by methods and equipment that are in conformance with generally acceptable systems for this type of Work. All precast concrete shall be manufactured by a plant thoroughly experienced in this type of Work. The manufacturer shall meet all production schedules. Surfaces on which units are cast shall be level and free from any imperfections detrimental to the surface appearance of the finished units. Parting compound shall be applied evenly as per manufacturer's recommendations.

Concrete shall be so handled as to prevent segregation of materials and shall be continuously vibrated during casting, either internally or externally, to achieve proper compaction, finish and distribution of concrete. All precautions must be taken to keep the reinforcing steel in the proper location during placing and consolidation of the concrete. Unless shown otherwise and except at concrete faces exposed to soil or liquids, all reinforcing steel shall have a minimum cover of 3/4 inch. At concrete faces exposed to soil or liquids, cover shall be 1-1/2 inches minimum. Embedded items shall be accurately placed and maintained in their proper location during the casting operation. Special inserts or other devices for handling of panels for the convenience of the manufacturer shall not be exposed to view after members are erected. Embedded anchors, inserts, plates, angles and other cast in items shall have sufficient anchorage and embedment for design requirements.

Precast sections shall be manufactured to contain wall and roof openings of the minimum size to receive the ends of the pipes and such openings being accurately set to conform to line and grade of the pipelines. Subsequent cutting or tampering in the field, for the purpose of creating new openings or altering existing openings, will not be permitted except as directed by the Owner.

No more than four lift holes may be cast or drilled in each section.

Casting, bowing, warpage and dimensional tolerances shall be in accordance with MNL 116, third edition.

##### B. Curing

All precast units shall be steam cured for a period of at least 12 hours. Fog spraying may be used when reviewed by the Engineer. Precast elements shall not be removed from molds for a minimum period of 12 hours after casting, or until concrete has attained a minimum compressive strength of 3500 pounds per square inch, whichever governs. After removal from the forms, curing by steam or fog spraying shall be continued until concrete has attained

specified strength and confirmed by standard tests. Curing procedures shall be consistent and uniform throughout the entire project.

#### C. Welding

The quality of material and fabrication of all welded connections shall conform to the latest AISC "Specification for the Design, Fabrication and Erection of Structural Steel for Buildings." All weldments shall be made in accordance with the applicable provisions of AWS. All welding, other than tacks, shall be done by certified welders. All units shall be protected from damage by field welding or cutting operations. Noncombustible shields shall be provided as necessary for this purpose.

#### D. Joints and Joint Sealants

In all instances, the edges of precast concrete units and of adjacent material shall be sound, smooth, clean and free of all contaminants prior to joint treatment.

Sealant and primer shall be supplied by the same manufacturer and the primer, when required, shall be as recommended for the particular sealant used. All sealant compounds shall be delivered to the job in the manufacturer's original sealed containers with labels intact and shall be applied in strict accordance with the manufacturer's recommendations.

#### E. Miscellaneous

All exterior surfaces of the concrete vault shall be given a minimum of one shop coat of bituminous damp-proofing.

Gasket materials shall be top grade (100% solids, vulcanized) butyl rubber and shall meet or exceed AASHTO M 198.

### **3.02 Erection**

Any errors or misalignment in the structure which would prevent the proper setting of the elements shall be corrected by the Contractor before the erection is commenced. Erection shall be supervised and performed by workmen skilled in this type of Work. Each element shall be set in the proper position, carefully plumbed and anchored securely to the structural frame. Adjustments or changes in connections which could involve additional stresses in the products or connections shall not be permitted without approval of the Engineer. All bearing surfaces shall be true to line and grade. Erection tolerances shall be in accordance with MNL 116. All joints shall be uniform and straight.

### **3.03 Cleaning and Repairing**

After installation, precast elements shall be protected from all damage until final acceptance by the Engineer. Precast units with cracks, spalls, and other defects shall be subject to rejection. Units reviewed for repair shall be repaired to the satisfaction of the Engineer.

### **3.04 Alternative Design**

The Contractor may offer an alternative design for any precast element. Such design shall be comparable in terms of strength, deflection, finish and all other design criteria indicated. Complete drawings prepared and sealed by a civil or structural engineer registered in the State of Georgia where applicable shall be submitted to the Engineer for his review in accordance with specification Section 01340 of these Contract Documents. No alternative design will be permitted unless it has been specifically accepted in writing by the Engineer. If an alternative design is accepted, all expenses resulting therefrom shall be borne by the Contractor.

END OF SECTION

