



## DEPARTMENT OF PURCHASING & CONTRACT COMPLIANCE

Winner 2000- 2006 Achievement of Excellence in Procurement Award  
National Purchasing Institute

Jerome Noble, Director



December 22, 2006

Re: **07ITBBELLROADPHASE-1**  
**R002 Bell Road Reuse Water Main Extension Phase 1**

Dear Bidders:

Attached is one (1) copy of Addendum 2, hereby made a part of the above referenced Bid #07ITBBELLROADPHASE-1, R002 Bell Road Reuse Water Main Extension.

### **Corrections to Drawings:**

Sheet CD-01, modify AIR/VACUUM VALVE INSTALLATION DETAIL 5 per the attached sketch CD-01-1.

Sheet CD-01, modify BLOWOFF ASSEMBLY DETAIL 2 per the attached sketch CD-01-2.

After Sheet CD-02, delete (second copy of) Sheet C-03 and replace with Sheet CD-03 included with this addendum.

Except as provided herein, all terms and conditions in the Bid referenced above remain unchanged and in full force and effect.

### **Questions:**


1. Is OCIP required for this project?  
Answer – No, OCIP is not part of this contract.
2. Confirm that Stream Crossings will not be paid for separately.  
Answer – Correct.
3. Will an NPDES permit be required for this project?  
Answer – Yes, an NPDES permit will be required. See specification Section 01060 for Contractor requirements regarding permitting.

Also, as a reminder, the term for this contract is 120 calendar days from Notice to Proceed and the Bid number, Bid title and GA Utility License must appear on

**07ITBBELLROADPHASE-1, R002 Bell Road Reuse Water Main Extension**  
**Phase-1**  
**Addendum No. 2**  
**Page Two**

the front of the submitted sealed package addressed to the Department of Purchasing and Contract Compliance.

Sincerely,

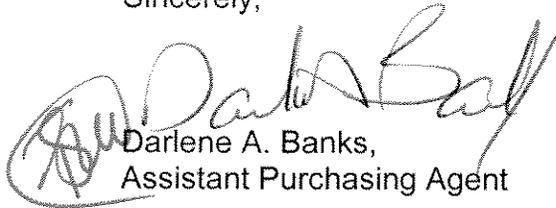

Darlene A. Banks,  
Assistant Purchasing Agent

This Addendum forms a part of the contract documents and modifies the original Bid documents as noted below:

See attached documents

**ACKNOWLEDGEMENT OF ADDENDUM NO. 2**

The undersigned proposer acknowledges receipt of this addendum by returning one (1) copy of this form with the proposal package to the Purchasing Department, Fulton County Public Safety Building, 130 Peachtree Street, Suite 1168, Atlanta, Georgia 30335 by the Bid due date and time on Thursday, January 11, 2007 at 11:00 A.M.



This is to acknowledge receipt of Addendum No. 2, \_\_\_\_\_ day of \_\_\_\_\_, 200\_\_.

\_\_\_\_\_  
Legal Name of Bidder

\_\_\_\_\_  
Signature of Authorized Representative

\_\_\_\_\_  
Title



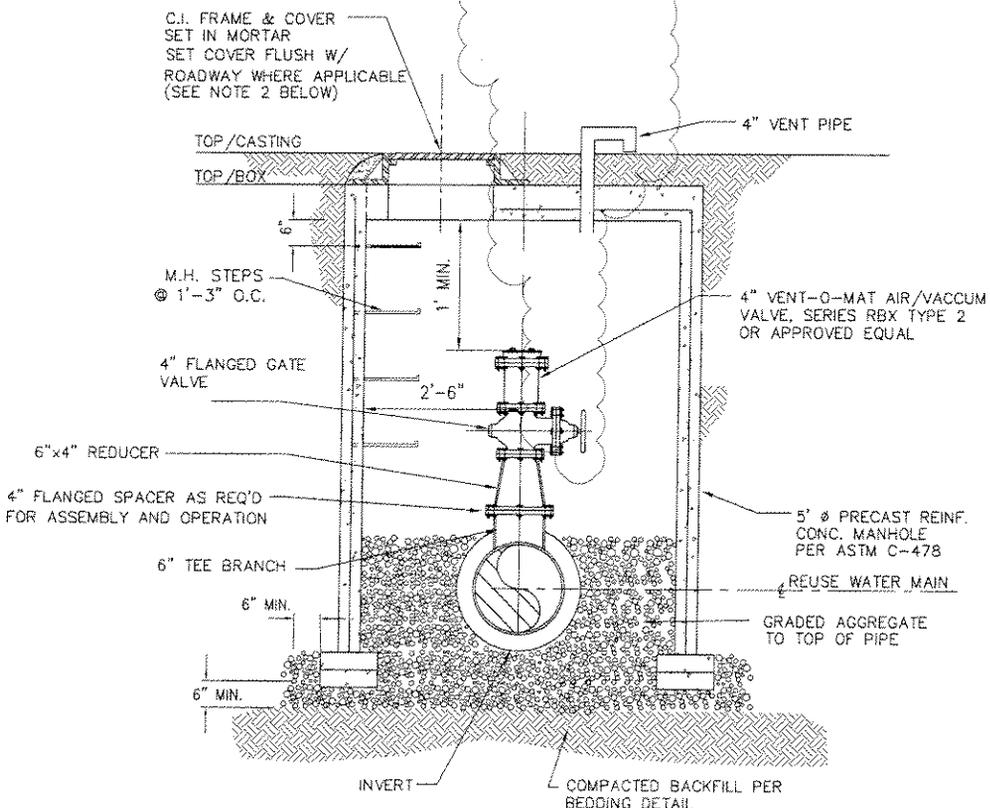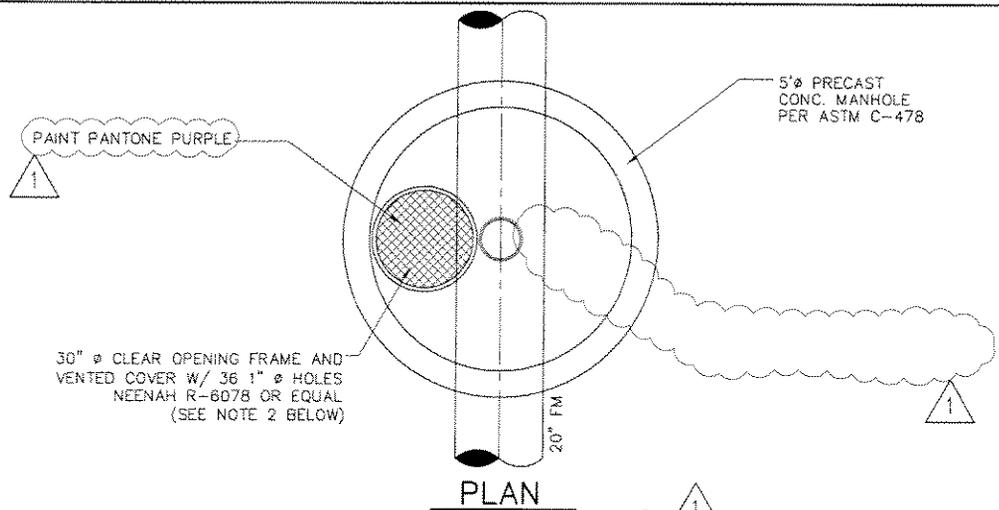

**PROFILE**

- NOTES:
1. JOINTS BETWEEN ALL MANHOLE SECTIONS SHALL BE SEALED WITH BUTYL SEALANT.
  2. PRECAST MANHOLE INCLUDING CONCRETE TOP, CAST IRON FRAME AND COVER SHALL BE DESIGNED AND FABRICATED TO WITHSTAND H-20 LOADING.

**AIR/VACUUM VALVE INSTALLATION DETAIL** 5

SCALE: N.T.S. C-02, C-03 | CD-01

**FULTON COUNTY DEPARTMENT OF PUBLIC WORKS**  
 141 PRYOR STREET, S.W. ~ SUITE 6001 ~ ATLANTA, GA 30303  
**PARSONS**  
 5390 Triangle Parkway, Suite 100,  
 Norcross, GA 30092, (770) 446-4900


**BELL ROAD REUSE WATER EXTENSION - PHASE I**

SKETCH NO.  
**CD-01-1**

NOTES:

1. GATE VALVE AND PIPING SHALL BE 6" UNLESS SHOWN OTHERWISE
2. PROVIDE RETAINER GLANDS FOR ALL MECHANICAL JOINT CONNECTIONS

1

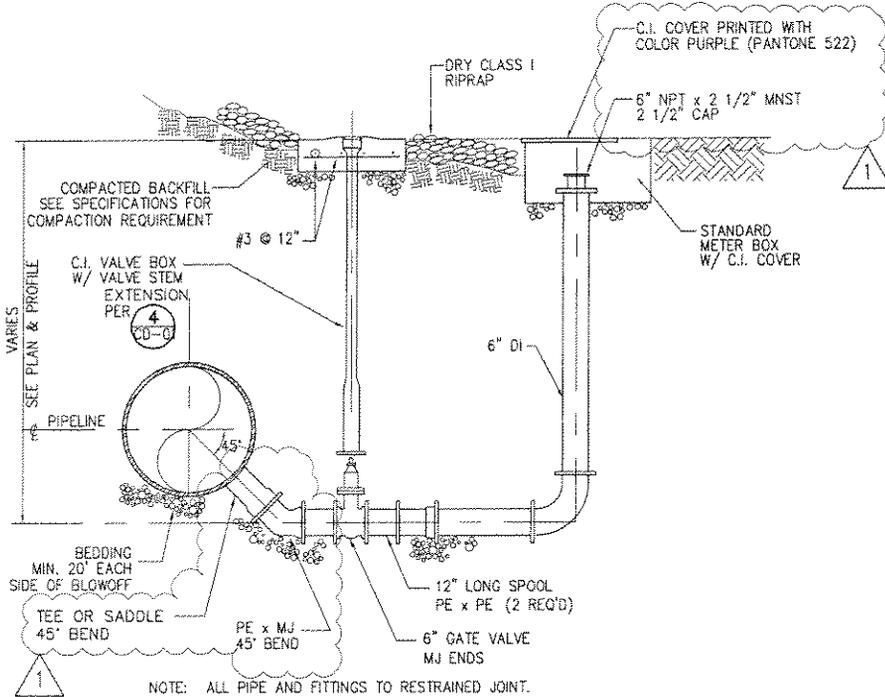

**BLOWOFF ASSEMBLY DETAIL**

NOT TO SCALE

2  
C-01 | CD-01



FULTON COUNTY DEPARTMENT OF PUBLIC WORKS  
141 PRYOR STREET, S.W. ~ SUITE 6001 ~ ATLANTA, GA 30303

**PARSONS**  
5390 Triangle Parkway, Suite 100,  
Norcross, GA 30092, (770) 446-4900

BELL ROAD REUSE WATER EXTENSION - PHASE I

SKETCH NO.

CD-01-2