


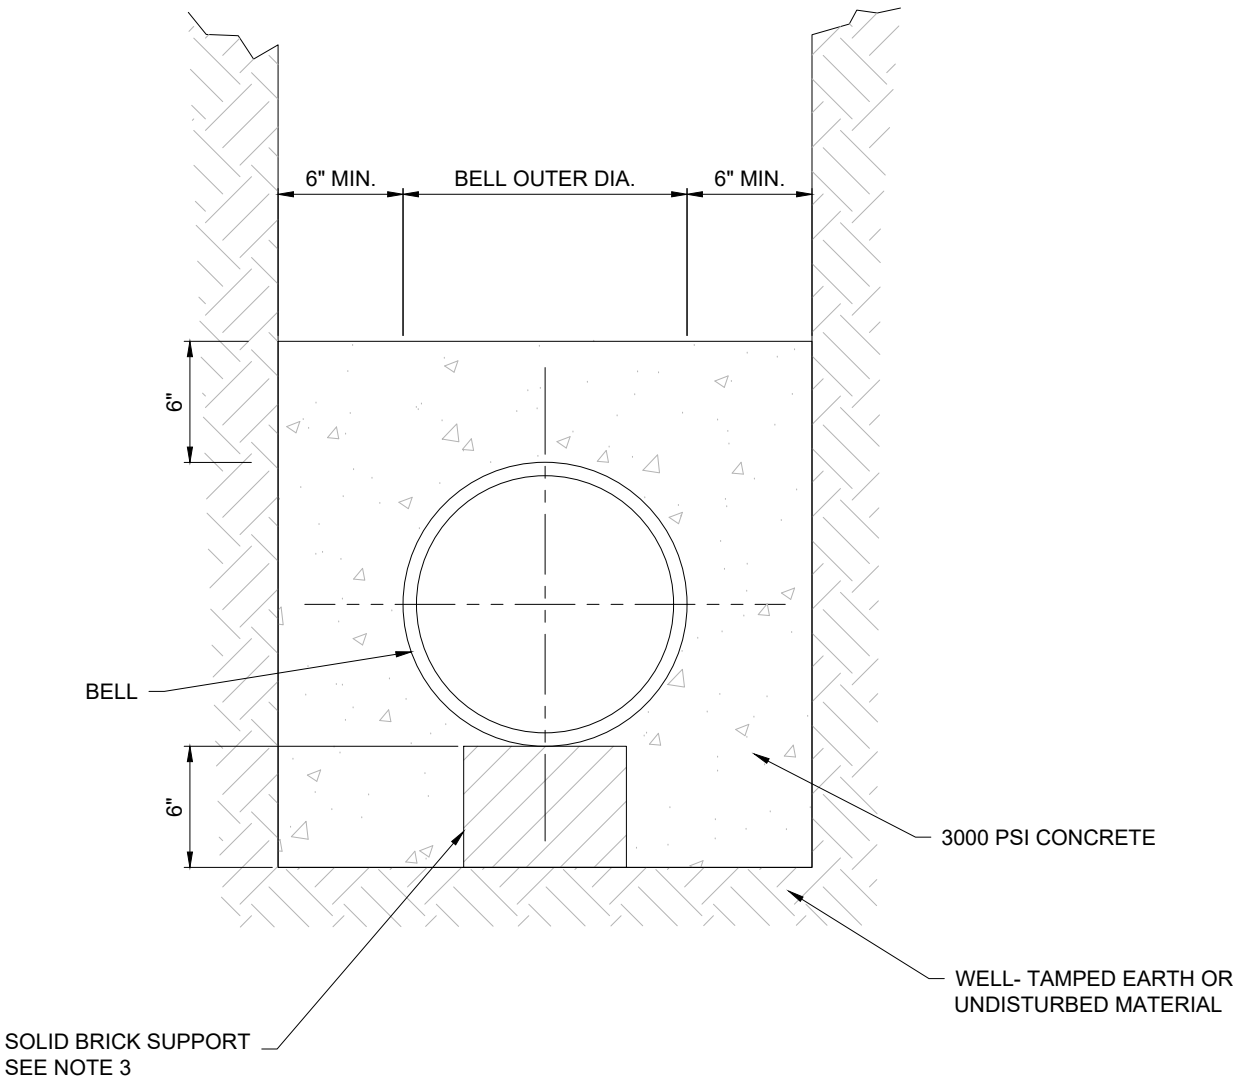

CONCRETE ENCASEMENT
NTS

- NOTES:**
- 1. CONCRETE ENCASEMENT SHALL BE USED WHEN COVER IS LESS THAN 4 FEET, AND WHERE CONDITIONS DIRECTED BY THE FULTON COUNTY ENGINEER
 - 2. ENCASEMENT TO BE PLACED AGAINST UNDISTURBED NATURAL GROUND OR FILL COMPACTED TO 90% RELATIVE COMPACTION, UNLESS OTHERWISE SPECIFIED.
 - 3. PROVIDE 3 SUPPORTS FOR EACH SECTION OF DIP, OR @ 5'-0" INTERVALS FOR HDPE AND PVC PIPES.

FULTON COUNTY STANDARD DETAIL 110
CONCRETE ENCASEMENT

DATE	REVISIONS	DATE	REVISIONS

DGS/DRN/CHKD: MB/EB/ML
APPROVED: TM
DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.
110