


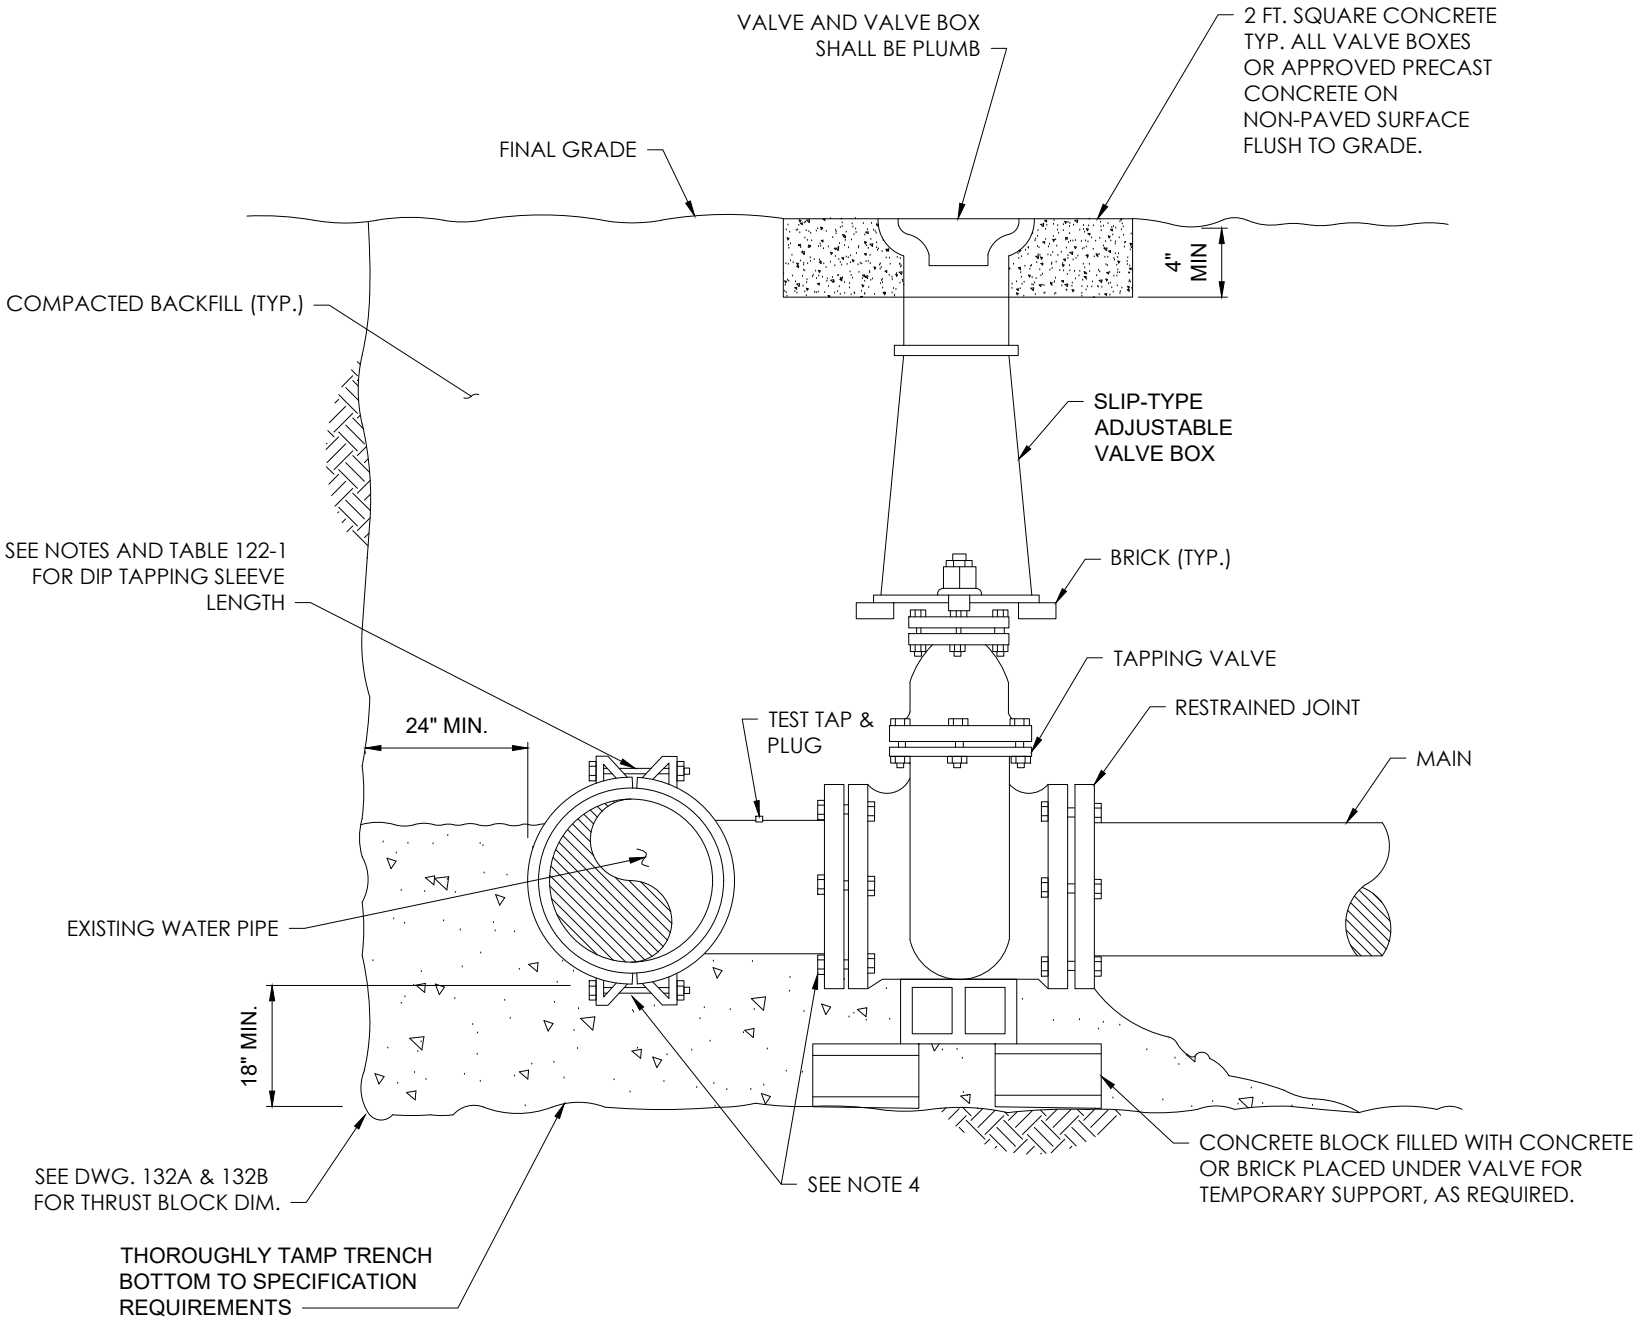

- NOTES:**
1. ALL TAPPING SLEEVES AND VALVES SHALL BE HYDROSTATICALLY TESTED PRIOR TO TAP.
 2. TEMPORARILY SUPPORT TAPPING SLEEVE AND VALVE PRIOR TO HYDROSTATIC TESTING; UPON ACCEPTANCE OF TEST, POUR INDICATED PERMANENT CONCRETE BLOCK AND SUPPORT PAD.
 3. MAKE TAP, LINE EXTENSION AND BACKFILL.
 4. COVER GLANDS AND BOLTS WITH HEAVY POLYETHYLENE SHEETING TO KEEP CONCRETE FROM BONDING. TYPICAL WHENEVER BOLTS OR GLANDS MAY BE "WRAPPED-UP" IN CONCRETE.
 5. COAT TAPPING SLEEVE AND BOLTS WITH AN APPROVED BITUMASTIC COATING BEFORE POURING CONCRETE. TYPICAL FOR ALL STEEL INCLUDING RODS, COUPLINGS, STRAPS, AND OTHER BURIED STEEL. SEE NOTE 4, DETAIL 127 FOR COATING.
 6. WORKMEN INSTALLING TAPPING SLEEVE AND VALVE SHALL FOLLOW MANUFACTURER'S INSTALLATION PROCEDURES AND THE REQUIREMENTS OF FULTON COUNTY ENGINEER'S OFFICE.

TABLE 122-1 MAXIMUM TAPPING SLEEVE LENGTH	
MAIN & TAP (IN. NOMINAL)	LENGTH ALONG RUN (IN.)
6x2, 6x3, 6x4, 6x6	18
8x2, 8x3, 8x4, 8x6	19
8x8	21
10x2, 10x3, 10x4, 10x6	19
10x8, 10x10	23
12x2, 12x3, 12x5, 12x6	19
12x8	21
12x10, 12x12	25

FULTON COUNTY STANDARD DETAIL 122

TAPPING SLEEVE AND VALVE
INSTALLATION DETAILS

DATE	REVISIONS	DATE	REVISIONS

DGS/DRN/CHKD: MB/EB/ML
APPROVED: TM
DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.

122