


502 - Catch Basin Double Wing One Foot Offset.dwg March 17, 2026 - 3:10pm

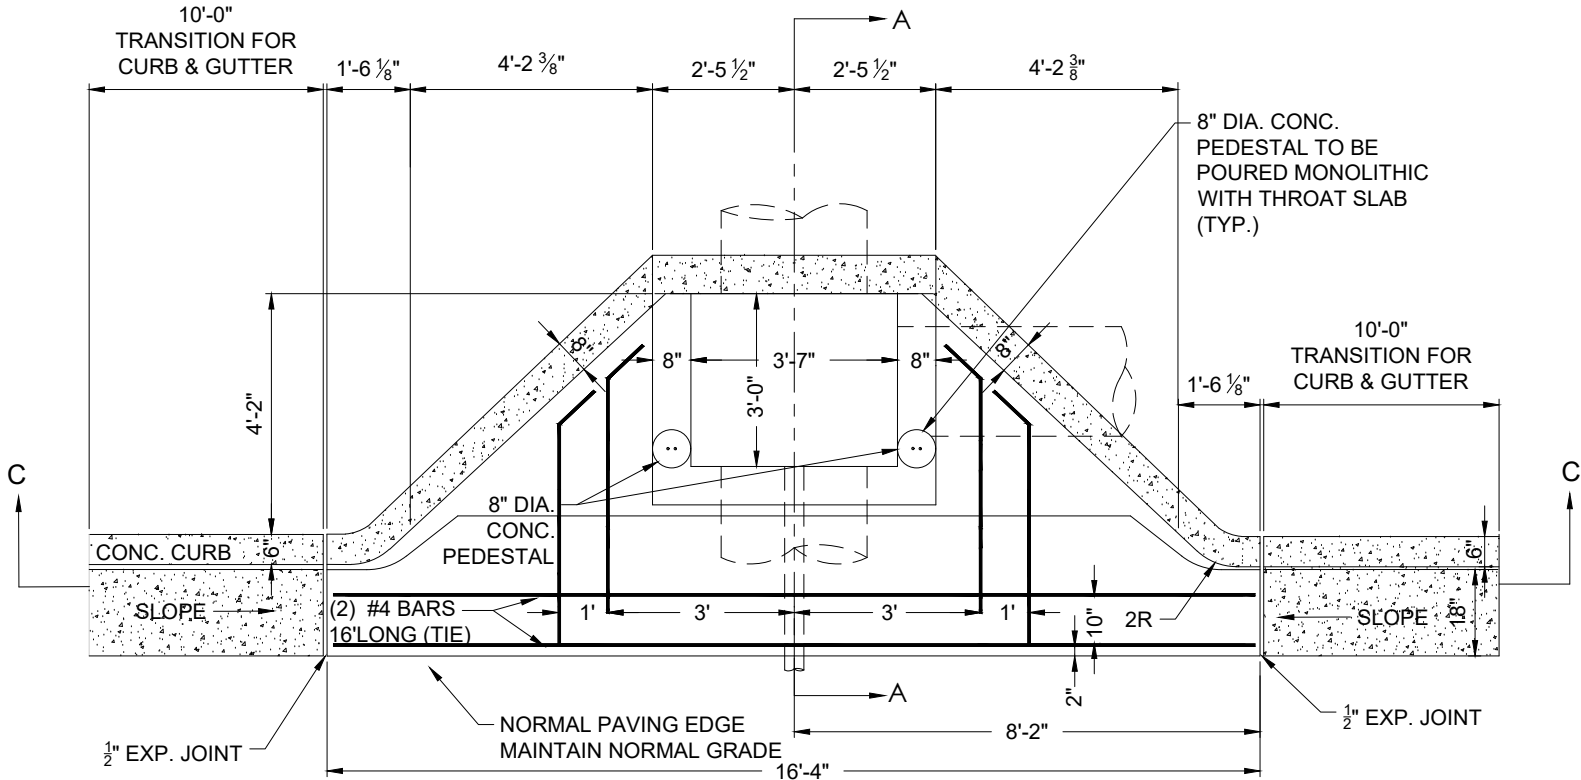

TOP OMITTED FOR CLARITY



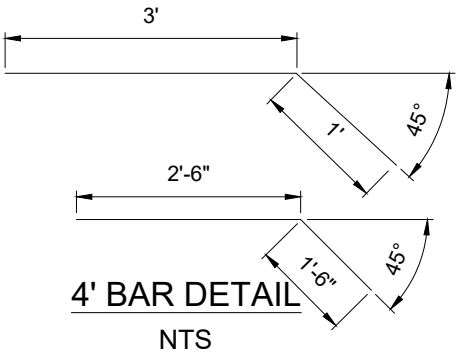


TABLE 502-1	
INSIDE DIAMETER OF PIPE (IN.)	MINIMUM "H"
12-18	4' - 10"
24	5' - 6"
30	6' - 2"

NOTES:

1. CONCRETE STRENGTH TEST REQUIRED FOR ALL POURED IN PLACE CONCRETE.
2. FOR ALL CATCH BASINS, $\frac{1}{2}$ " EXPANSION JOINT MATERIAL SHALL BE PLACED AROUND THE CATCH BASIN WHERE SIDEWALK OR MEDIAN PAVEMENT IS PLACED ADJACENT TO THE CATCH BASIN.
3. IN ANY SUBDIVISION, THE OPTION IS TO USE EITHER ALL ONLINE CATCH BASINS OR ALL ONE FOOT OFFSET CATCH BASINS.
4. ONE FOOT OFFSET REQUIRED IN ALL CUL-DE-SACS.
5. PLASTIC COATED STEEL STEPS ARE REQUIRED IN ALL CATCH BASINS.
6. SEE STANDARD DWG. 513 FOR STAIR DETAIL.
7. ALL POURED-IN-PLACE CONC. TO BE CLASS "A" 3000 P.S.I.

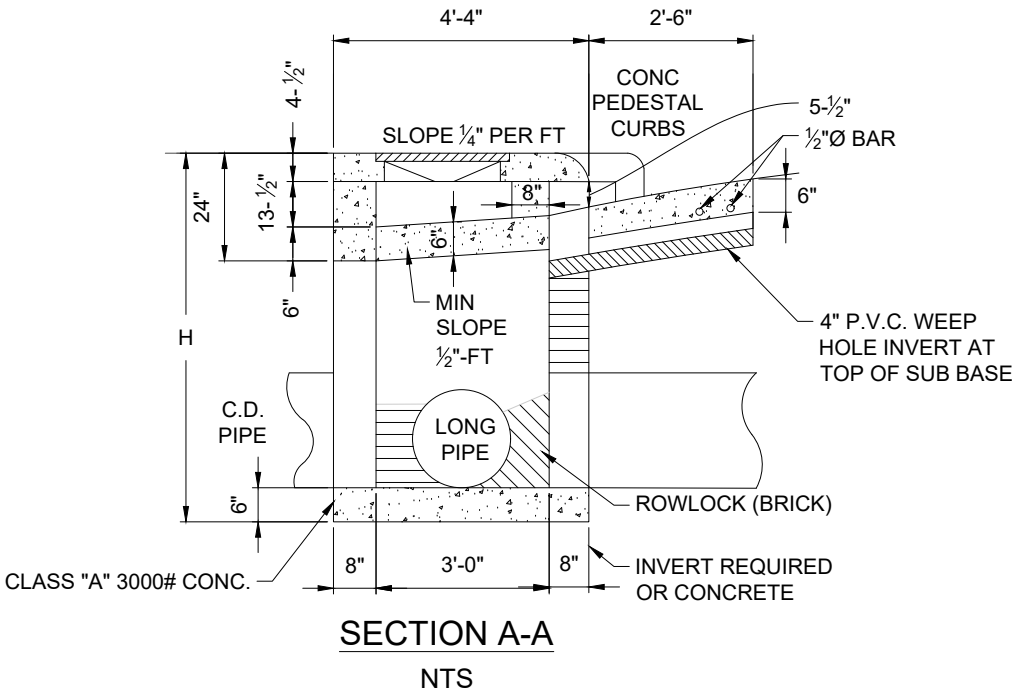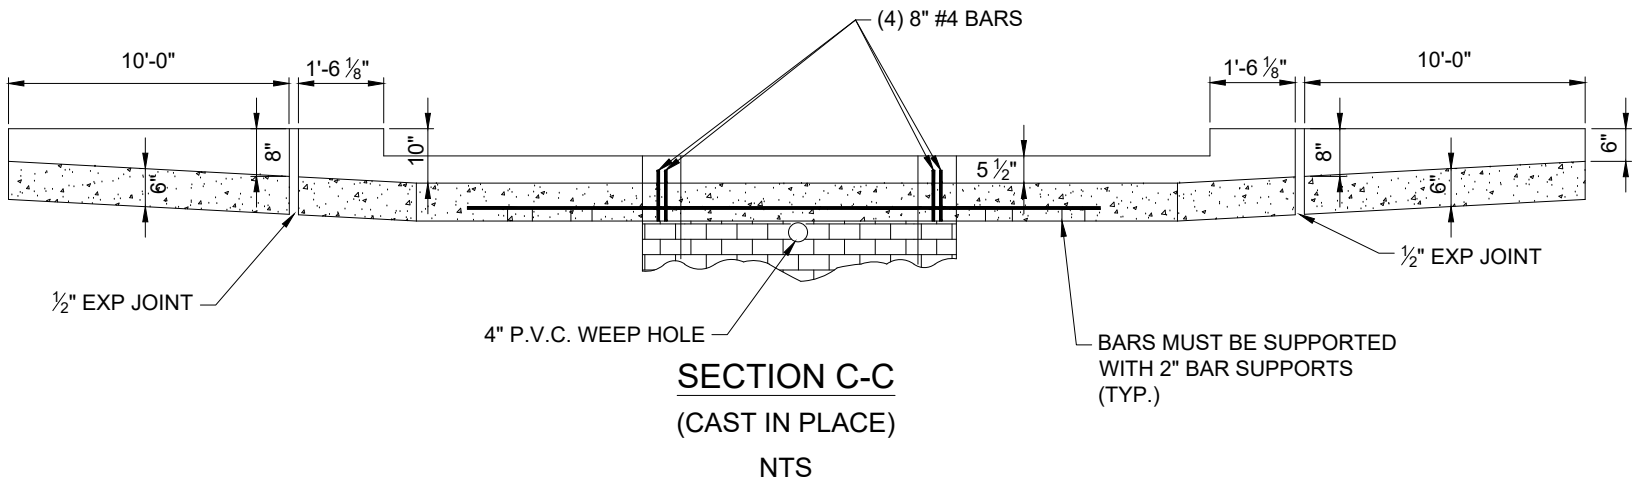

FULTON COUNTY STANDARD DETAIL 502

CATCH BASIN DOUBLEWING
ONE FOOT OFFSET (FACE OF CURB)

DATE	REVISIONS	DATE	REVISIONS

DGS/DRN/CHKD: MB/EB/ML
APPROVED: TM
DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.

502