

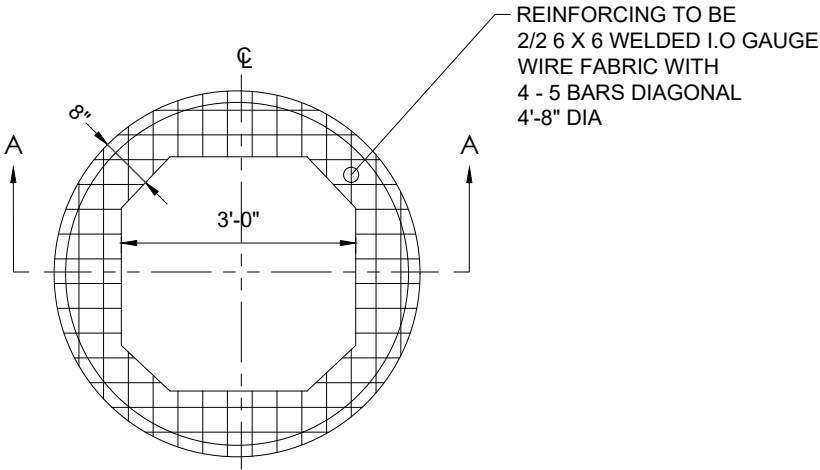
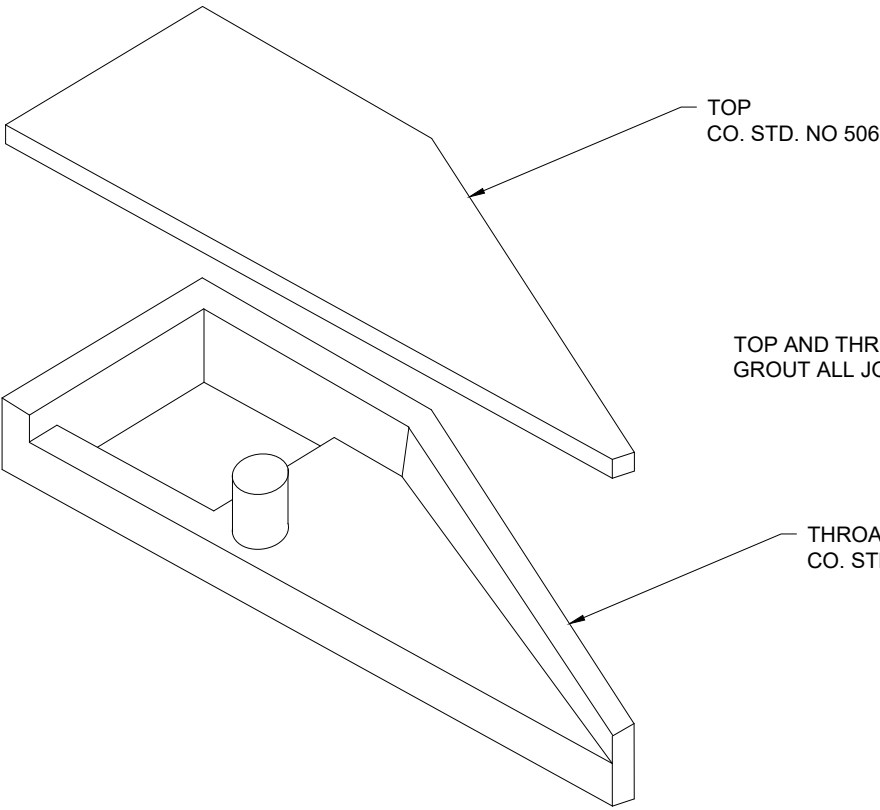
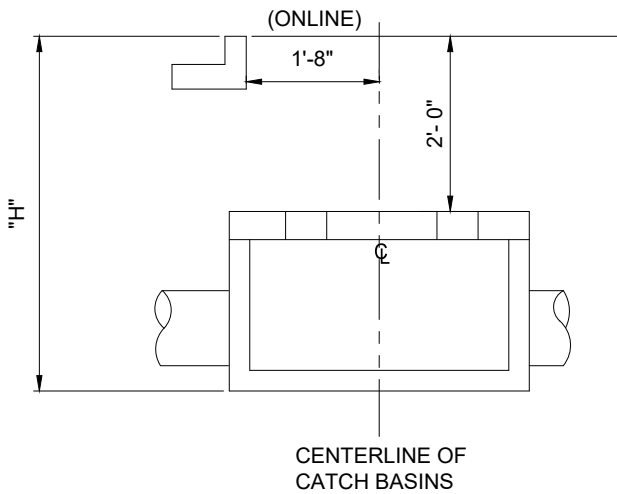


NOTES:


1. CATCH BASIN SHALL BE INSTALLED WITH PIPE OPENING AS SPECIFIED.
2. STEPS TO BE INSTALLED ON 15" VERTICAL SPACING.
3. SEE PRECAST MANHOLE STANDARD FOR SPECIFICATIONS.
4. ALL CONCRETE SHALL BE 4,000 PSI.
5. FOR ROLLED CURB & GUTTER, SEE STD. NO. 503-B FOR BOX LOCATION.

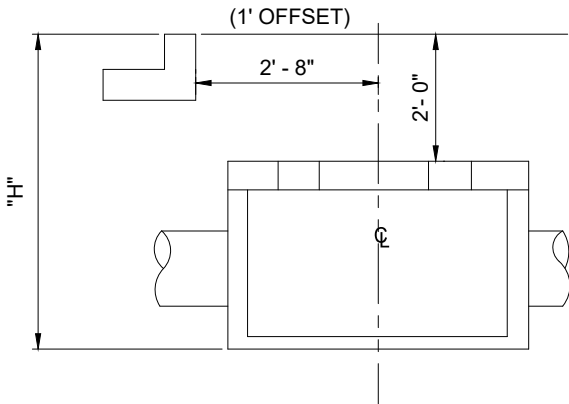


ROUND TO SQUARE ADAPTER

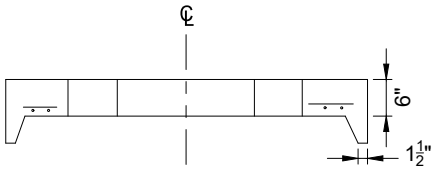

SECTION A-A

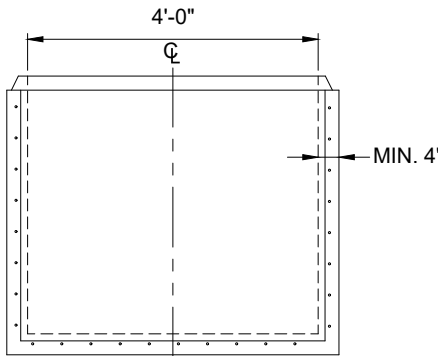

REINFORCING TO BE 3/3
6 X 8 WELDED WIRE FABRIC

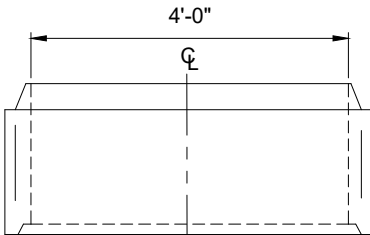


REINFORCING TO BE 2/2
6 X 6 WELDED WIRE FABRIC

RISER

TABLE 507 - 1			
BASE HEIGHT	METAL PIPE	CONC. PIPE	*H (MIN.)
4' DIA - 2' - 6"	18"	12"	5" - 0"
3' - 0"	24"	18"	5" - 6"
3' - 6"	30"	24"	6" - 0"
4' - 0"		30"	6' - 6"

*OTHERWISE BOX MUST BE BUILT OUT OF BRICK

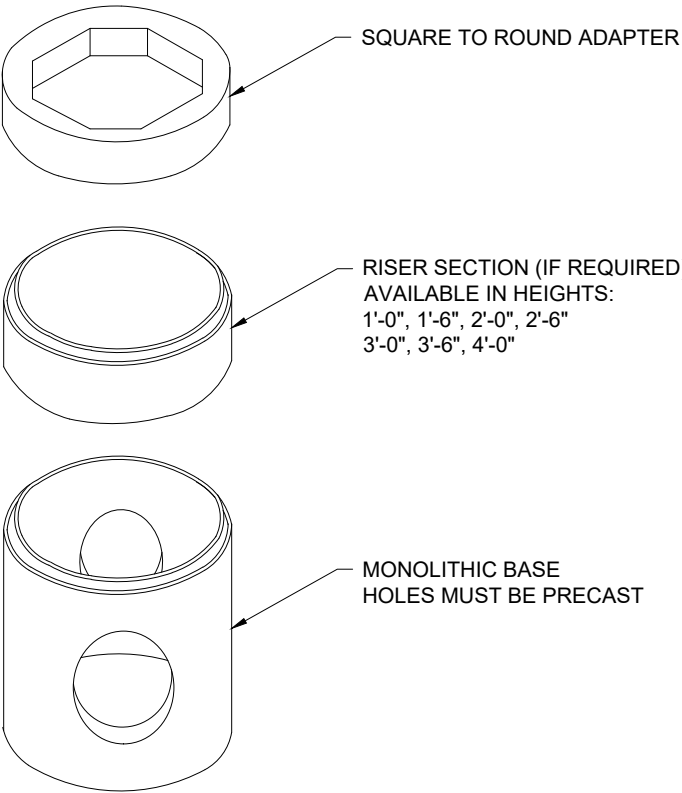

FULTON COUNTY STANDARD DETAIL 507
STANDARD PRECAST ROUND CATCH BASINS

DATE	REVISIONS	DATE	REVISIONS

DGS/DRN/CHKD: MB/EB/ML
APPROVED: TM
DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.

507