




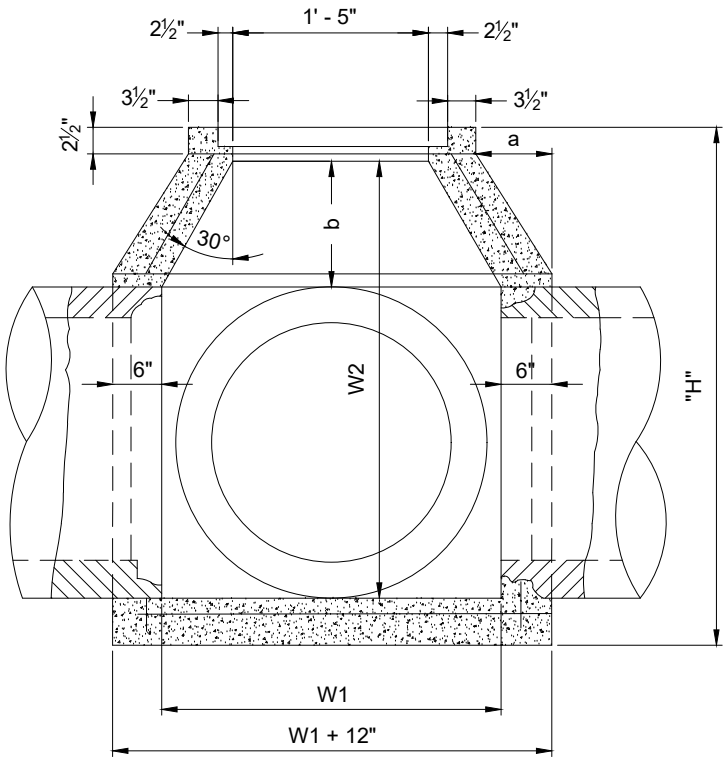


SECTION A-A

TYPE A

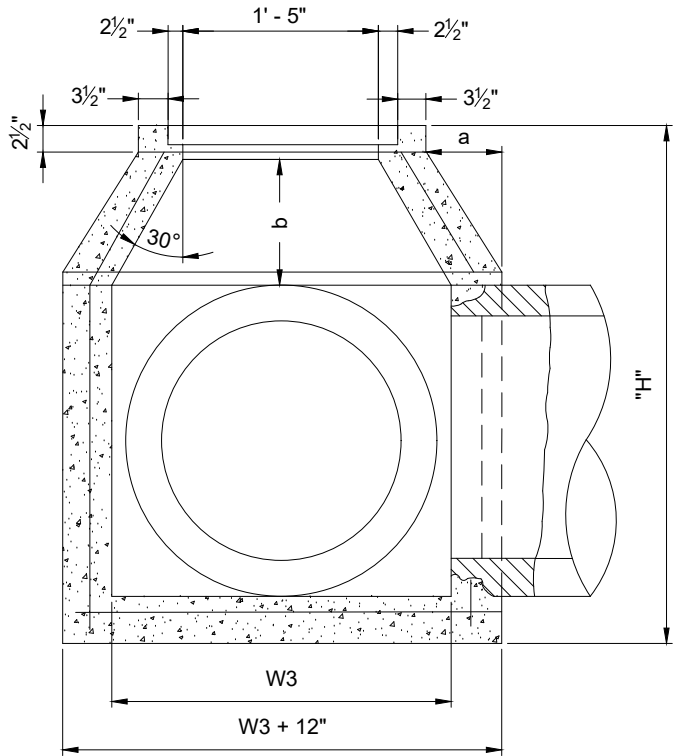


SECTION B-B

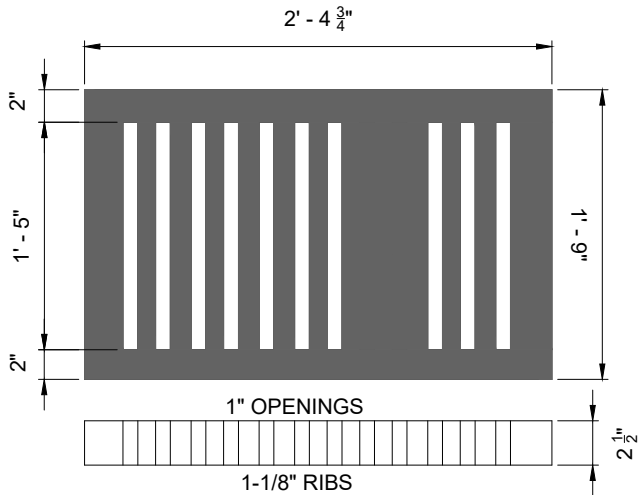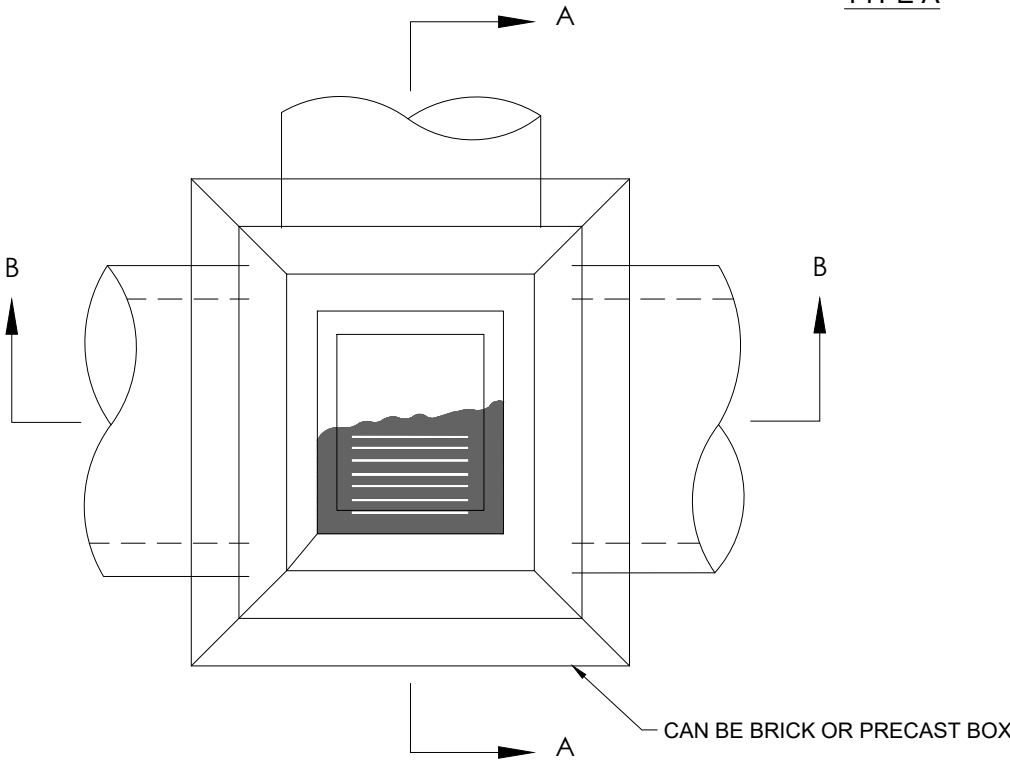


DETAIL OF CAST IRON GRATING
APPROX. WT. 200 LB.

NOTES:

1. ROWLOCK BRICK INVERTS REQUIRED AT ALL JUNCTION BOXES & DROP INLETS. CONCRETE INVERT IS ALLOWED.
2. IN ALL DROP INLETS, 1/2" DIA. BAR REINFORCING STEEL TO BE PLACED NOT MORE THAN 12" CENTER LINE AND COVERED NOT LESS THAN 2".

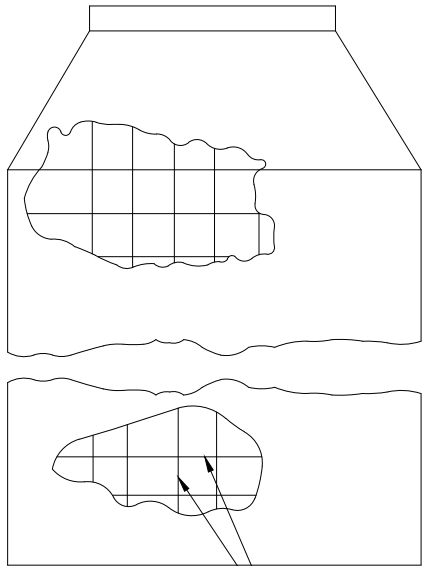

HOR. REINF. STEEL AT 6" C TO C
VERT. REINF. STEEL AT 12" C TO C

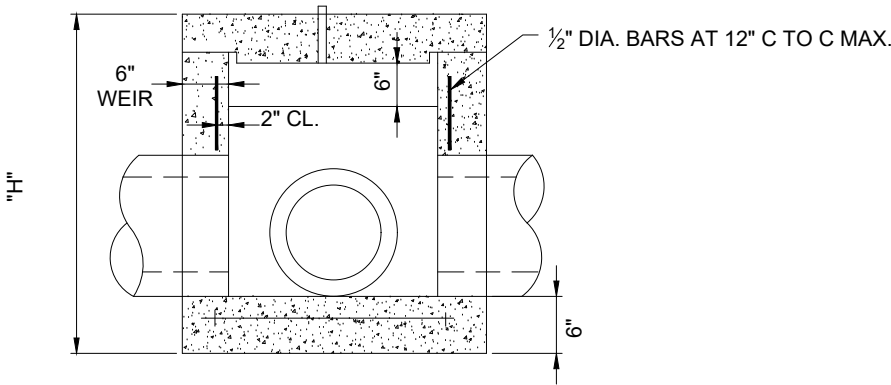

TYPE B
SEE SHEET NO. 511 FOR DIMENSIONS

FULTON COUNTY STANDARD DETAIL 510

DROP INLETS, CONCRETE
DETAILS FOR PAVED SECTIONS ONLY

DATE	REVISIONS	DATE	REVISIONS

DGS/DRN/CHKD: MB/EB/ML
APPROVED: TM
DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.

510