


- NOTES:
- 1. ALL FITTINGS TO BE BRASS MEETING AWWA C800 AND ASTM B62.

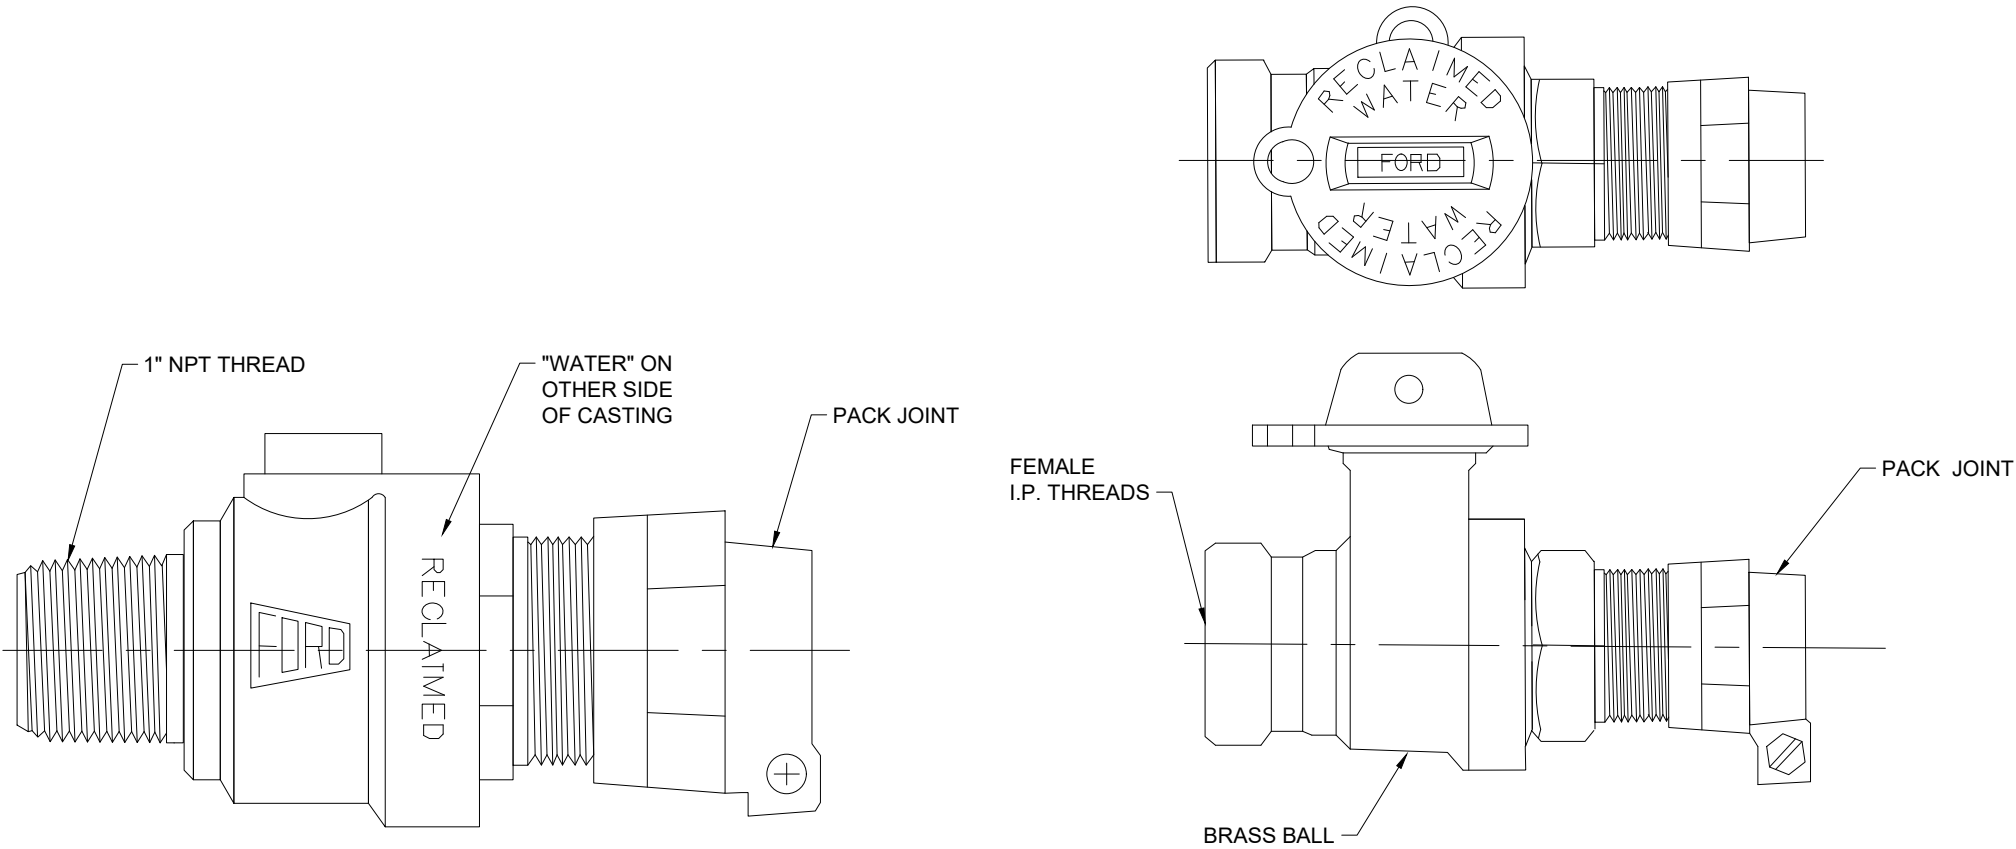

FULTON COUNTY STANDARD DETAIL 606

BRASS FITTINGS FOR  
METER INSTALLATION ON NPRL

| DATE | REVISIONS | DATE | REVISIONS |
|------|-----------|------|-----------|
|      |           |      |           |
|      |           |      |           |
|      |           |      |           |
|      |           |      |           |
|      |           |      |           |
|      |           |      |           |

DGS/DRN/CHKD: MB/EB/ML  
APPROVED: TM  
DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS  
141 PRYOR ST. ATLANTA, GA. 30303  
404-612-7400 FAX: 404-224-0498

DRAWING NO.  
  
606