



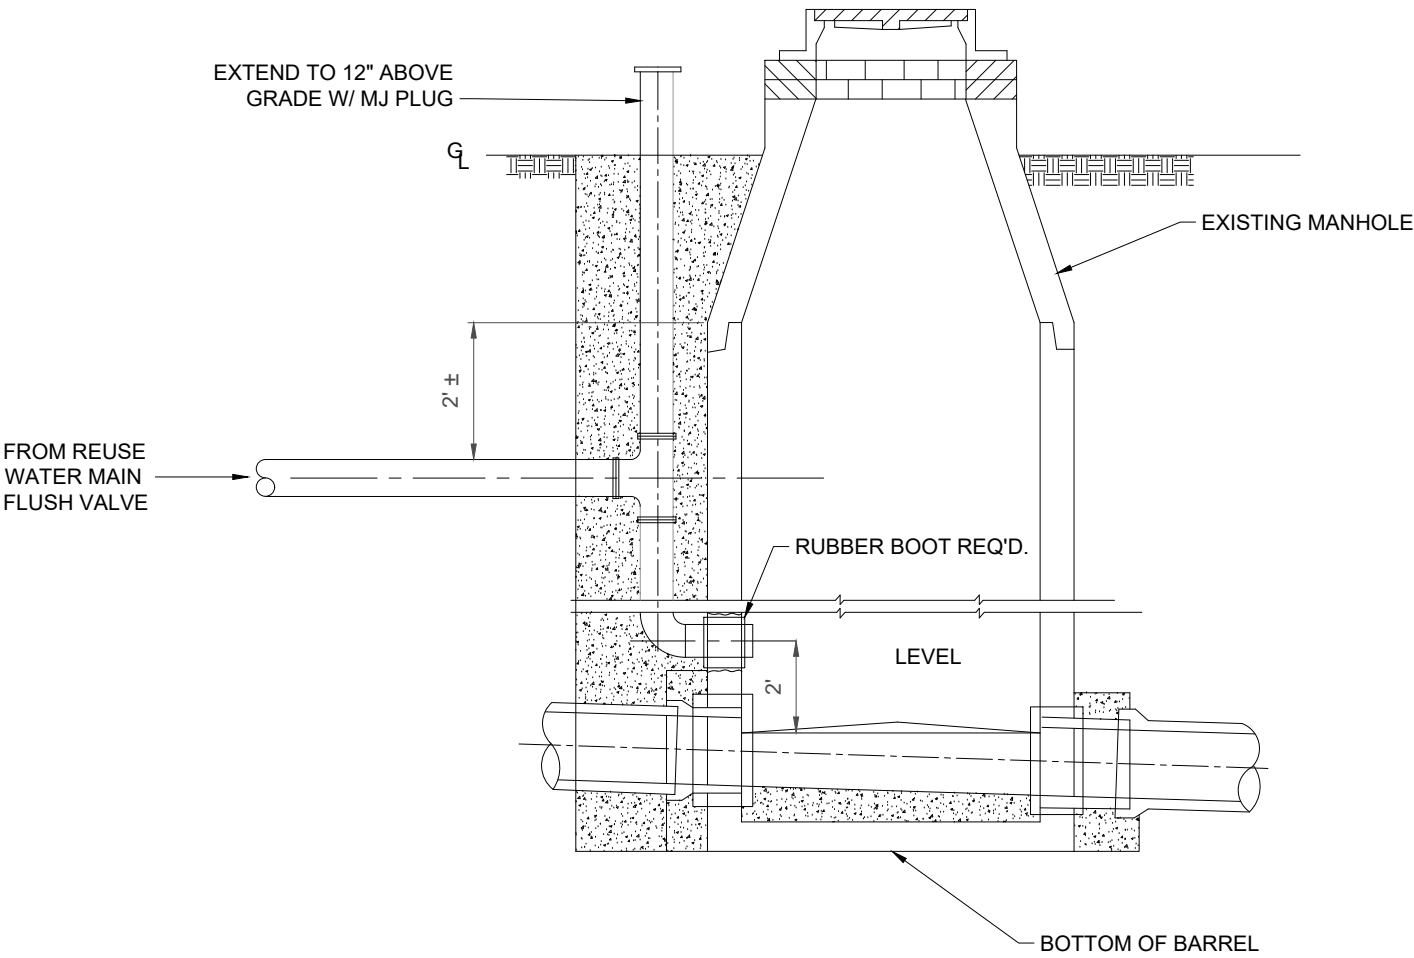

MANHOLE CONNECTION DETAIL

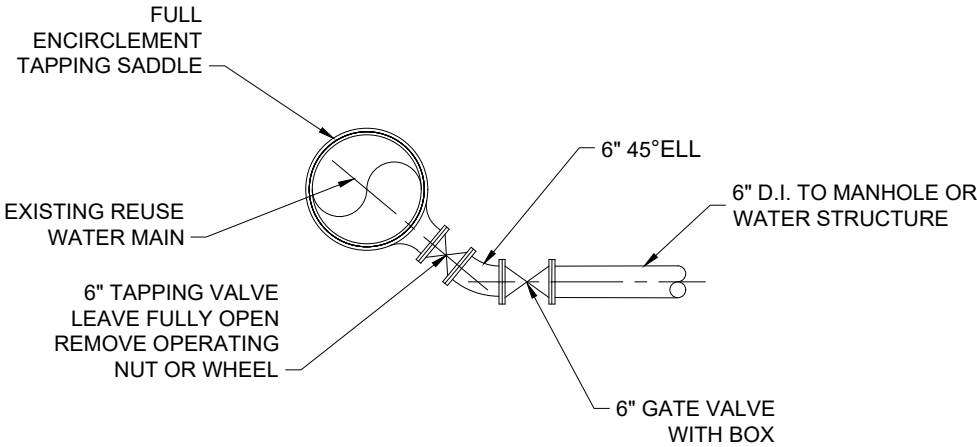

REUSE TAP AND VALVE DETAIL

FULTON COUNTY STANDARD DETAIL 613
IN-LINE FLUSH POINT DETAIL

DATE	REVISIONS	DATE	REVISIONS

DGS/DRN/CHKD: MB/EB/ML
APPROVED: TM
DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.
613

613 - In-Line Flush Point Detail.dwg March 17, 2026 - 3:28pm