


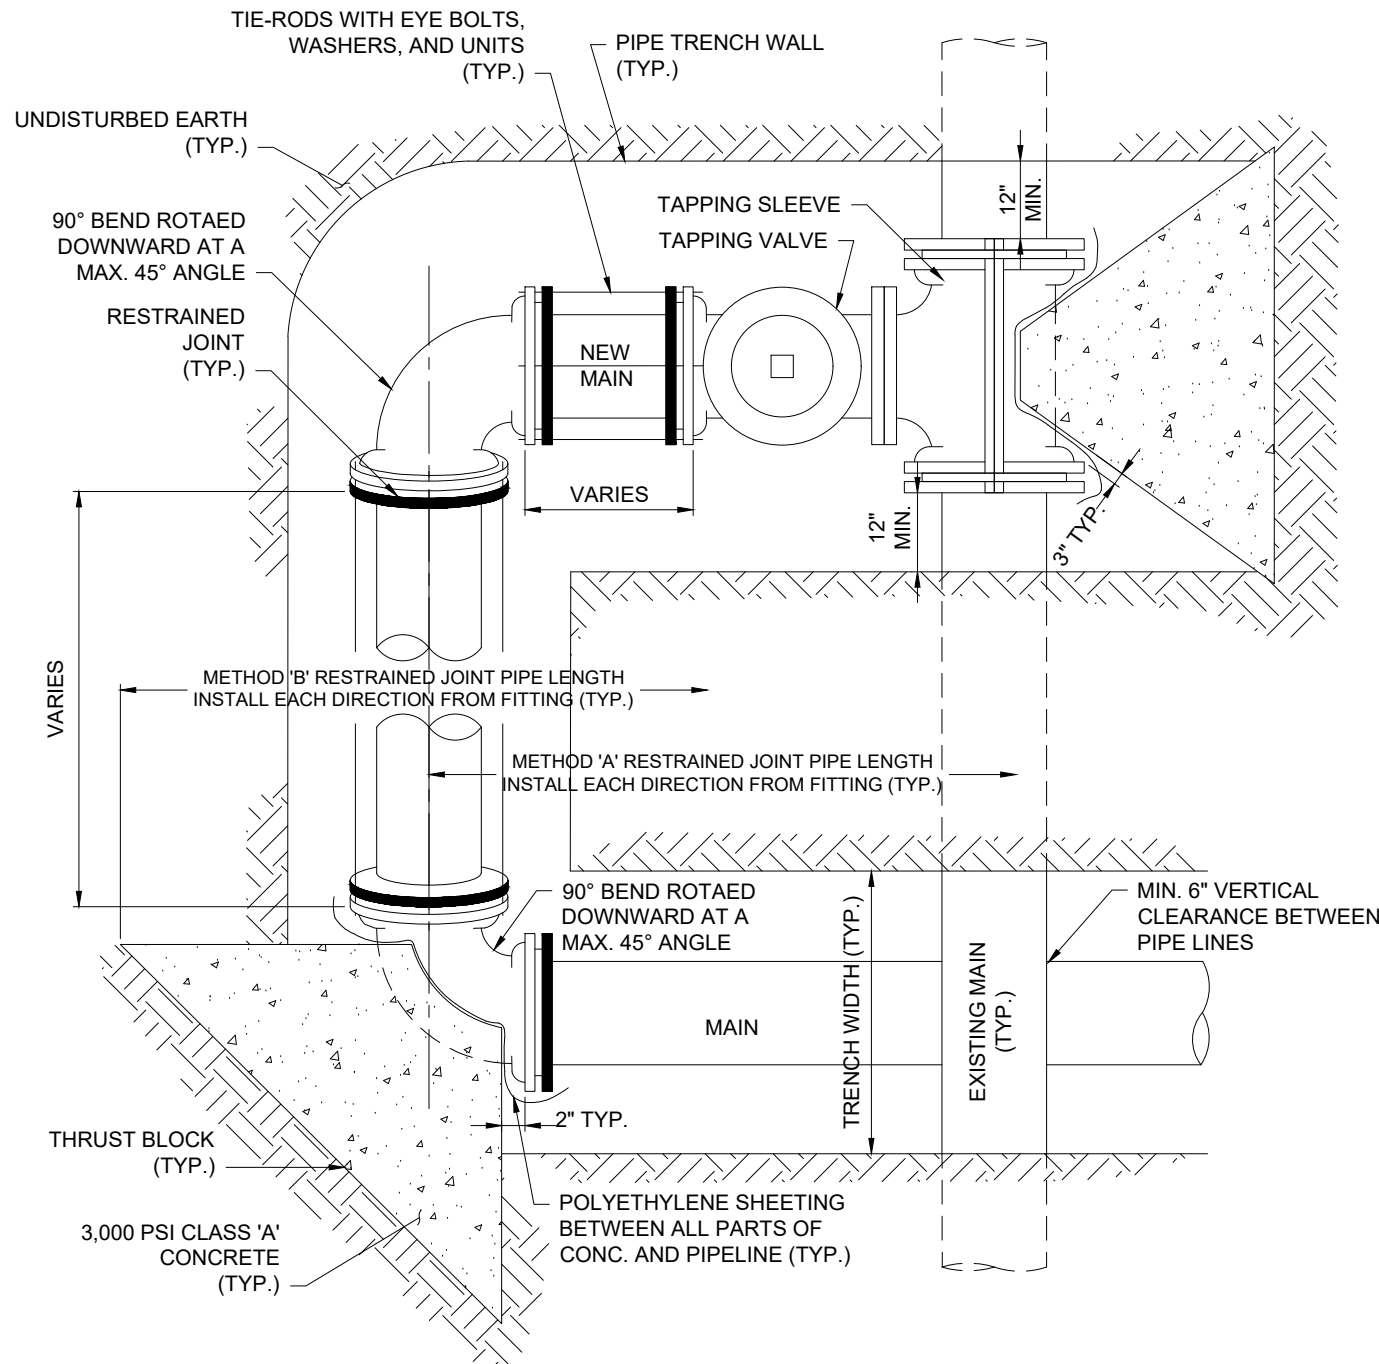

PLAN
N.T.S.

NOTES:

1. REFER TO TYPICAL HORIZONTAL THRUST BLOCK DRAWINGS FOR ADDITIONAL DETAILS.
2. REFER TO TYPICAL TAPPING SLEEVE AND VALVE INSTALLATION DRAWING FOR ADDITIONAL DETAILS.
3. RESTRAINED JOINT PIPE MAY BE USED IN LIEU OF THRUST BLOCKING AND TIE-RODS INDICATED, AS APPLICABLE.
4. RESTRAINED JOINT METHOD 'A': RESTRAINT JOINT PIPE AND FITTINGS.
5. RESTRAINED JOINT METHOD 'B': ONE (1) OF THE FOLLOWING DUAL (2) INDEPENDENT RESTRAINTS:
 - A. MEGA-LUGS PLUS THRUST BLOCKING.
 - B. MEGA-LUGS PLUS RODDING.

FULTON COUNTY STANDARD DETAIL 615
ROUND CONNECTION DETAIL

DATE	REVISIONS	DATE	REVISIONS

DGS/DRN/CHKD: MB/EB/ML
APPROVED: TM
DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.
615