



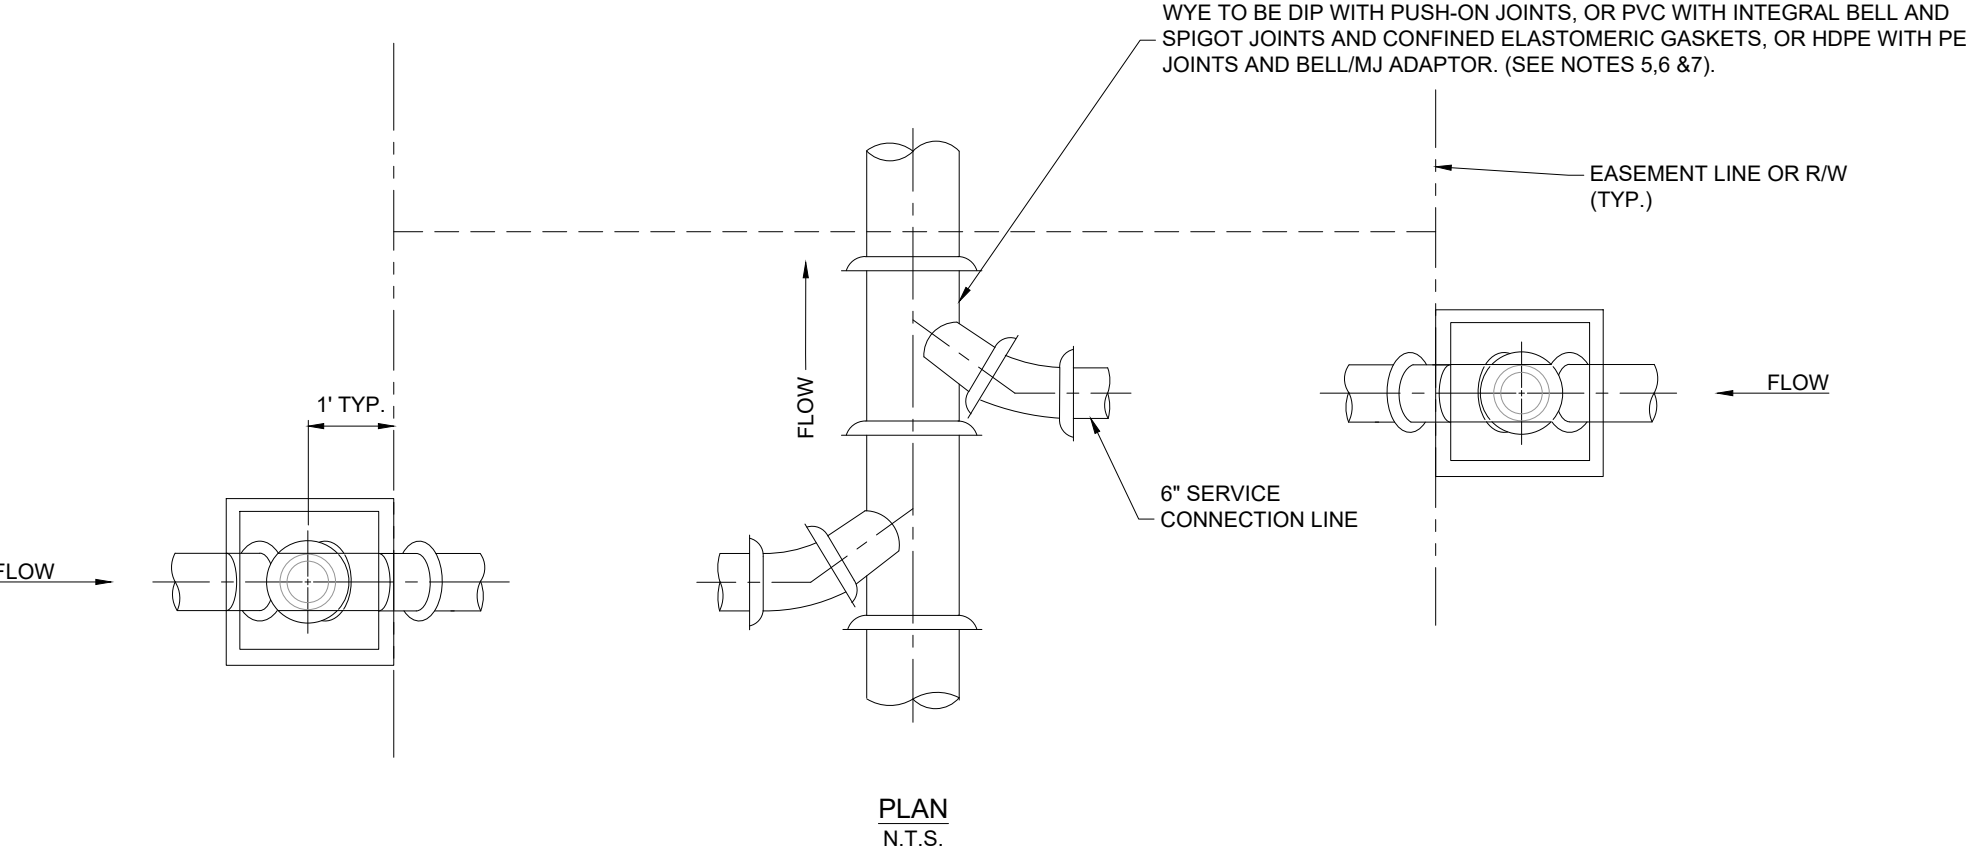

- NOTES:
- 1. CONNECTIONS TO NEW SEWER SHALL BE WITH A WYE.
 - 2. NO TEES WILL BE ALLOWED.
 - 3. NO WYE CONNECTION WILL BE ALLOWED ON EXISTING SEWERS LARGER THAN 12". LATERALS MAY ONLY BE CONNECTED AT AN EXISTING OR NEW MANHOLE.
 - 4. ALL CONNECTIONS TO EXISTING SEWERS SHALL BE MADE WITH A WYE.
 - 5. WHERE SERVICE LINE CROSSES STATE HWY R/W, DI PIPE AND FITTINGS SHALL BE MJ JOINTS, HDPE PIPE AND FITTINGS SHALL BE PROVIDED WITH BELL/MJ ADAPTOR JOINED TO THE PLAIN END BY BUTT FUSION. TRENCHES SHALL BE BACKFILLED WITH CRUSHED STONE.
 - 6. HDPE SERVICE LINE CROSSING STATE HWY R/W SHALL BE ENCASED IN STEEL CASING. REFER TO STANDARD DETAIL 107 FOR STEEL CASING REQUIREMENTS.
 - 7. THE USE OF PVC IS ONLY ALLOWED IN LANSCAPE AREA.
 - 8. DIP ONLY ALLOW AS AUTHORIZED BY FULTON COUNTY FOR LATERAL WITHIN PAVEMENT ON A CASE BY CASE BASIS.

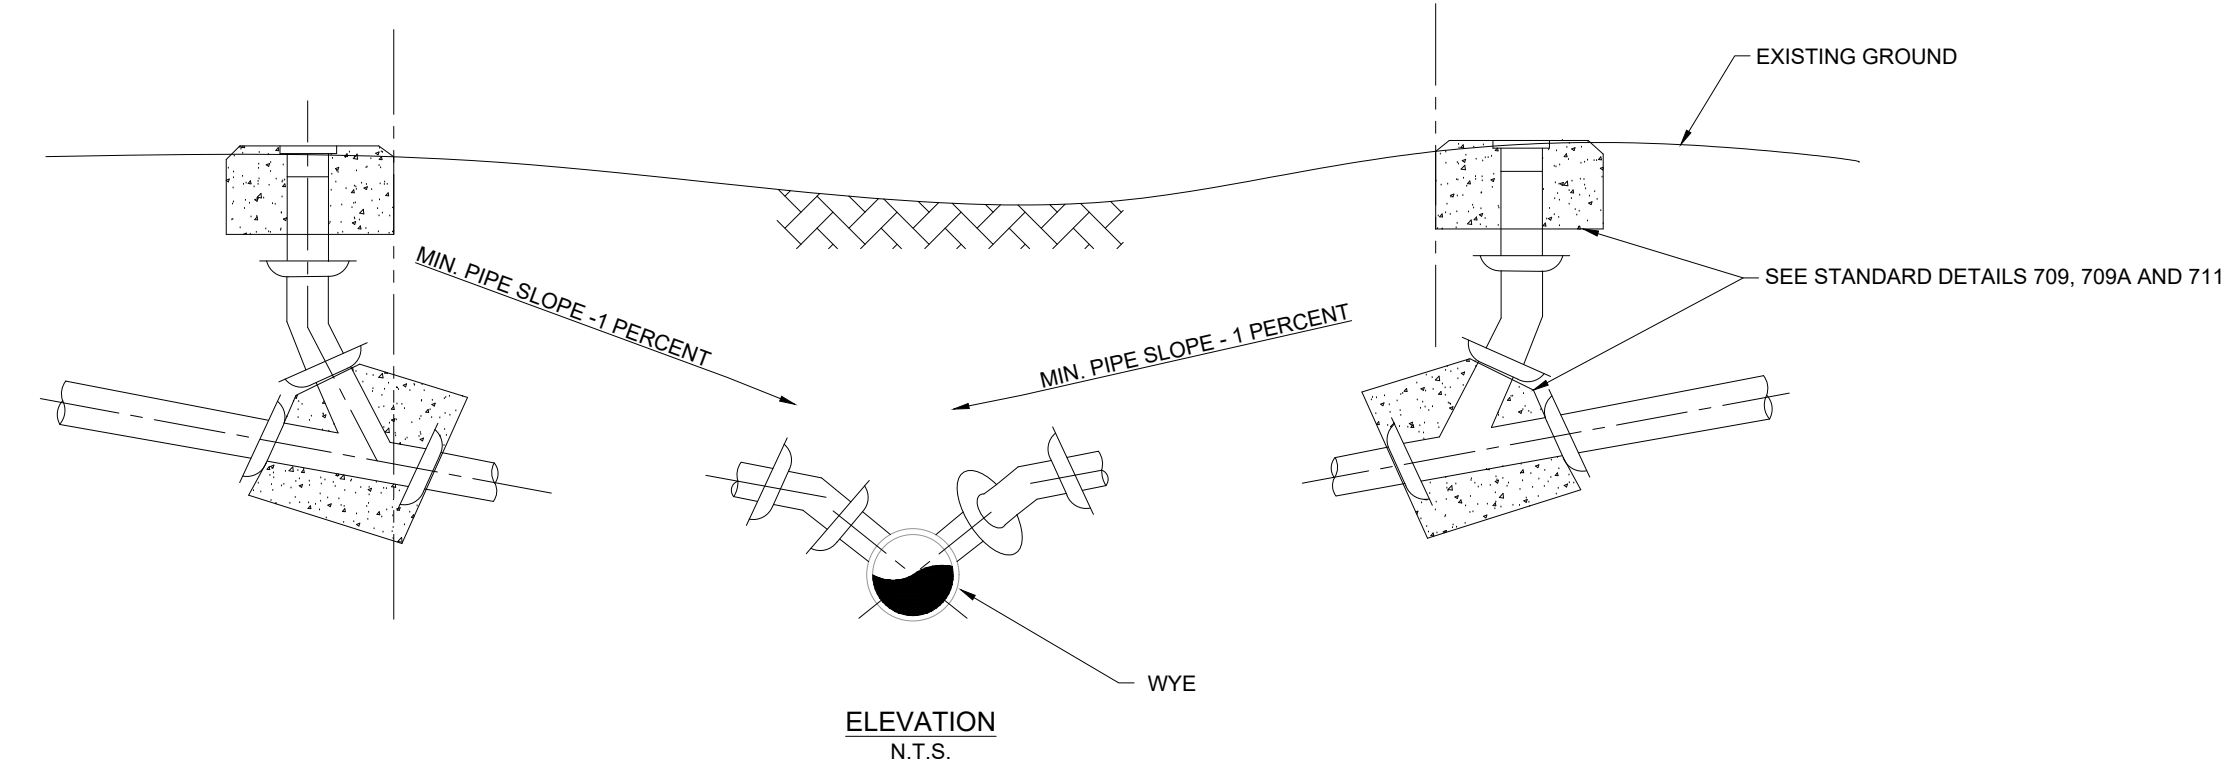

FULTON COUNTY STANDARD DETAIL 707

SEWER SERVICE CONNECTION TO
NEW AND EXISTING SANITARY SEWER

DATE	REVISIONS	DATE	REVISIONS

DGS/DRN/CHKD: MB/EB/ML

APPROVED: TM

DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS

141 PRYOR ST. ATLANTA, GA. 30303

404-612-7400 FAX: 404-224-0498

DRAWING NO.

707