

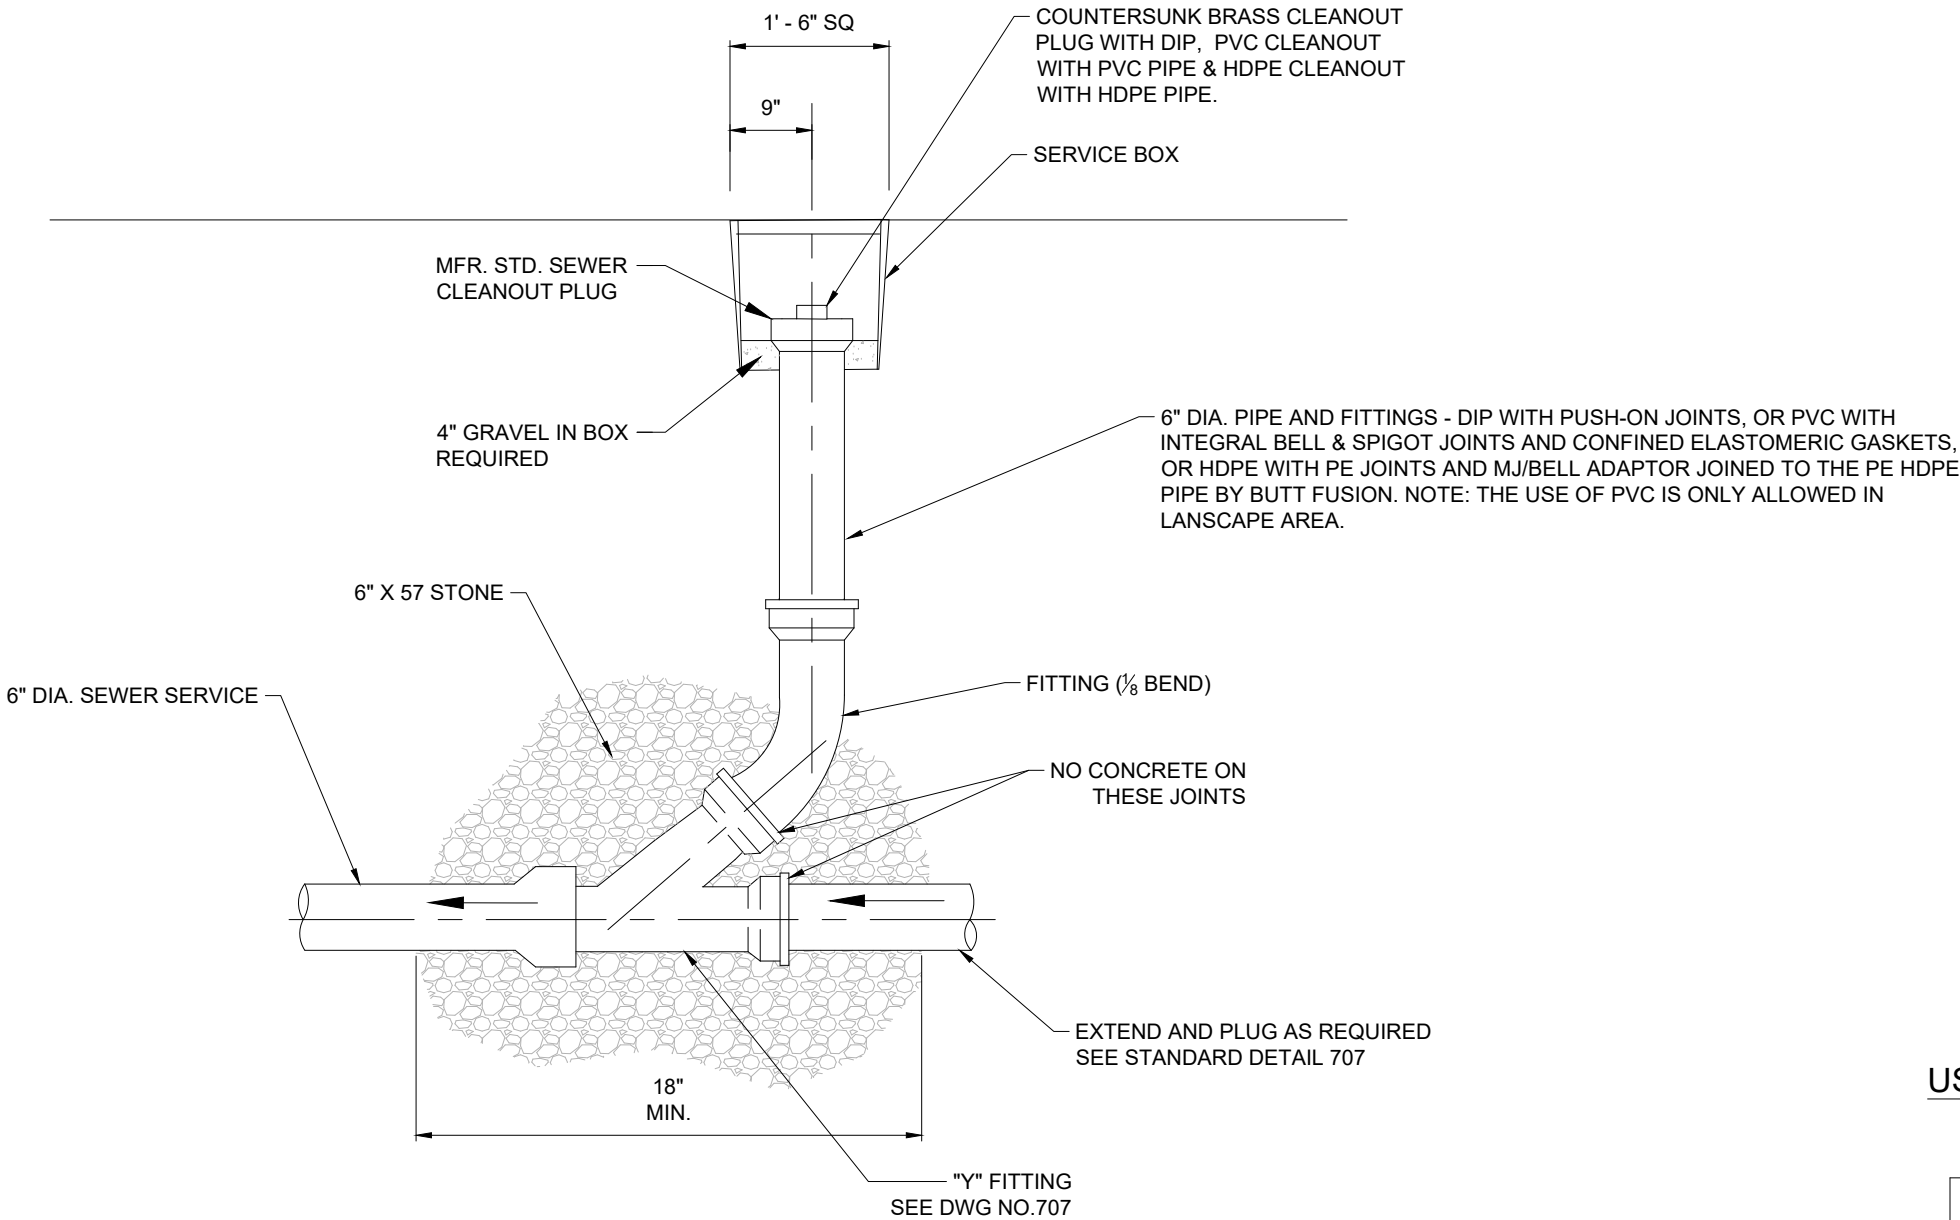


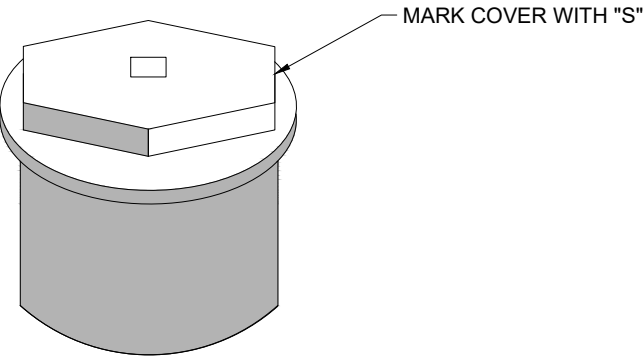

- NOTES:
- 1. TOP OF SERVICE BOX SHALL BE FLUSH WITH FINAL SURFACE IN SIDEWALKS AND PAVED AREAS.
  - 2. HEAVY DUTY CLEANOUT BOX AND LID ARE REQUIRED IN PAVED AREAS.
  - 3. CLEANOUTS IN PAVED AREA ARE TO BE 6-INCH DUCTILE IRON PIPE.
  - 4. DIP ONLY ALLOW AS AUTHORIZED BY FULTON COUNTY FOR LATERAL WITHIN PAVEMENT ON A CASE BY CASE BASIS.
  - 5. PLUG TO BE REMOVED BY THE PLUMBER UPON CONNECTION OF BUILDING SYSTEM TO PUBLIC SYSTEM.

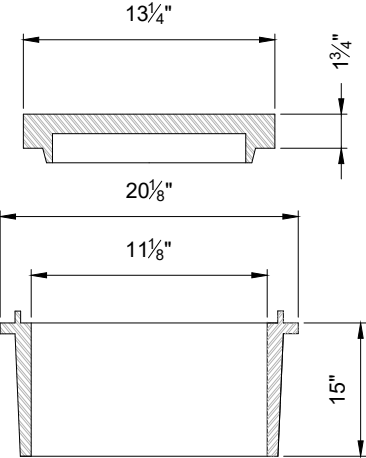

USF 7635 SEWER VALVE BOX AND COVER  
N.T.S.

| TABLE 709 - 1 |             |              |              |
|---------------|-------------|--------------|--------------|
| COVER TYPE    | LOAD RATING | COVER WEIGHT | TOTAL WEIGHT |
| FJ            | HEAVY DUTY  | 55           | 230          |

FULTON COUNTY STANDARD DETAIL 709  
CLEANOUT DETAIL

| DATE | REVISIONS | DATE | REVISIONS |
|------|-----------|------|-----------|
|      |           |      |           |
|      |           |      |           |
|      |           |      |           |
|      |           |      |           |
|      |           |      |           |

DGS/DRN/CHKD: MB/EB/ML  
APPROVED: TM  
DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS  
141 PRYOR ST. ATLANTA, GA. 30303  
404-612-7400 FAX: 404-224-0498

DRAWING NO.  
709