



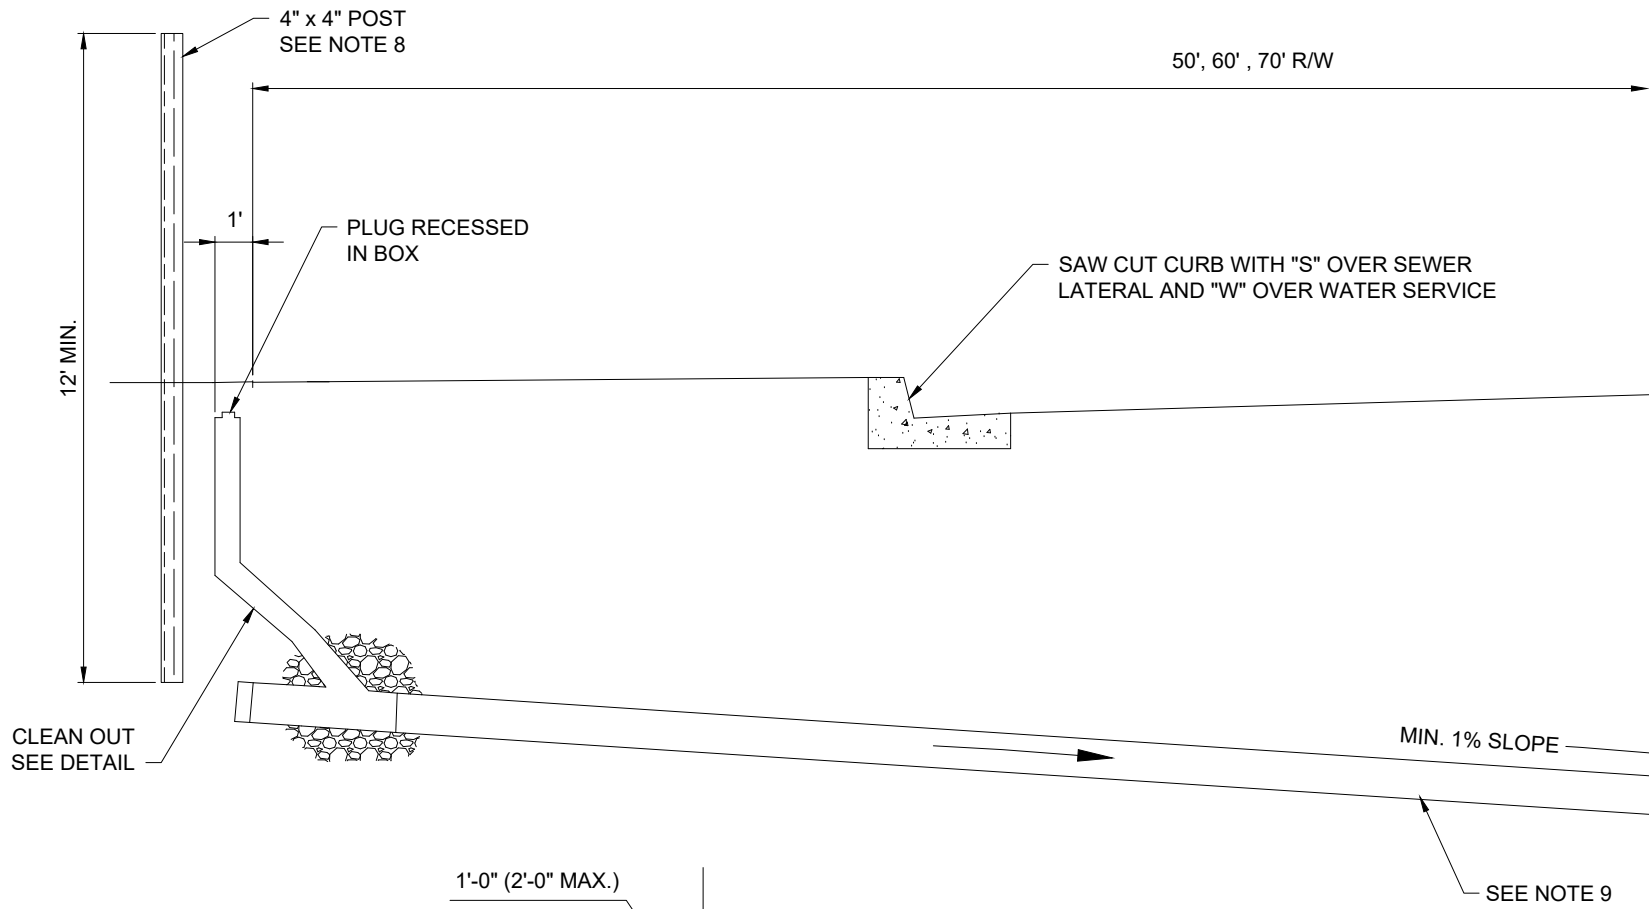

- NOTES:
1. CLEANOUTS TO BE INSTALLED BY SUBDIVISION DEVELOPER.
 2. MAINTAIN MATERIAL FOR STANDARD SEWER CLEANOUT PLUG. PLUGS TO BE PVC FOR PVC LATERALS, HDPE FOR HDPE LATERALS, AND BRASS FOR D.I. LATERAL.
 3. CLEANOUT BOX AND LID INSTALLED IN LANDSCAPE AREAS TO BE OLDCASTLE GREEN FLUSH HDPE 13" X 24" LIGHT DUTY 1324 CLEANOUT AND GREEN FLUSH SOLID COVER WITH FULTON COUNTY LOGO AND "SEWER CLEANOUT" ON THE COVER OR APPROVED EQUIVALENT.
 4. CLEANOUT BOX AND LID INSTALLED IN RESIDENTIAL DRIVEWAYS AND ALL SIDEWALKS TO BE EJ GROUP, INC. 1621Z 1621A ASSEMBLY PRODUCT NUMBER 00162121A01 OR APPROVED EQUIVALENT.
 5. CLEANOUT BOX AND LID INSTALLED WITHIN COMMERCIAL PAVEMENT OR WITHIN THE STREET PAVEMENT TO BE US FOUNDRY 7635 VALVE BOX AND ACCESS COVER WITH COVER TYPE FU OR APPROVED EQUIVALENT.
 6. IF THE RISER IS GREATER THAN 6' - 0" THE JOINT WILL BE ENCASED IN 6" OF 1:3.5 CONCRETE.
 7. MAINTAIN MATERIAL: USE PVC LATERALS WITH PVC MAINS, USE HDPE LATERALS WITH HDPE MAINS, AND USE D.I. LATERALS WITH D.I. MAINS.
 8. INSTALL 4" x 4" POST NEXT TO ALL CLEANOUTS. POST TO BE MIN. 12' LONG FOR PLUMBER TO DETERMINE DEPTH OF CLEANOUT. USE 16' POST FOR DEEPER LATERALS.
 9. WHERE SERVICE LINE CROSSES STATE HWY R/W, DI PIPE AND FITTINGS SHALL BE MJ JOINTS, HDPE PIPE AND FITTINGS SHALL BE PROVIDED WITH BELL/MJ ADAPTOR JOINED TO THE PLAIN END BY BUTT FUSION. TRENCHES SHALL BE BACKFILLED WITH CRUSHED STONE.
 10. DIP ONLY ALLOW AS AUTHORIZED BY FULTON COUNTY FOR LATERAL WITHIN PAVEMENT ON A CASE BY CASE BASIS
 11. PLUG TO BE REMOVED BY THE PLUMBER UPON CONNECTION OF BUILDING SYSTEM TO PUBLIC SYSTEM.

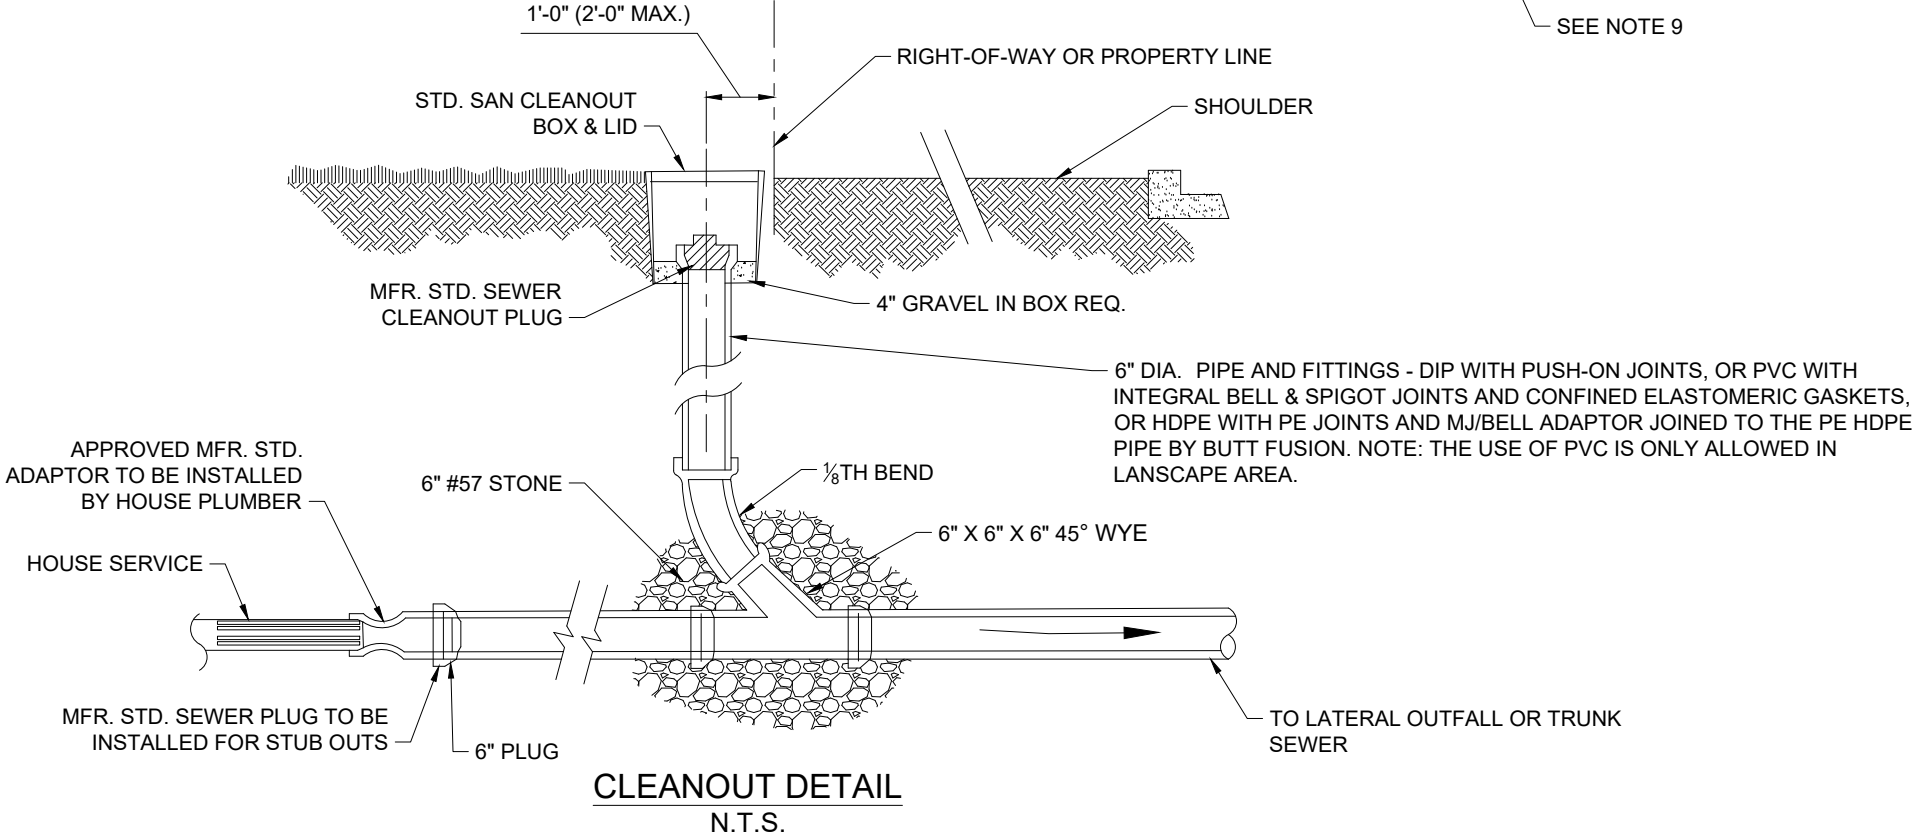

FULTON COUNTY STANDARD DETAIL 711

SEWER LATERAL INSTALLATION
DETAILS FOR CURBED STREETS

DATE	REVISIONS	DATE	REVISIONS

DGS/DRN/CHKD: MB/EB/ML

APPROVED: TM

DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.

711