




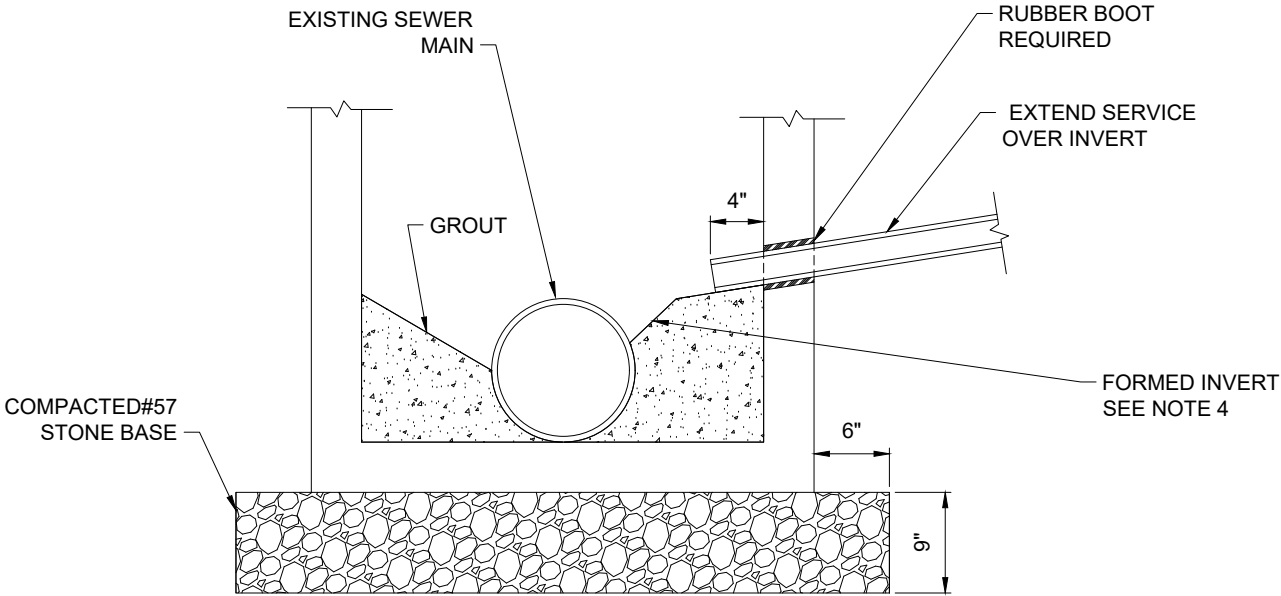

CROSS SECTION AT EXISTING SEWER MAIN (B-B)

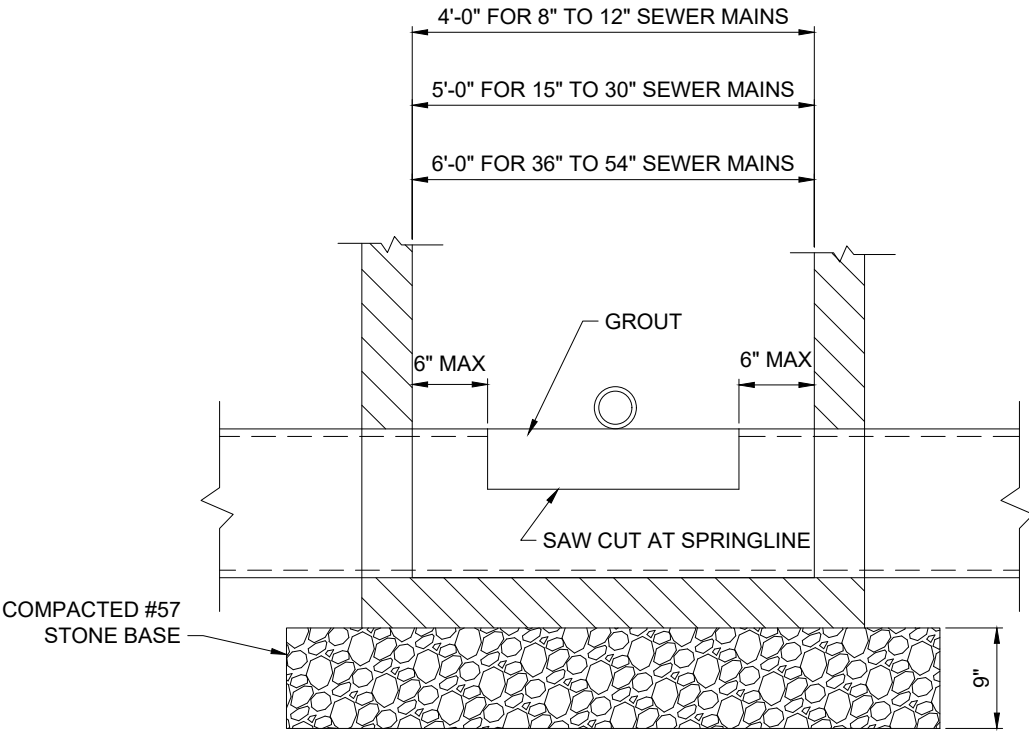

SECTION ALONG CENTERLINE OF EXISTING SEWER MAIN (A-A)

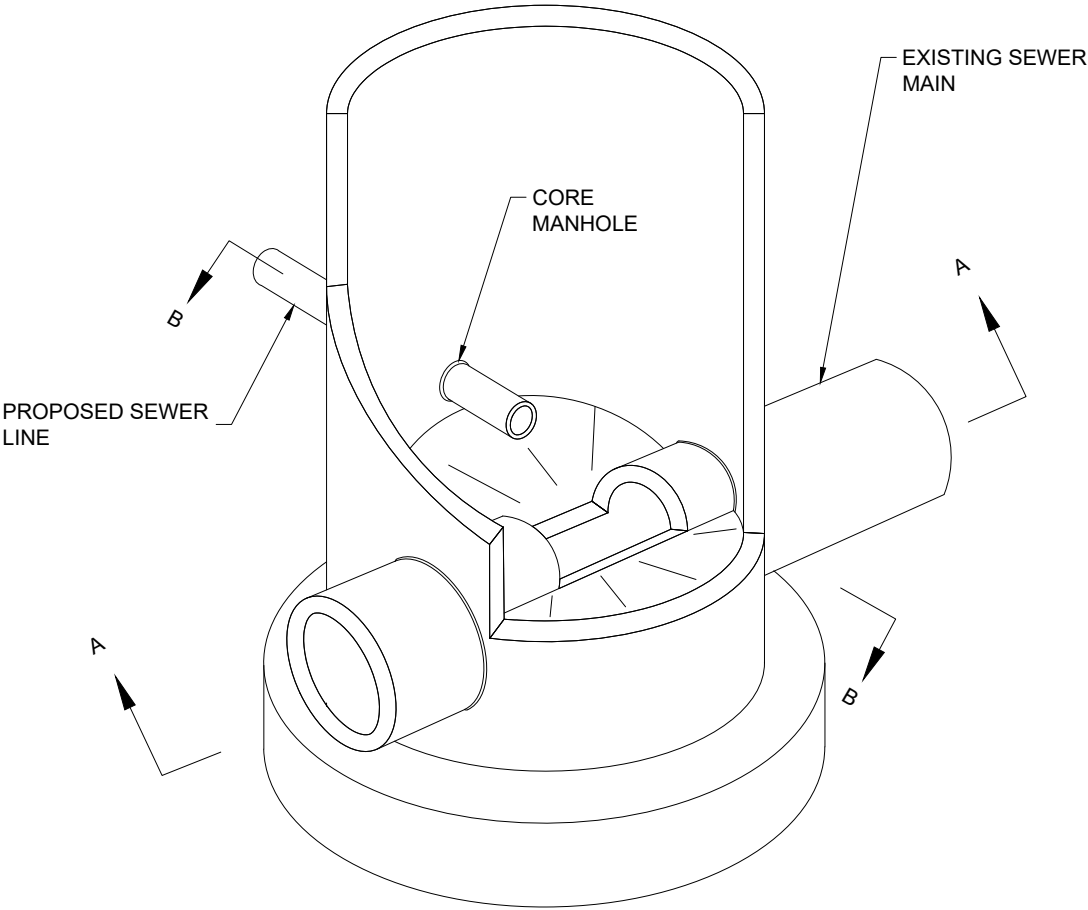

NOTES:

1. FLOW SHALL BE MAINTAINED DURING DOGHOUSE MANHOLE CONSTRUCTION.
2. MANHOLE PAD TO REST UPON A MINIMUM OF 9" COMPACTED #57 STONE BASE.
3. REFER TO STANDARD DETAILS 113,114A THROUGH F, AND 115 FOR ADDITIONAL DETAILS OF MANHOLE.
4. A FORMED INVERT IS REQUIRED FROM THE NEW SERVICE TO THE EXISTING PIPE. REFER TO STANDARD DETAILS 113, 114, AND 115 FOR DETAILS OF THE INVERT.

FULTON COUNTY STANDARD DETAIL 713
DOGHOUSE MANHOLE DETAIL

DATE	REVISIONS	DATE	REVISIONS

DGS/DRN/CHKD: MB/EB/ML
APPROVED: TM
DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.
713