


NOTES:

- 1. SEE STANDARD DWG. 809 FOR UNCURBED STREET.
- 2. ALL VALVES MUST BE RATED AT WORKING PRESSURE OF 200 PSI AND TESTED AT A PRESSURE OF 250 PSI. ALL FIRE HYDRANTS MUST BE ACCOMPANIED BY A MANUFACTURER'S CERTIFICATE THAT STATES EACH HYDRANT HAS BEEN TESTED ACCORDING TO THE LATEST REVISION OF AWWA SPECIFICATION C502.
- 3. CONCRETE STRENGTH TEST REQUIRED FOR ALL POURED IN-PLACE CONCRETE.
- 4. PAINT BONNET SILVER FOR HYDRANTS SET ON 10-INCH AND SMALLER WATER LINES; YELLOW FOR HYDRANTS SET ON 12-INCH WATER LINES; AND GREEN FOR HYDRANTS SET ON 16-INCH OR GREATER WATER LINES. REPAINT HYDRANT AT END OF MAINTENANCE.
- 5. MINIMUM 18 INCHES BETWEEN TOP OF CURB AND CENTER OF CONNECTION. MAXIMUM OF 21 INCHES.
- 6. "SMART" HYDRANTS SHALL BE M&H 5-1/4" iHYDRANT™ - M&H 129S FOR APPROVED EQUIVALENT.

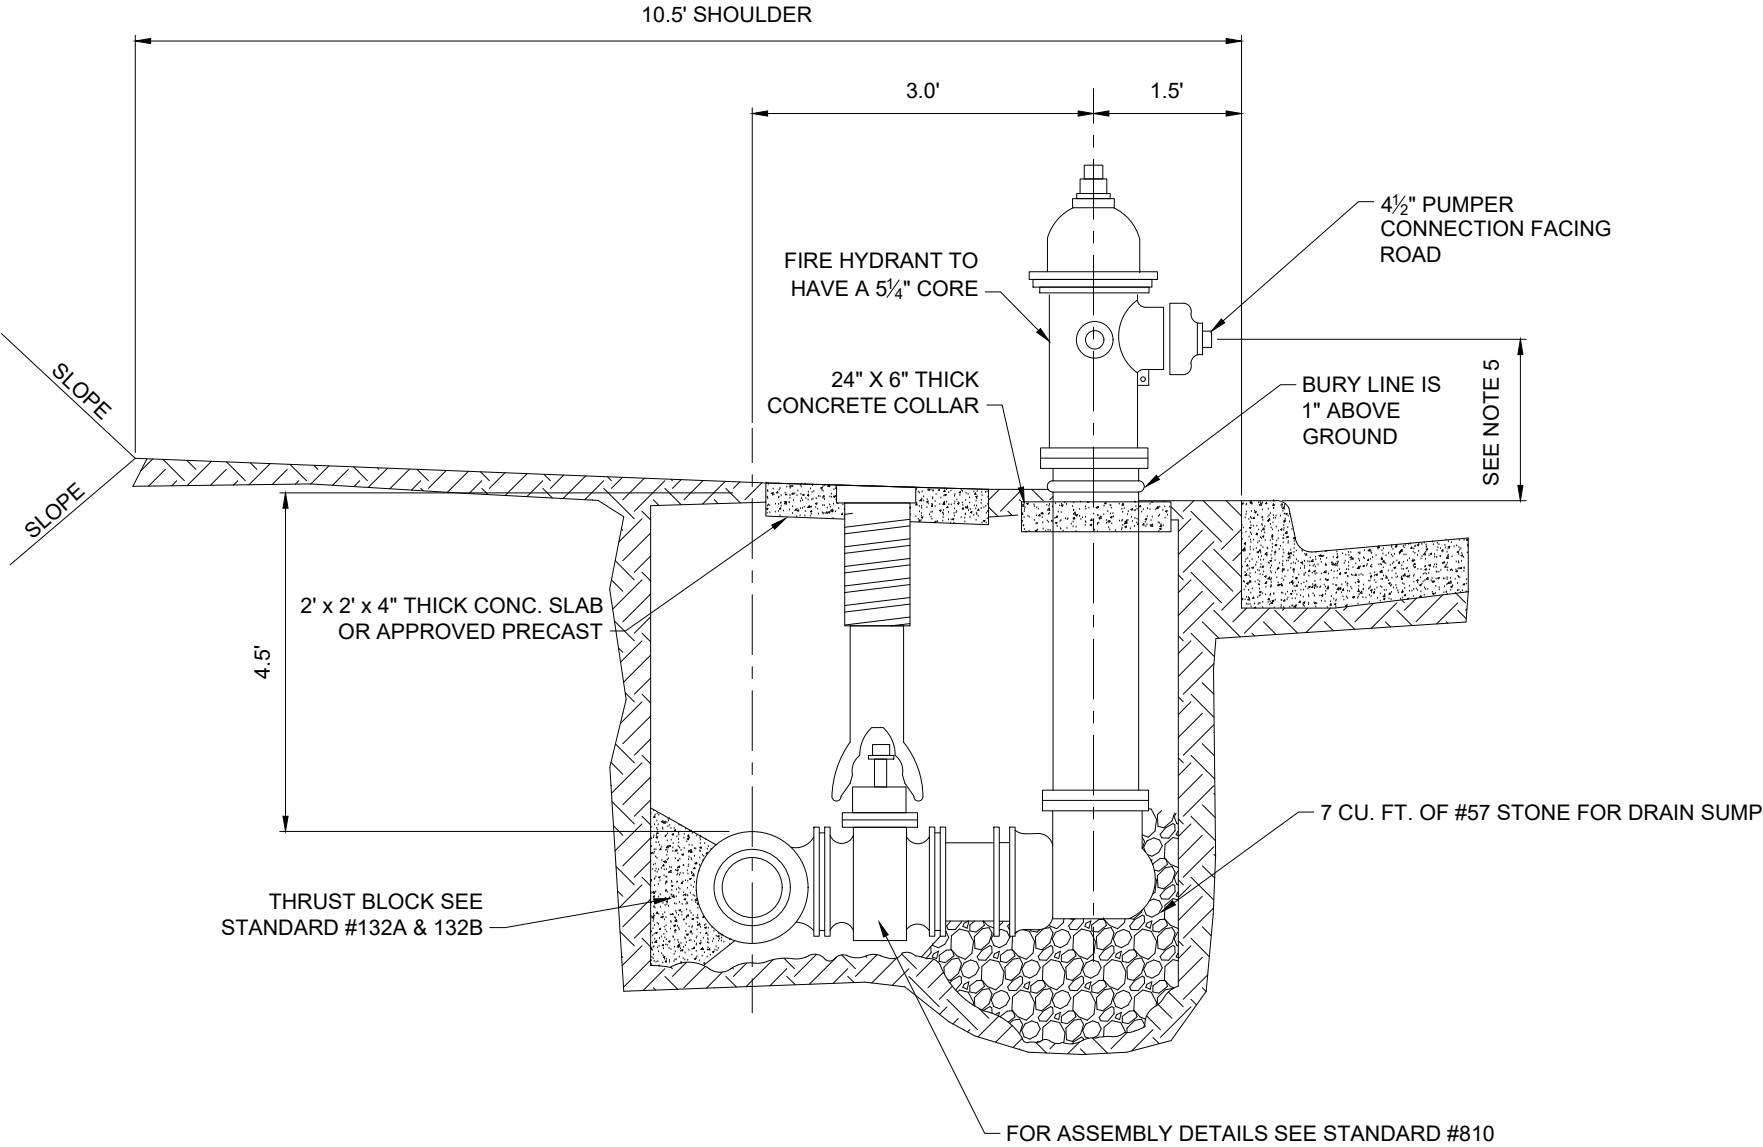

HYDRANT LOCATION DETAIL
N.T.S.

FULTON COUNTY STANDARD DETAIL 808

HYDRANT LOCATION DETAIL FOR
CURB & GUTTER RESIDENTIAL STREETS

DATE	REVISIONS	DATE	REVISIONS

DGS/DRN/CHKD: MB/EB/ML
APPROVED: TM
DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.

808