


NOTES:

1. SEE ANCHOR RODDING DETAIL #818. GRADE-LOCS CAN BE USED TO ADJUST HYDRANTS TO PROPER BURY DEPTH.
2. "SMART" HYDRANTS SHALL BE M&H 5-1/4" iHYDRANT™ - M&H 129S FOR APPROVED EQUIVALENT.

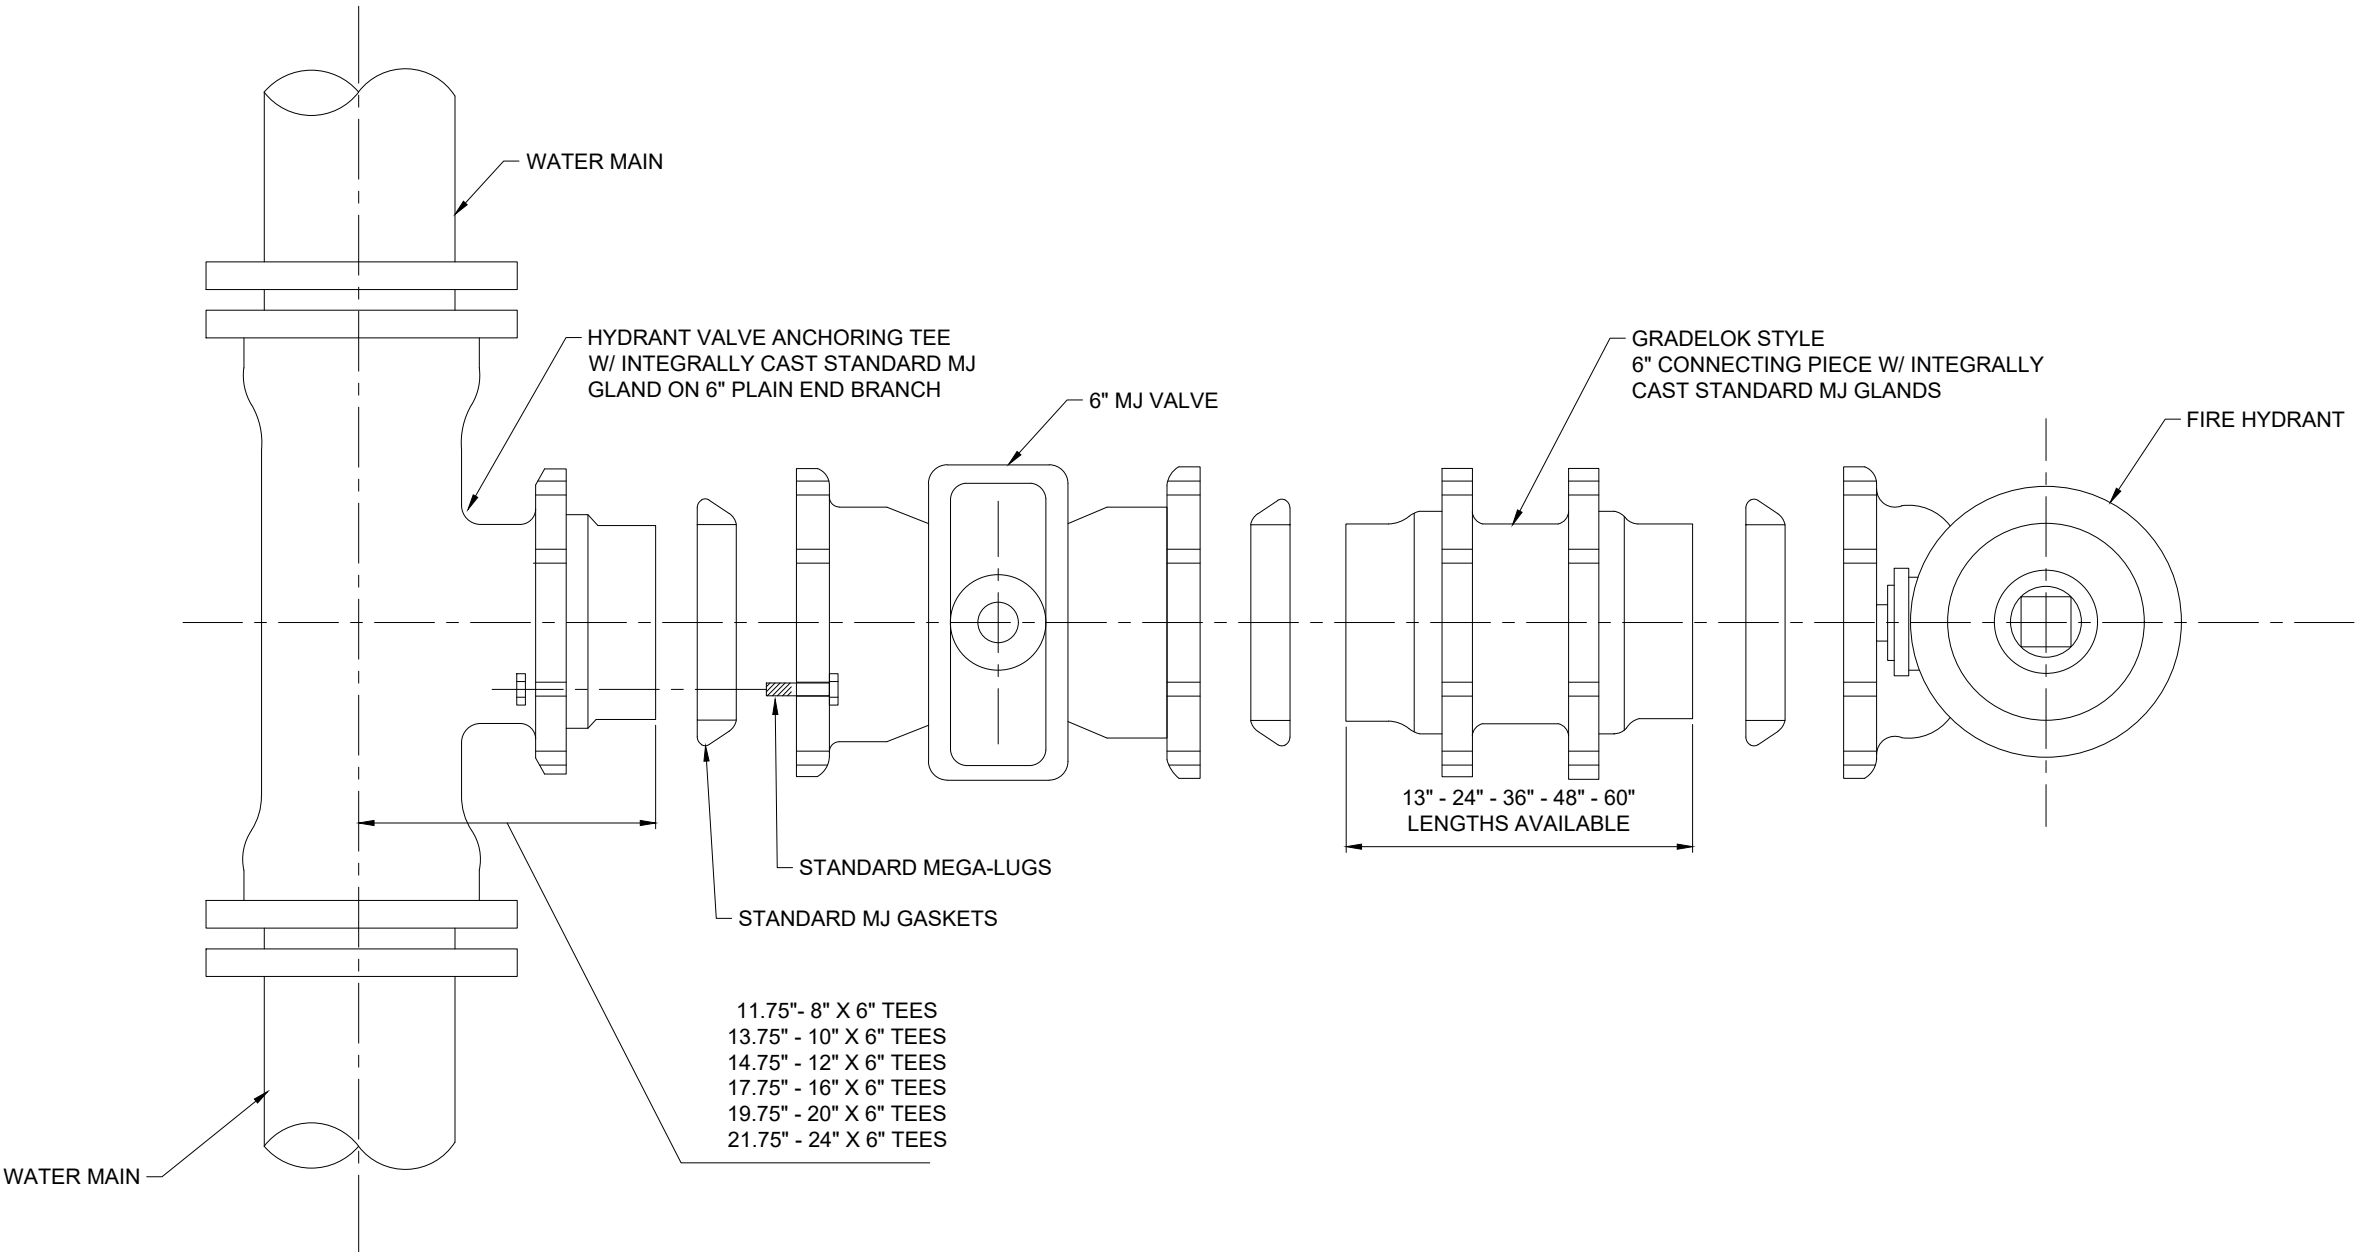

HYDRANT ASSEMBLY DETAIL
NTS

FULTON COUNTY STANDARD DETAIL 810

HYDRANT ASSEMBLY DETAIL

DATE	REVISIONS	DATE	REVISIONS

DGS/DRN/CHKD: MB/EB/ML

APPROVED: TM

DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS

141 PRYOR ST. ATLANTA, GA. 30303

404-612-7400 FAX: 404-224-0498

DRAWING NO.

810