


813 - Water Meter Manifold Detail for Townhome Development.dwg March 17, 2026 - 4:14pm

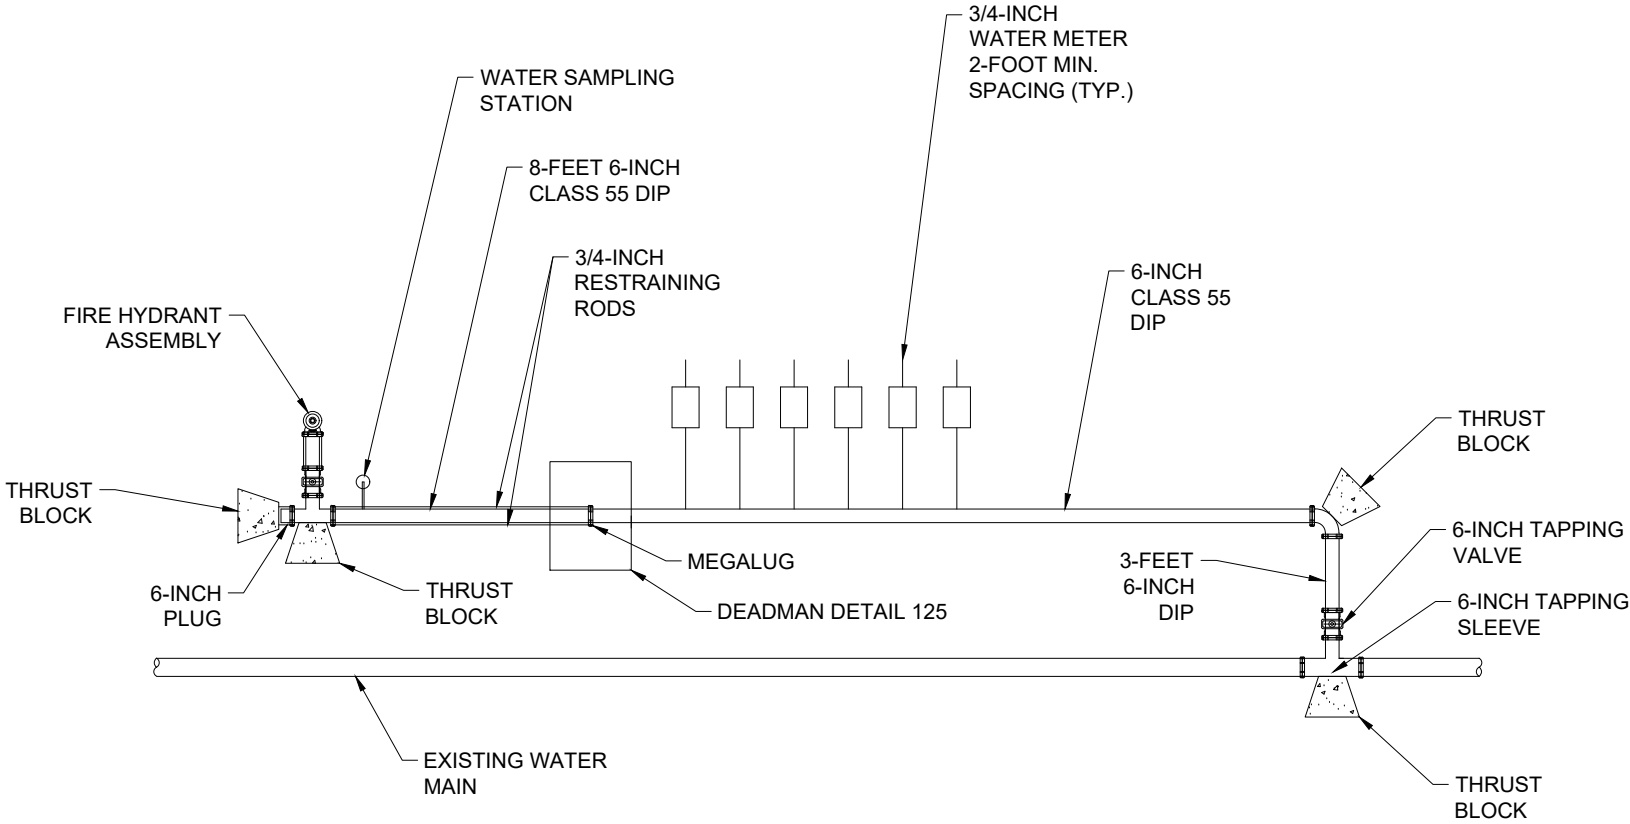

NOTES:

1. 6-INCH TAPPING SLEEVE AND VALVE IS TO BE INSTALLED IN ACCORDANCE WITH FULTON COUNTY STANDARD DETAIL 122.
2. THRUST BLOCKS ARE TO BE INSTALLED IN ACCORDANCE WITH FULTON COUNTY STANDARD DETAILS 132A AND 132B.
3. WATER METERS ARE TO BE INSTALLED IN ACCORDANCE WITH FULTON COUNTY STANDARD DETAIL 801.
4. FIRE HYDRANT IS TO BE INSTALLED IN ACCORDANCE WITH FULTON COUNTY STANDARD DETAILS 808 AND 810.
5. END OF LINE IS TO BE INSTALLED IN ACCORDANCE WITH FULTON COUNTY STANDARD DETAIL 812.
6. WATER SAMPLING STATION IS TO BE INSTALLED IN ACCORDANCE WITH FULTON COUNTY STANDARD DETAIL 818.

FULTON COUNTY STANDARD DETAIL 813

WATER METER MANIFOLD DETAIL
FOR TOWNHOME DEVELOPMENTS

DATE	REVISIONS	DATE	REVISIONS

DGS/DRN/CHKD: MB/EB/ML
APPROVED: TM
DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.

813