

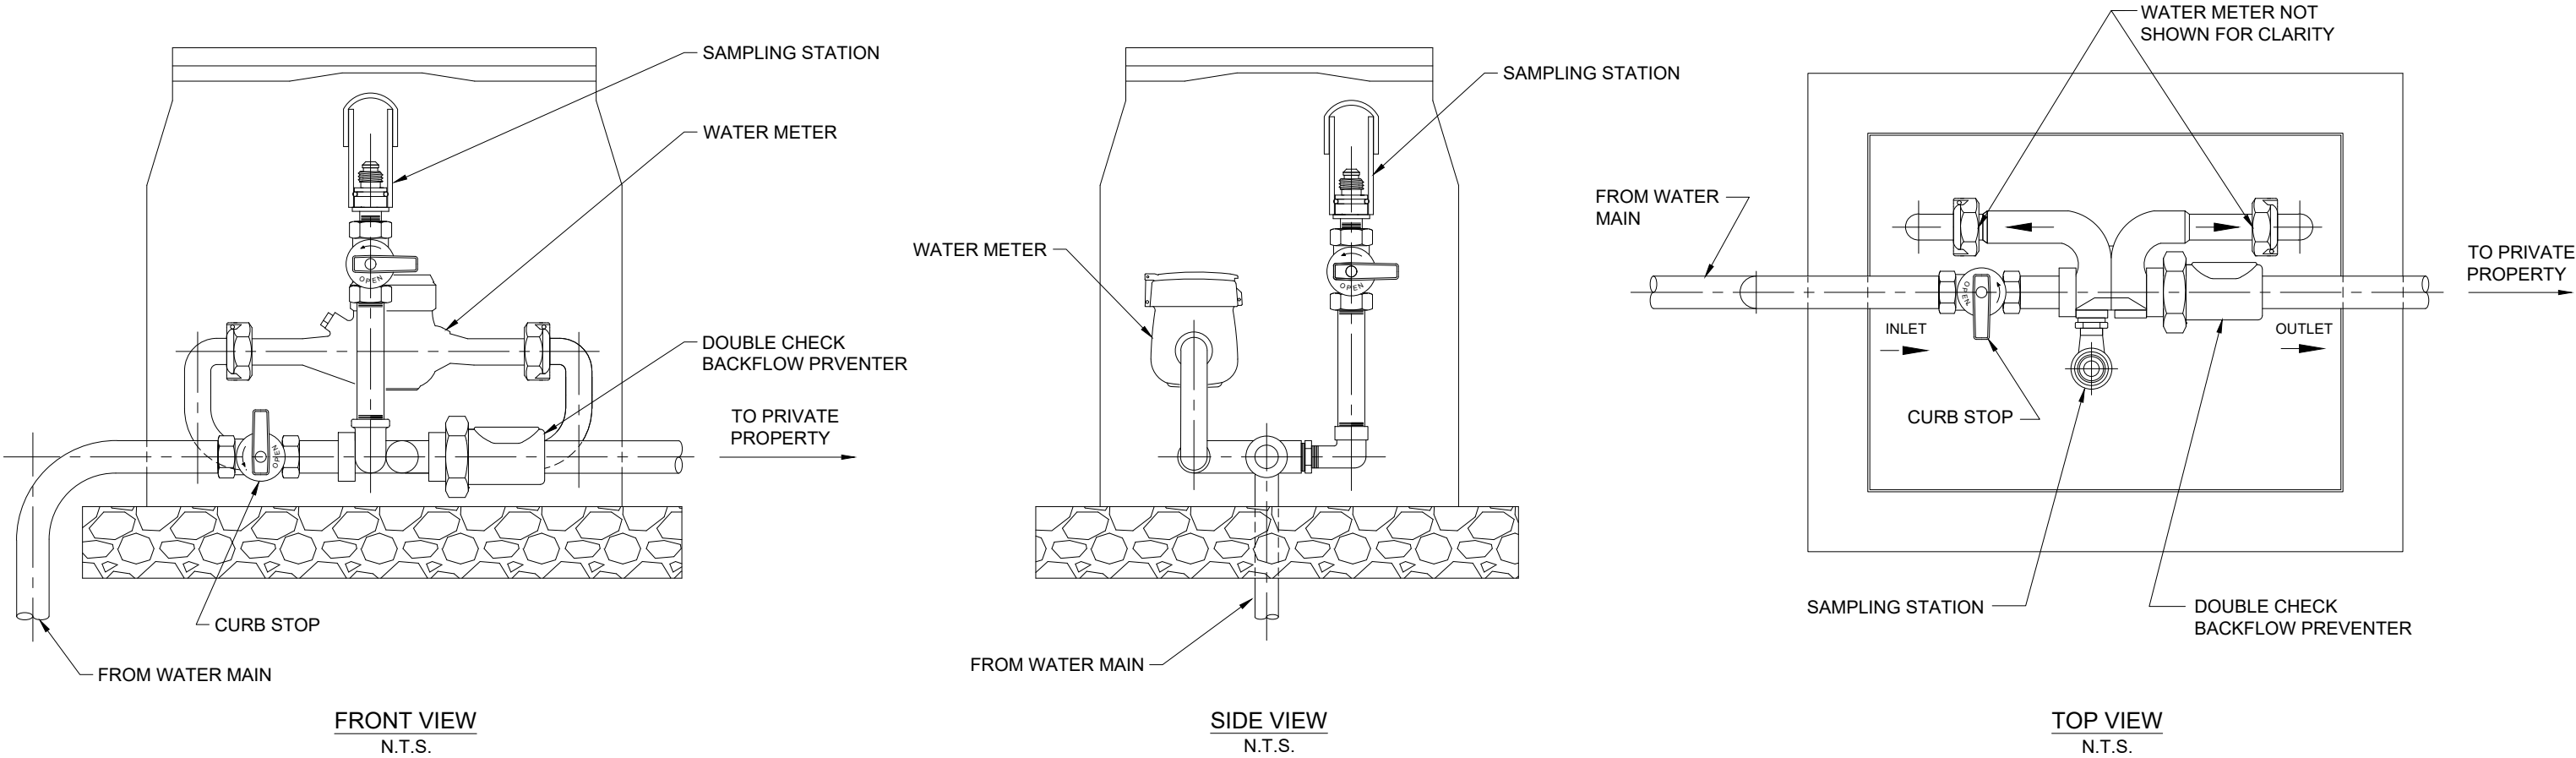


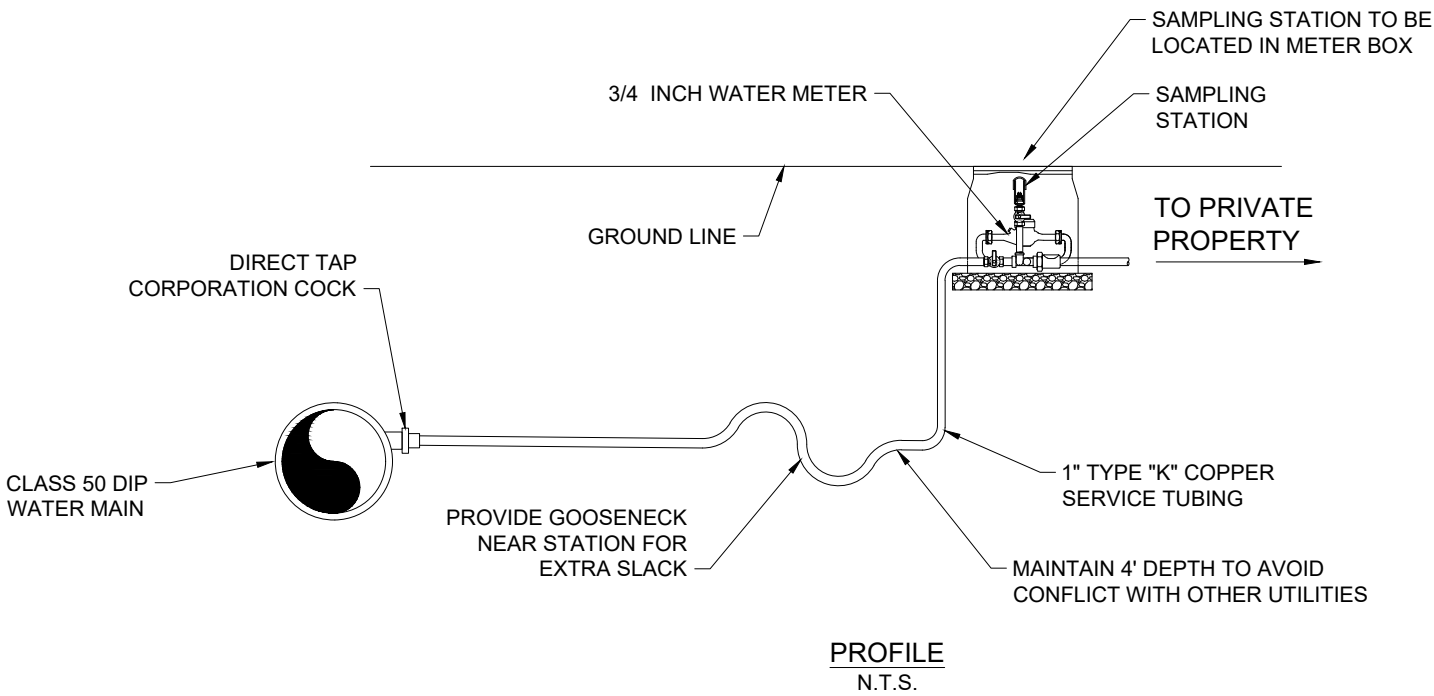

NOTE:

1. SAMPLING STATION SHALL BE ECLIPSE #24 SAMPLING STATION BY KUPFERLE OR FCPW APPROVED EQUAL.
2. SAMPLING STATION TO BE PROVIDED WITH SAMPLING ROD IN PROTECTIVE TRAVEL CASE.

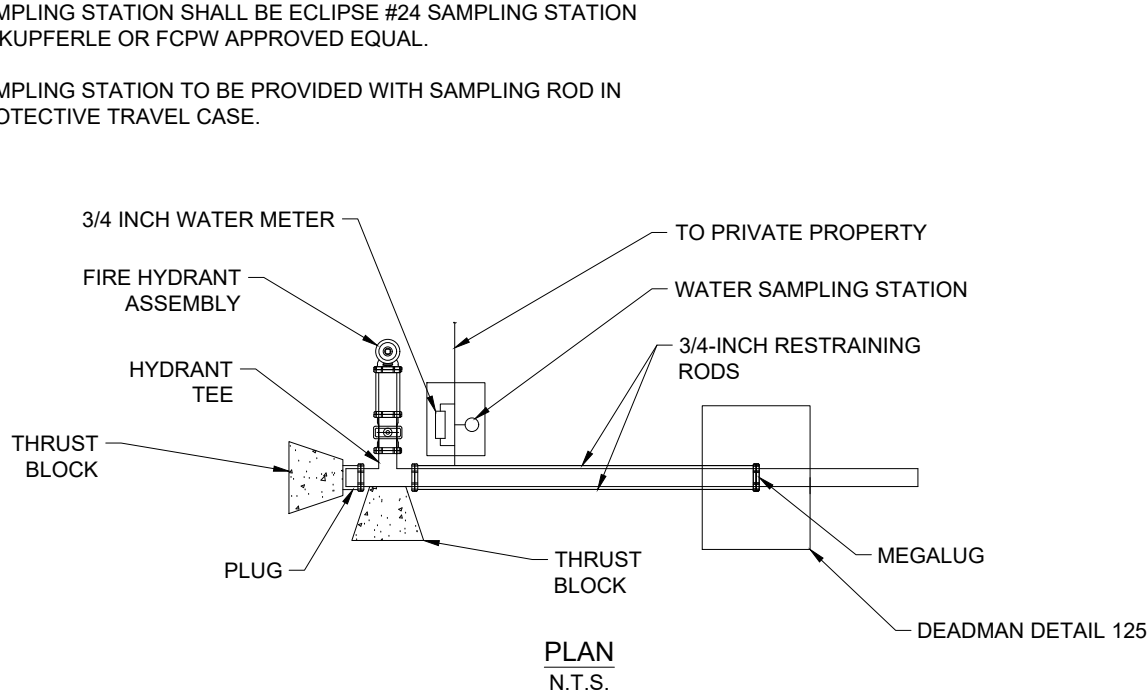

FULTON COUNTY STANDARD DETAIL 818
WATER SAMPLING STATION

DATE	REVISIONS	DATE	REVISIONS

DGS/DRN/CHKD: MB/EB/ML
APPROVED: TM
DATE: 02-18-2026



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.
818