




NOTES:

- 1. METER AND DISCONNECT SHALL BE PLACED NEAR THE FRONT ENTRANCE AS SHOWN ON P-001.
- 2. CONDUITS TO BE ENCASED IN CONCRETE. ADD RED DYE OR SPRINKLE RED DYE THROUGHOUT CONCRETE THAT IS ACCEPTABLE TO INSPECTOR.
- 3. SHOW CONCRETE ENCASEMENT OF POWER LINE CONDUITS WITH RED DYED CONCRETE.

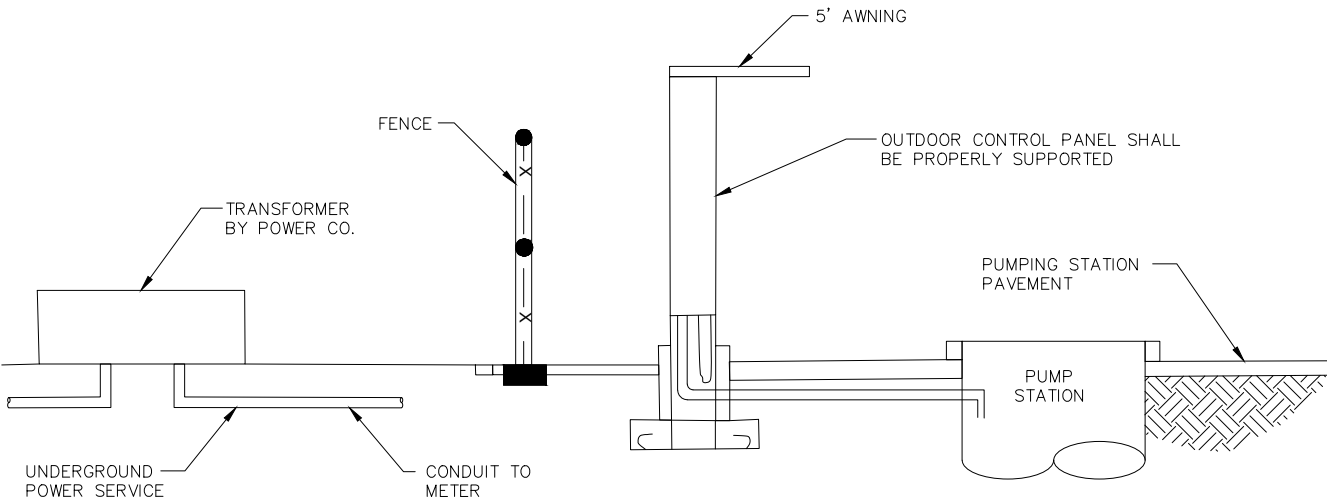

FULTON COUNTY STANDARD DETAILS

PUMP STATION
UNDERGROUND POWER DETAIL

NOT TO SCALE

DATE: 02-18-2026

FULTON COUNTY PUBLIC WORKS
141 PRYOR ST.
ATLANTA, GA. 30303
404-612-7400
FAX: 404-224-0498

DETAIL NO. P-002