




NOTES:

- 1. DISCONNECT SHALL BE PLACED ON ELECTRICAL/CONTROL PANEL SUPPORT (MAIN BREAKER IS SHOWN ON P-023 AND P-025).
- 2. DISCONNECT SWITCH MUST BE LOCKABLE IN EACH POSITION.
- 3. OVERHEAD POWER ONLY ALLOWED IF NOT PHYSICALLY POSSIBLE TO RUN SERVICE UNDERGROUND.
- 4. SHOW CONCRETE ENCASEMENT OF POWER LINE CONDUITS WITH RED DYED CONCRETE.

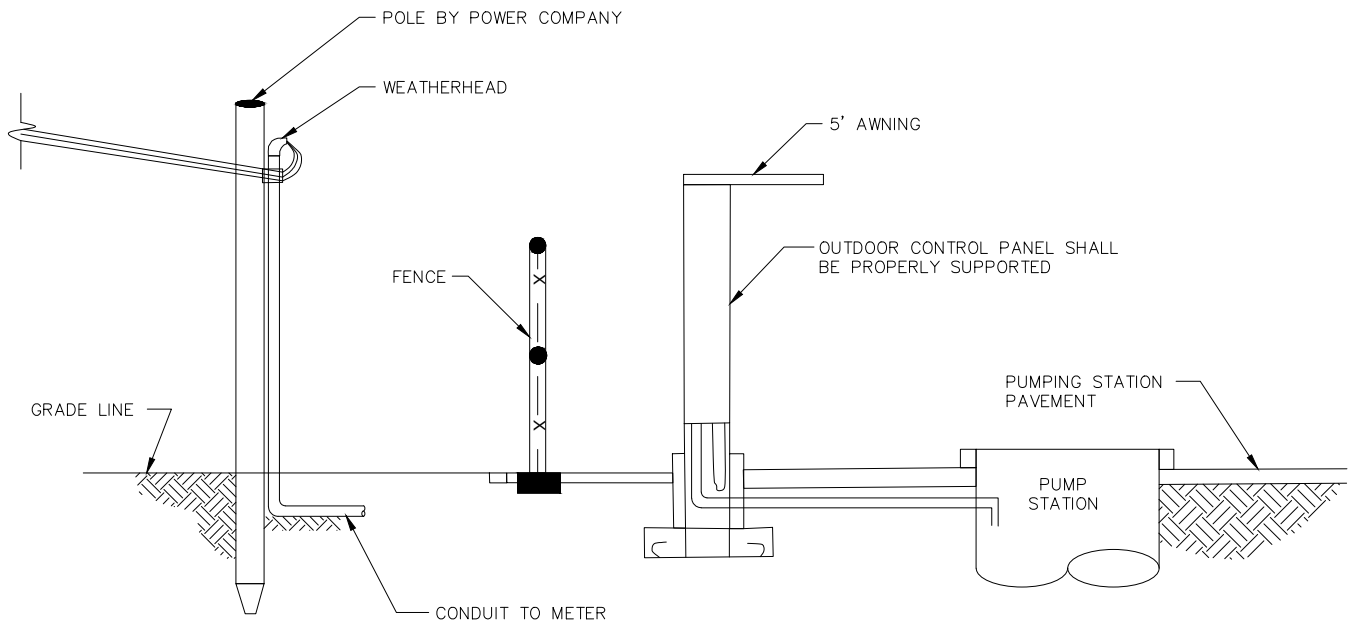

FULTON COUNTY STANDARD DETAILS

PUMP STATION
OVERHEAD POWER DETAIL

NOT TO SCALE

DATE: 02-18-2026

FULTON COUNTY PUBLIC WORKS
141 PRYOR ST.
ATLANTA, GA. 30303
404-612-7400
FAX: 404-224-0498

DETAIL NO. P-003