




- NOTE:
- 1. YARD HYDRANT TO BE SIMMONS 800 SERIES FREEZE PROOF OR APPROVED EQUAL.
 - 2. ADD FREEZE PROOF INSULATION FOR PIPE.

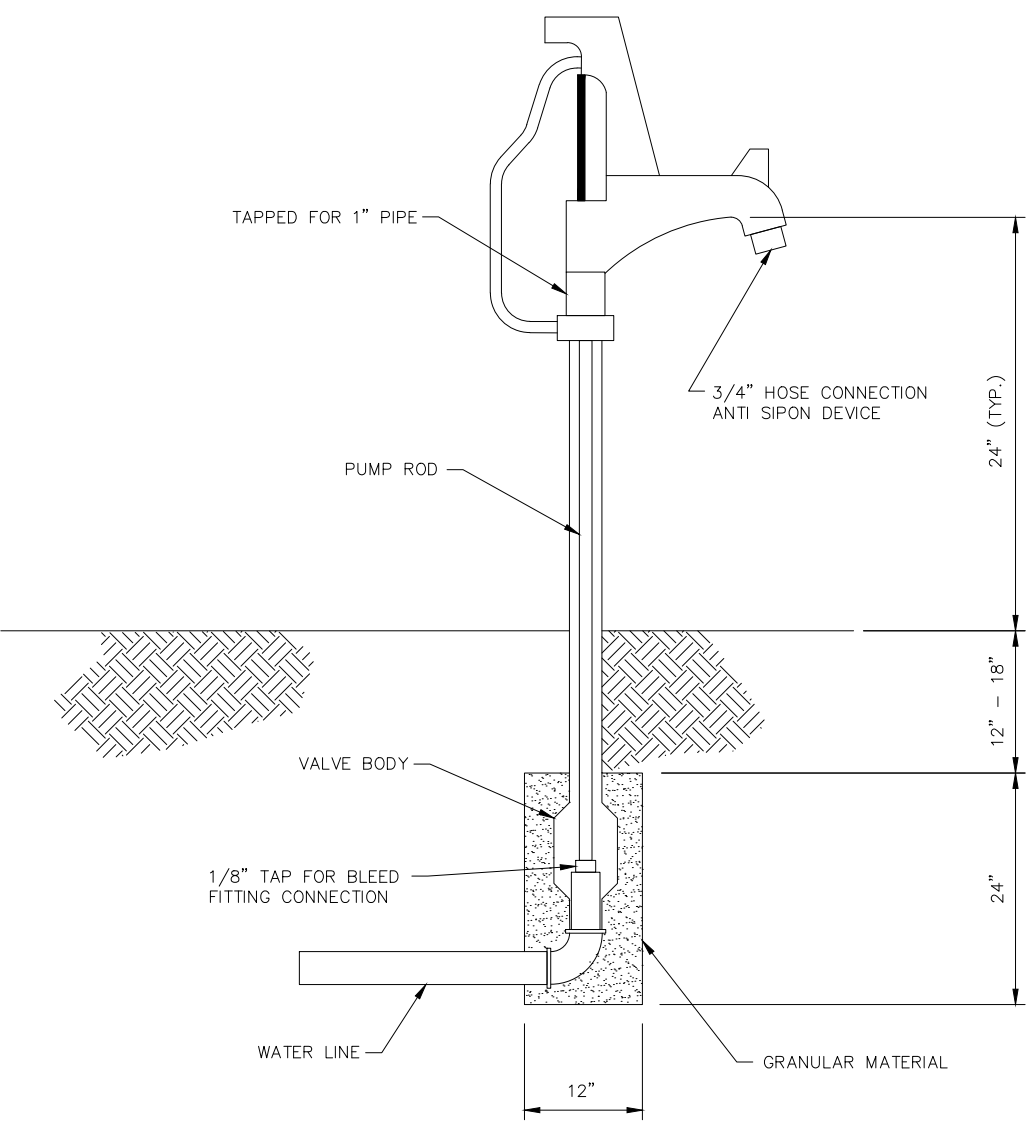

FULTON COUNTY STANDARD DETAILS

PUMP STATION
HOSE BIB
SERVICE CONNECTION DETAIL

NOT TO SCALE

DATE: 02-18-2026

FULTON COUNTY PUBLIC WORKS
141 PRYOR ST.
ATLANTA, GA. 30303
404-612-7400
FAX: 404-224-0498

DETAIL NO. P-004