


NOTES:

- 1. EXTERIOR HINGED LIGHT POLE WITH 4900 LUMENS LED FIXTURE 120 VOLT PHOTOELECTRIC CONTROL, WITH HEAT AND IMPACT RESISTANT LENS. POLE IS TO BE ARCHITECTURAL BROWN AND IS TO BE SUPPLIED WITH LOWERING WENCH. FIXTURE - GE PART # ERL1005C530EDKBZR ER1 SHEILDS - GE PART # 93118695 BRACKET - GE PART # RBSU216PP POLE - GE PART # ASHS202T-4.0-7PP WINCH - GE PART # M180A

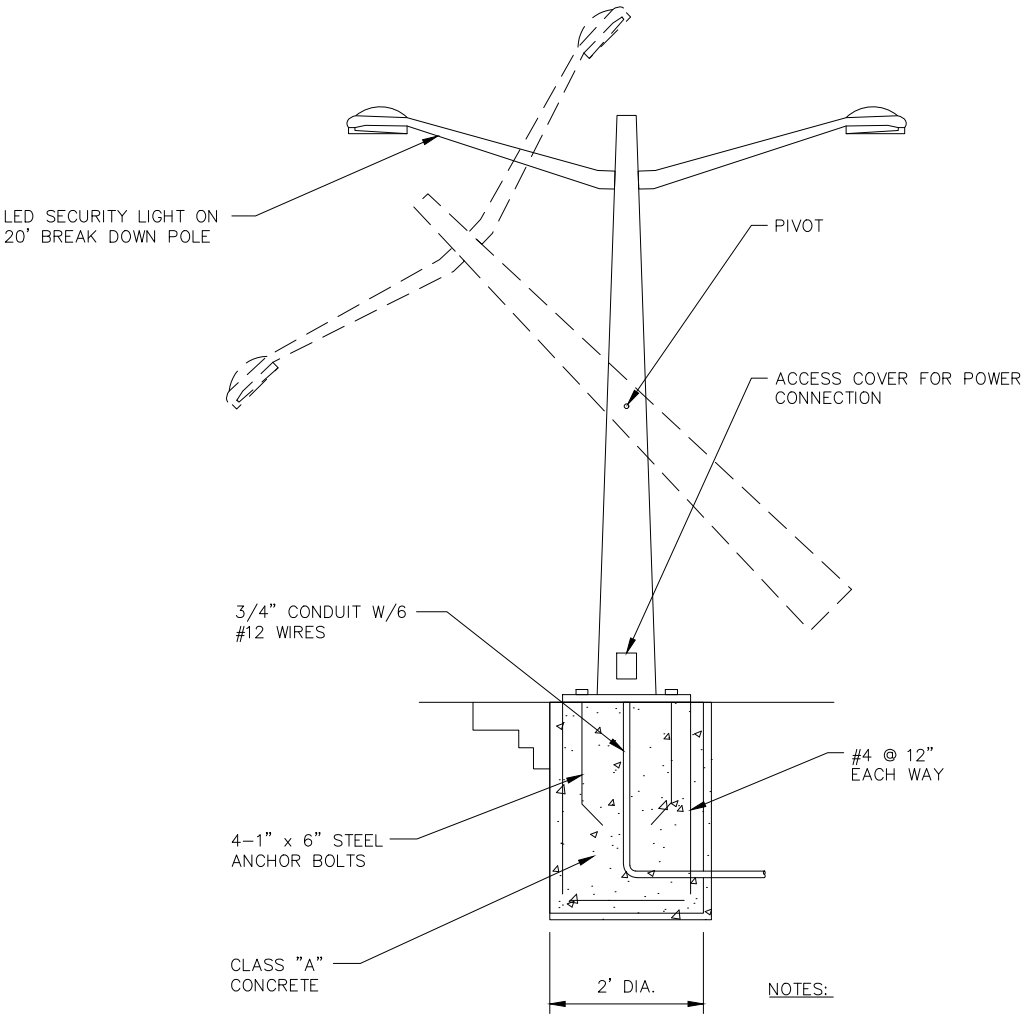

NOTES:

- 1. SHOW CONCRETE ENCASEMENT OF POWER LINE CONDUITS WITH RED DYED CONCRETE.
- 2. SECURITY LIGHT TO AVE MOTION SENSOR TO ACTIVE, LIGHTS TO CUT OFF 30-MINUTES AFTER ACTIVATION
- 3. LIGHT TO HAVE FULL CUTOFF SHIELD.



FULTON COUNTY STANDARD DETAILS

PUMP STATION
LIGHT POLE DETAIL

NOT TO SCALE

DATE: 02-18-2026

FULTON COUNTY PUBLIC WORKS
141 PRYOR ST.
ATLANTA, GA. 30303
404-612-7400
FAX: 404-224-0498

DETAIL NO. P-006