




DETAIL  
N.T.S.

- NOTES:
- 1. PUMPING STATION CONCRETE PAD TO BE A MINIMUM OF 6 INCHES THICK ON A COMPACTED SUB-GRADE AND A MINIMUM 6 INCH AGGREGATE BASE COURSE COMPACTED TO 95% STANDARD PROCTOR COMPACTION.
  - 2. PROVIDE CURBING, AS SHOWN, AROUND THE PAD TO PREVENT RUNOFF FROM ERODING THE UNDERSIDE OF THE PAD.
  - 3. PUMPING STATION PAD AND DRIVEWAY SHALL INCLUDE EXPANSION JOINTS AS NEEDED.
  - 4. PUMPING STATION PAD AND DRIVEWAY REINFORCEMENT SHALL BE DESIGNED TO WITHSTAND 80,000 LB LOAD.

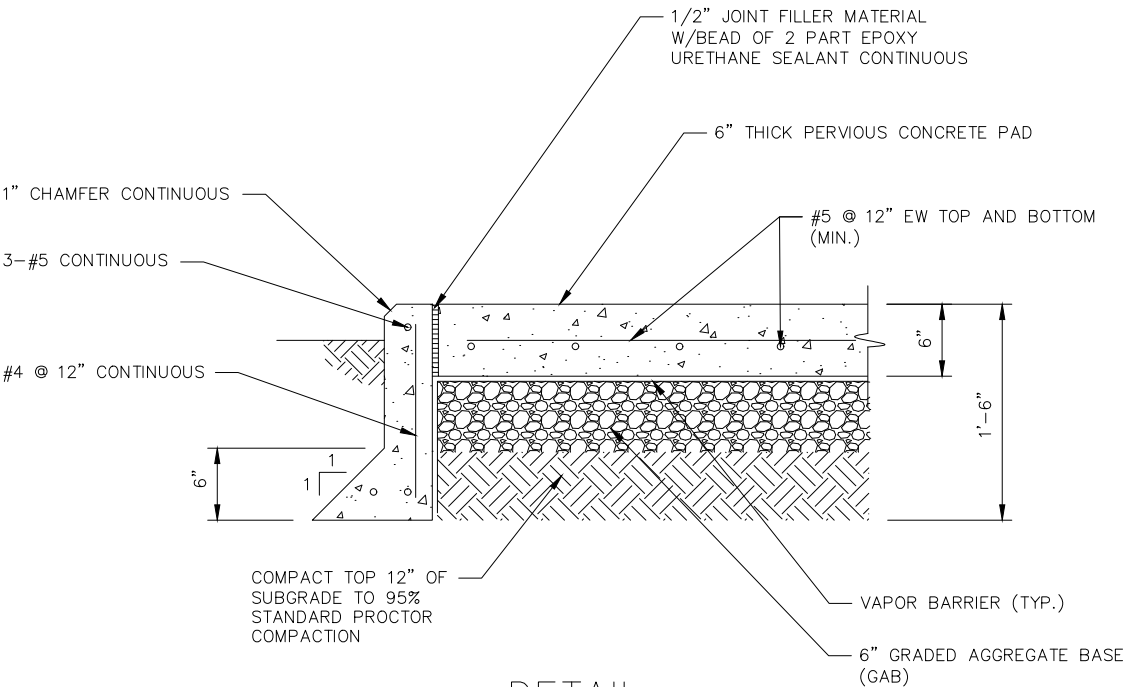

FULTON COUNTY STANDARD DETAILS

PUMP STATION  
SLAB AND CURB DETAIL

NOT TO SCALE

DATE: 02-18-2026

FULTON COUNTY PUBLIC WORKS  
141 PRYOR ST.  
ATLANTA, GA. 30303  
404-612-7400  
FAX: 404-224-0498

DETAIL NO. P-008