



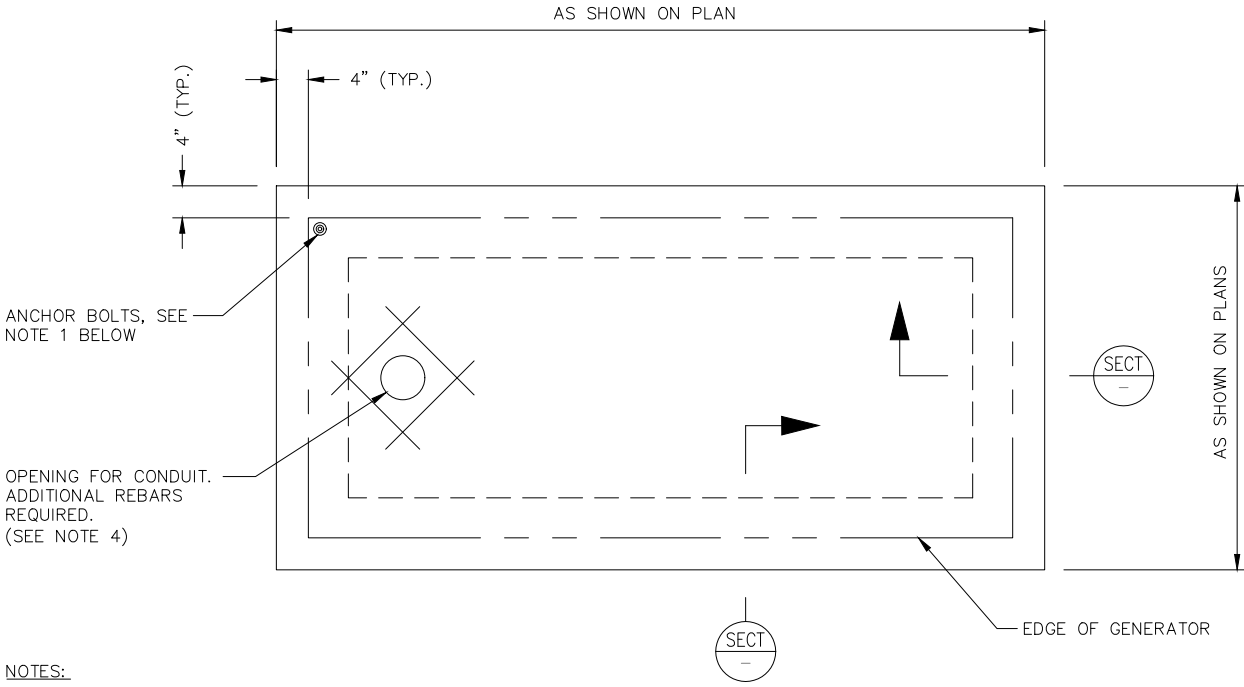

NOTES:

1. VERIFY QUANTITY, TYPE, DIAMETER AND LENGTH OF ANCHOR BOLTS REQUIRED BY MANUFACTURER PRIOR TO ORDERING AND/OR EMBEDDING FASTENERS IN CONCRETE SLAB.
2. PAD SIZE SHALL BE INCREASED AS NECESSARY.
3. CONTRACTOR TO COORDINATE SIZE AND LOCATION OF OPENING IN PAD FOR CONDUITS.
4. SIZE AND LENGTH OF REBARS TO BE DETERMINED BY DIAMETER OF CONDUIT OPENING.

PLAN
N.T.S.

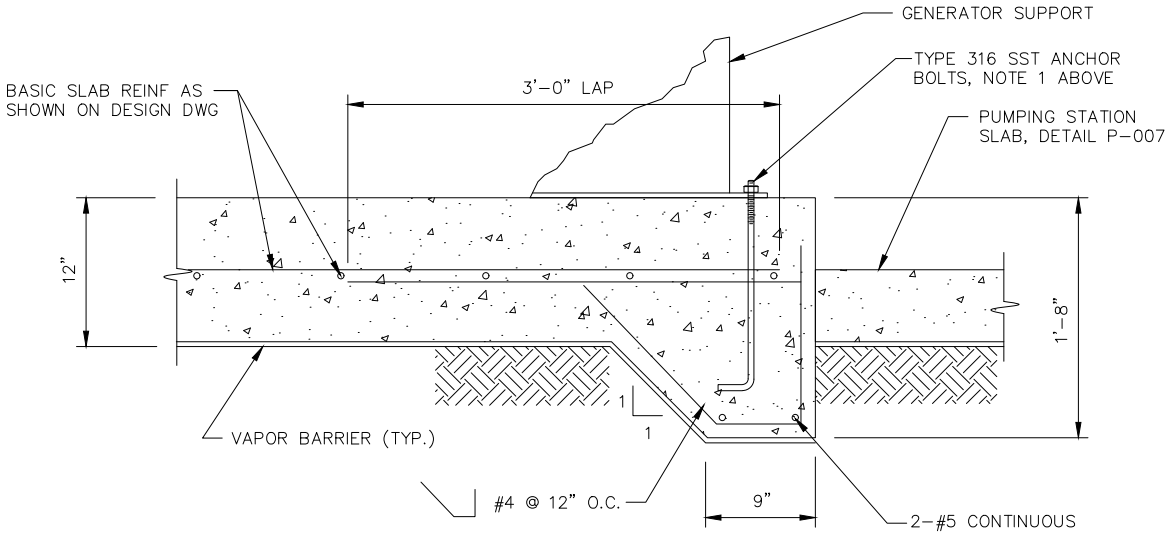

SECTION (TYP.)
N.T.S.



FULTON COUNTY STANDARD DETAILS

PUMP STATION
GENERATOR PAD DETAIL

NOT TO SCALE

DATE: 02-18-2026

FULTON COUNTY PUBLIC WORKS
141 PRYOR ST.
ATLANTA, GA. 30303
404-612-7400
FAX: 404-224-0498

DETAIL NO. P-009