



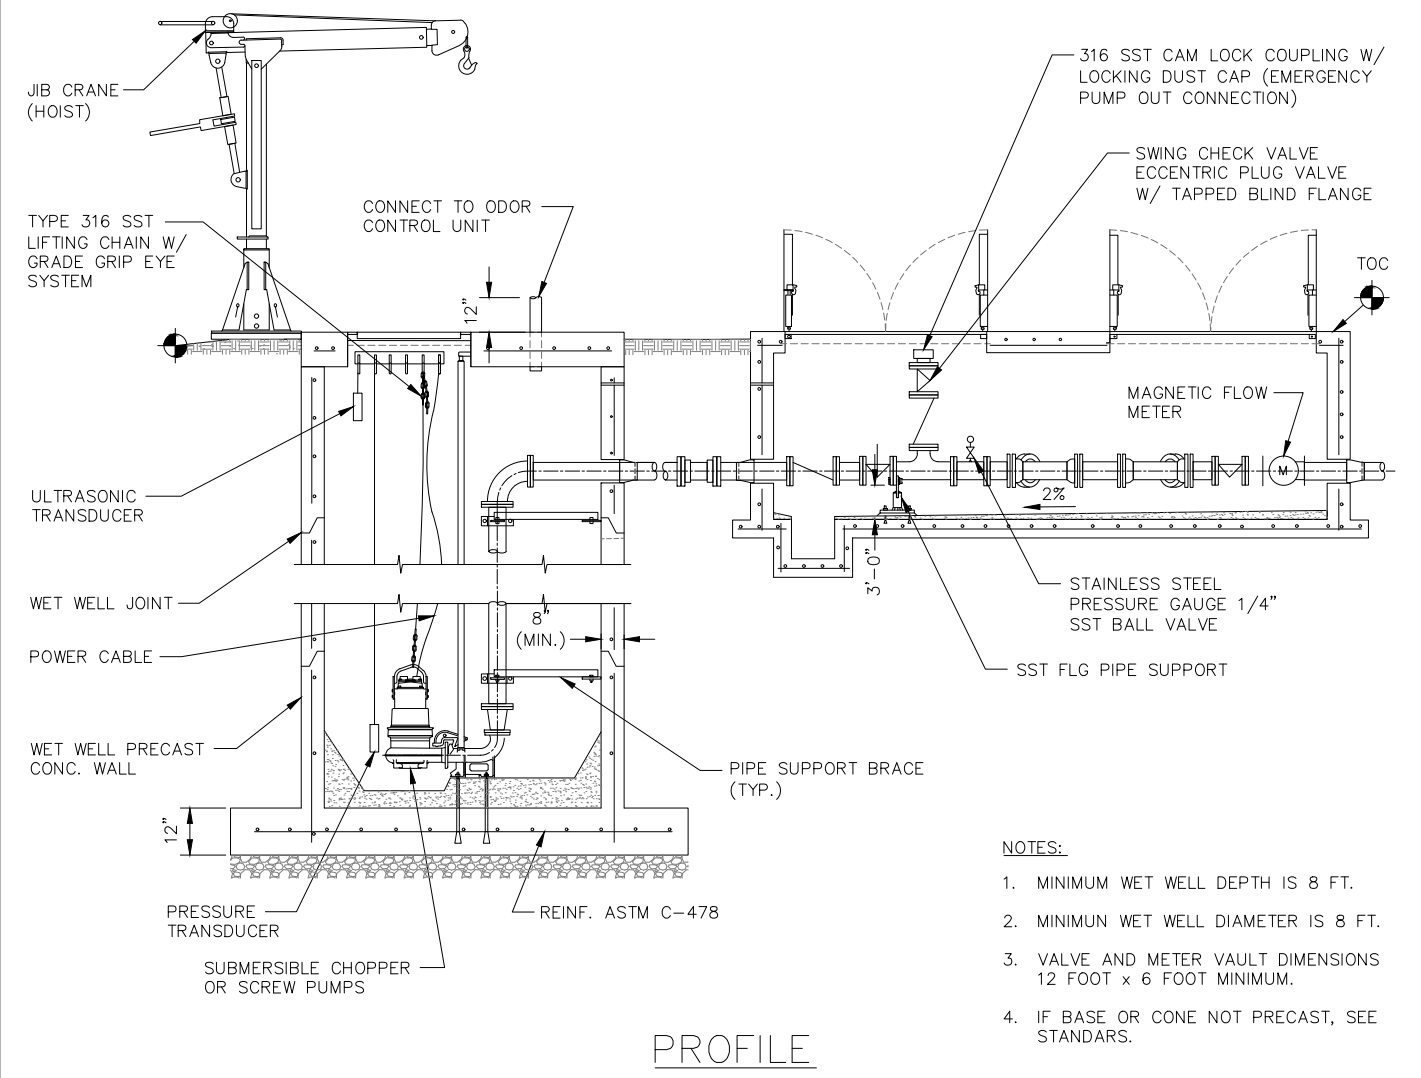

- NOTES:
- 1. MINIMUM WET WELL DEPTH IS 8 FT.
 - 2. MINIMUM WET WELL DIAMETER IS 8 FT.
 - 3. VALVE AND METER VAULT DIMENSIONS 12 FOOT x 6 FOOT MINIMUM.
 - 4. IF BASE OR CONE NOT PRECAST, SEE STANDARDS.

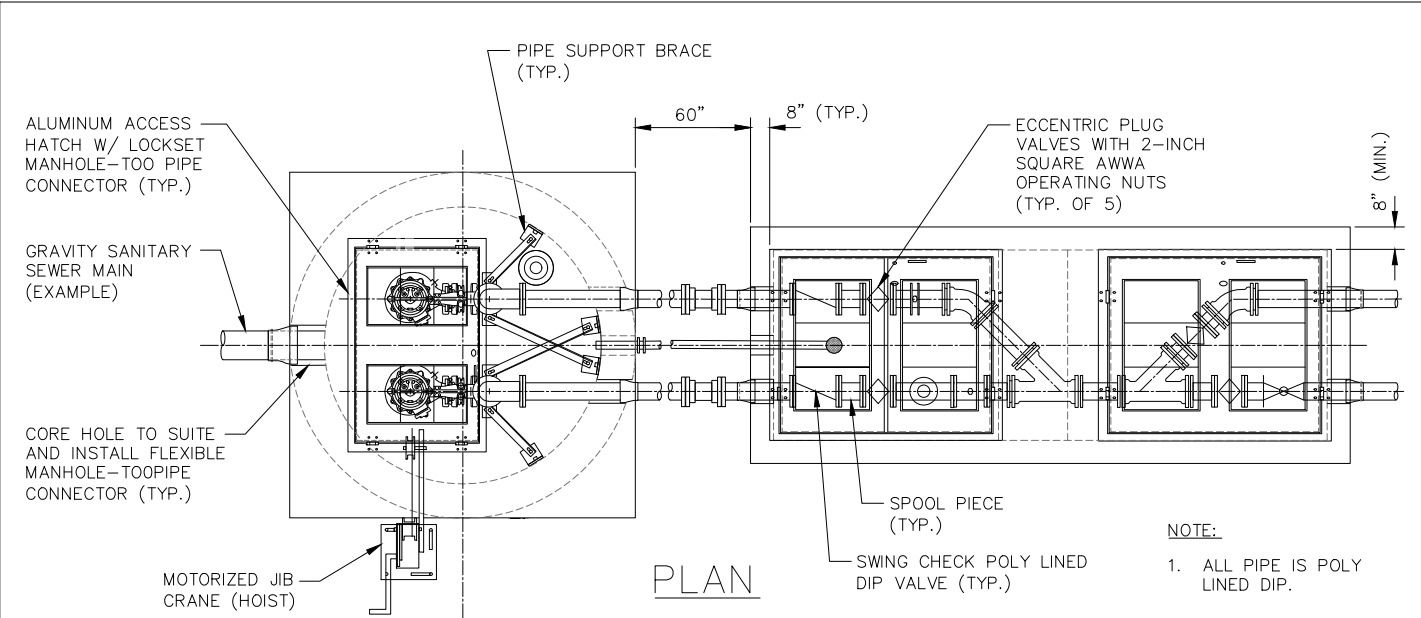

FULTON COUNTY STANDARD DETAILS

PUMP STATION
TYPICAL DETAIL
MAXIMUM 50 HP PUMPS AND 1 MGD FLOW

NOT TO SCALE

DATE: 02-18-2026

FULTON COUNTY PUBLIC WORKS
141 PRYOR ST.
ATLANTA, GA. 30303
404-612-7400
FAX: 404-224-0498

DETAIL NO. P-014