


NOTES:

- 1. INTERIOR AND EXTERIOR OF WETWELL VALVE VAULT SHALL HAVE SPRAY EPOXY APPLIED PER THE MANUFACTURER'S RECOMMENDATION.
- 2. ACCEPTABLE PRODUCTS SHALL BE CPP SPRAYLINER BY EPOXY TEC OR APPROVED EQUAL.
- 3. REFER TO SECTION 33 01 32 OF FULTON COUNTY SEWER STANDARD SPECIFICATIONS.

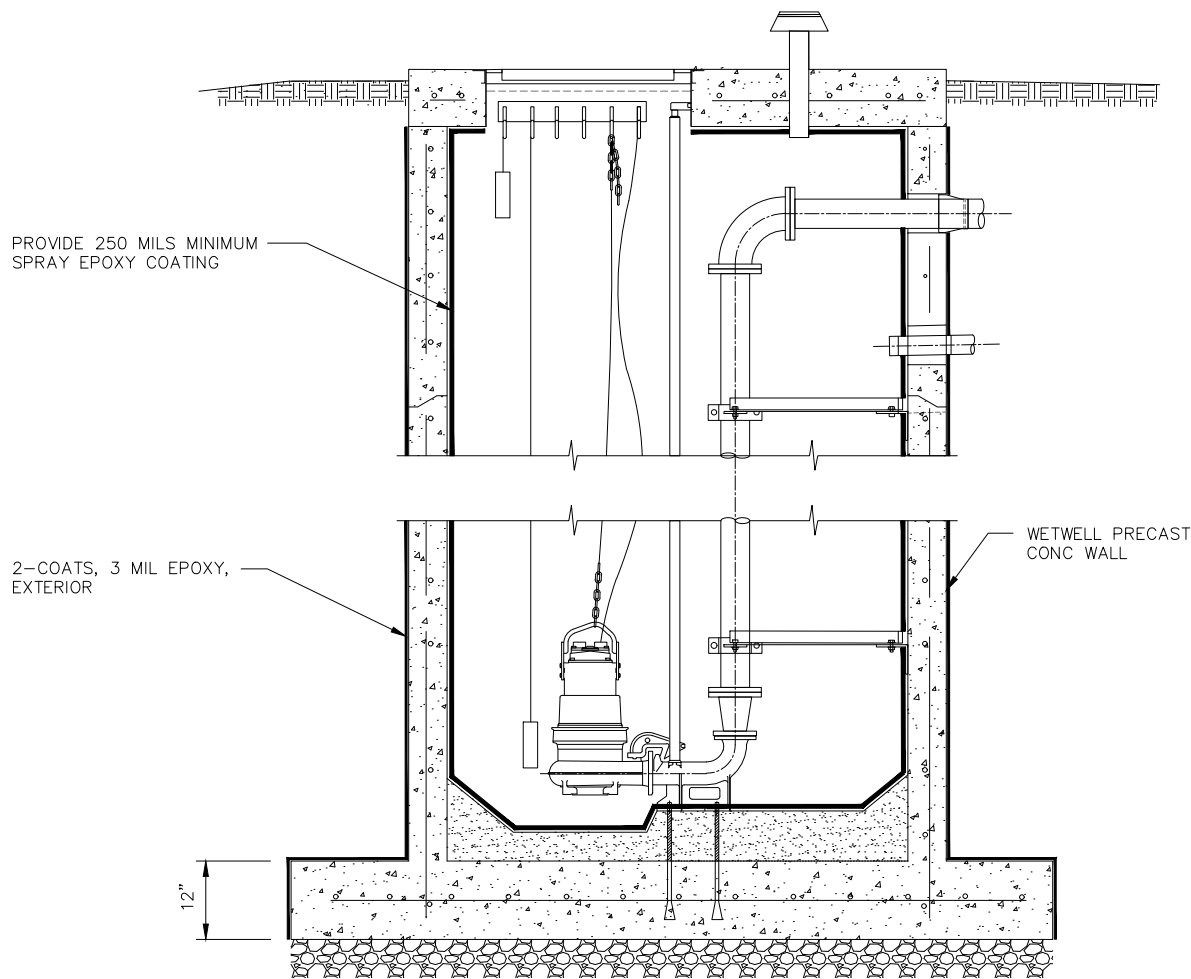

FULTON COUNTY STANDARD DETAILS

PUMP STATION
COATING DETAIL

NOT TO SCALE

DATE: 02-18-2026

FULTON COUNTY PUBLIC WORKS
141 PRYOR ST.
ATLANTA, GA. 30303
404-612-7400
FAX: 404-224-0498

DETAIL NO. P-015