


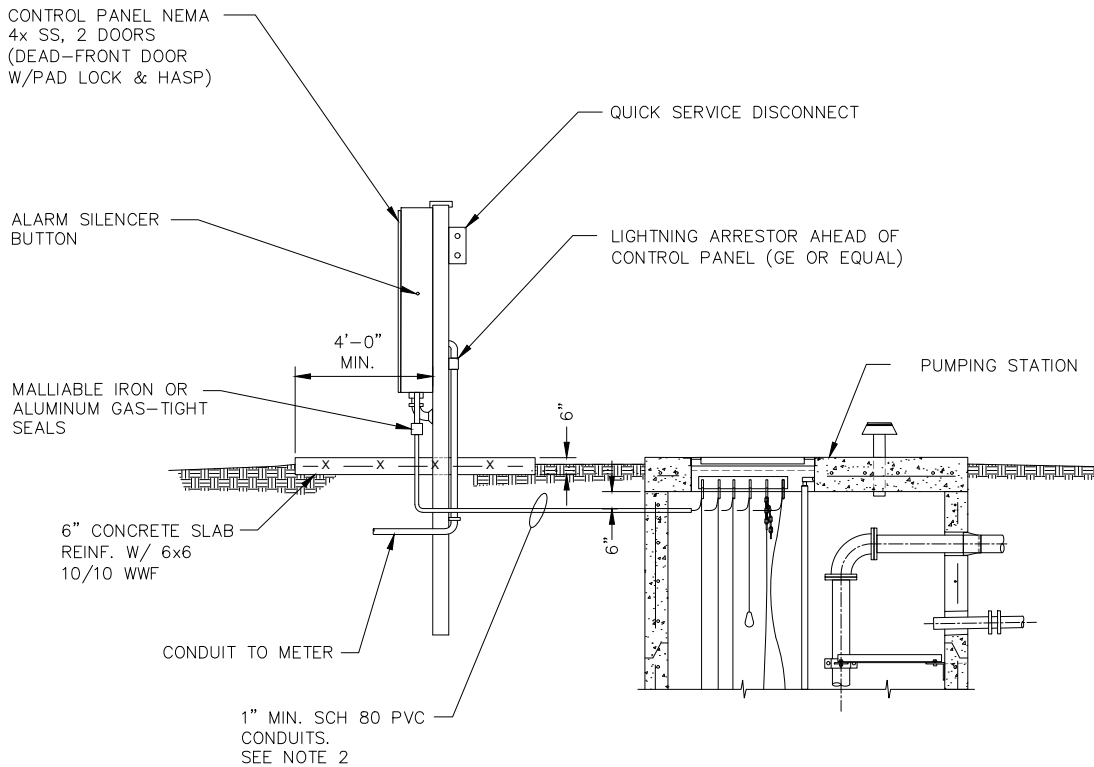

NOTES:

1. AWNING NOT SHOWN FOR CLARITY. SEE NOTE 4 ON P-001 FOR AWNING REQUIREMENTS.
2. CONDUIT SIZES SHALL BE INCREASED AS NECESSARY TO ACCOMMODATE POWER AND CONTROL CABLES.
3. SHOW CONCRETE ENCASEMENT OF POWER LINE CONDUITS WITH RED DYED CONCRETE.

SECTION

	FULTON COUNTY STANDARD DETAILS	DATE: 02-18-2026
	PUMP STATION CABLE DETAIL	FULTON COUNTY PUBLIC WORKS 141 PRYOR ST. ATLANTA, GA. 30303 404-612-7400 FAX: 404-224-0498
	NOT TO SCALE	DETAIL NO. P-016