




NOTES:

1. USE OF OVERFLOW TANK IS NOT ALLOWED EXCEPT WHEN SPECIFICALLY DIRECTED BY FCDPW.
2. FOLLOW REQUIREMENTS FOUND IN PART III GRAVITY STANDARDS FOR STEPS AND MANHOLE COVER REQUIREMENTS.
3. PIPES ARE ROTATED TO BE SHOWN IN THE SAME VIEW.
4. OVERFLOW PIPE INVERT SHALL BE EQUAL TO HIGH LEVEL ALARM.
5. VOLUME OF OVERFLOW SHALL BE EQUAL TO THREE HOURS OF STORAGE AT PEAK FLOW, MINIMUM 32,000 GALLONS.
6. OVERFLOW TANK MUST BE ENTIRELY WITHIN 150 FT BY 150 FT BUFFER AREA. MANHOLE ACCESS AND VENT TO BE LOCATED WITHIN FENCE AREA.
7. OVERFLOW VAULT TOP SLAB REINFORCEMENT SHALL BE DESIGNED TO WITHSTAND 80,000 LB LOAD.
8. ODOR CONTROL UNIT TO BE INCREASED FOR OVERFLOW TANK.
9. INSTALLATION OF OVERFLOW TANK DOES NOT REMOVE REQUIREMENT FOR BACKUP POWER GENERATOR.

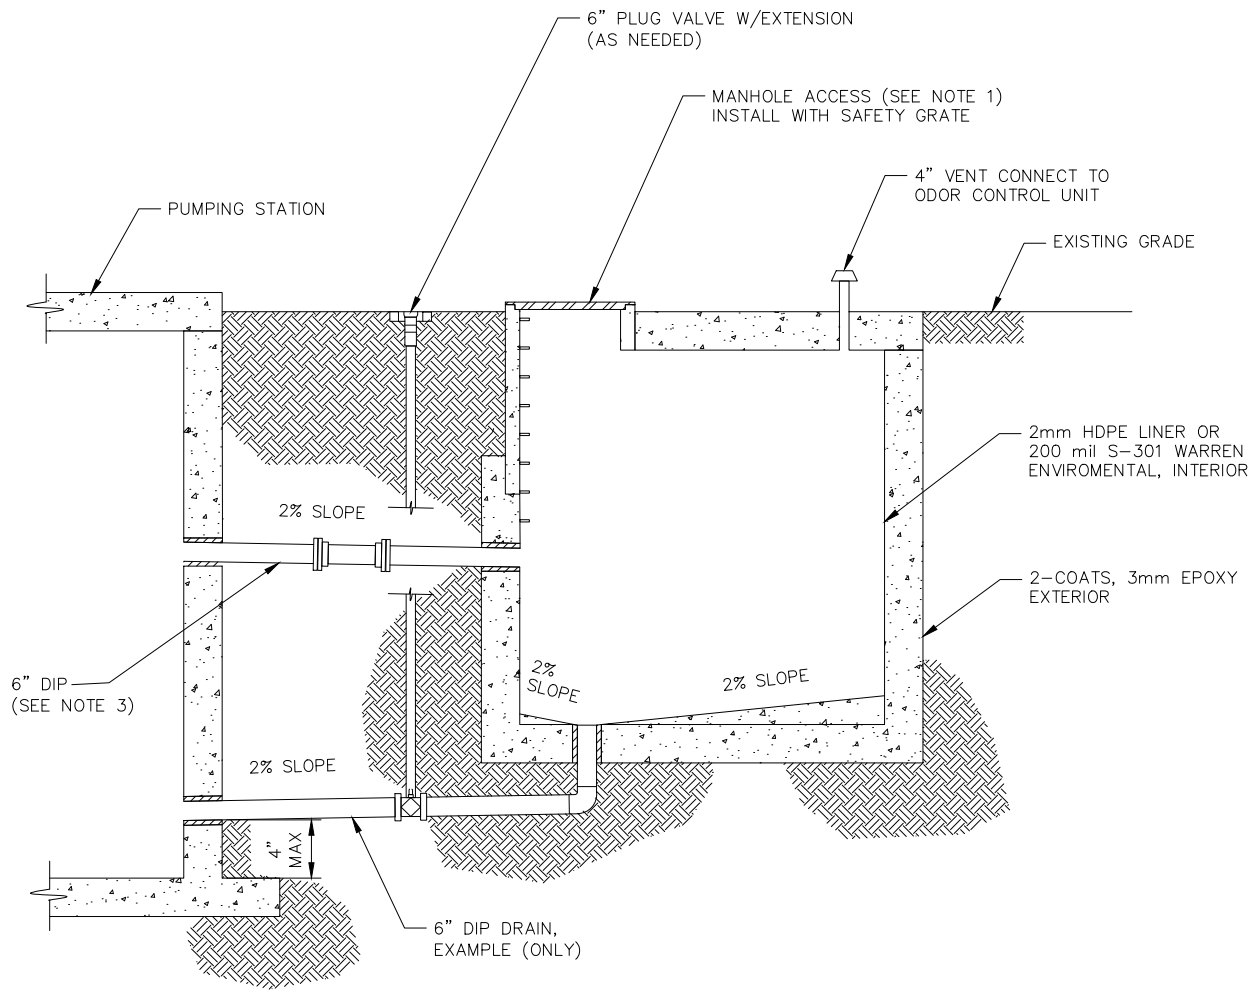

FULTON COUNTY STANDARD DETAILS

**PUMP STATION
EXAMPLE OVERFLOW TANK**

NOT TO SCALE

DATE: 02-18-2026

FULTON COUNTY PUBLIC WORKS
141 PRYOR ST.
ATLANTA, GA. 30303
404-612-7400
FAX: 404-224-0498

DETAIL NO. P-017