



BASIC LIFT STATION CONTROL PANEL – RTU ALARM INPUTS


PUMP 1 FAILURE




PUMP 2 FAILURE




HIGH WET WELL




CONTROL VOLTAGE FAILURE
STATION FLOODED (IF NEEDED)



TYPICAL FOR 240V
3 PHASE POWER

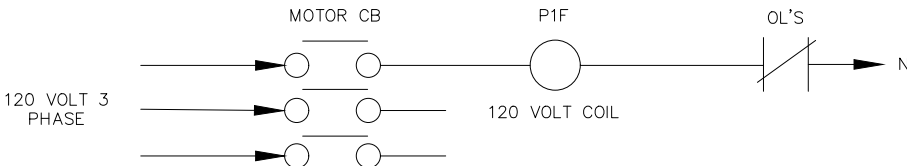

TYPICAL FOR 480V
3 PHASE POWER
(PREFERRED)

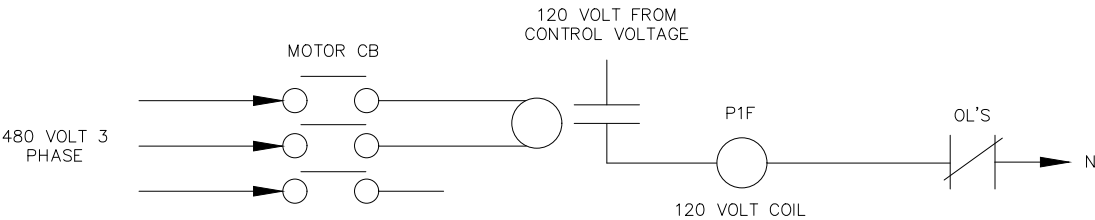

RELAY TYPE:
480 VOLT AC COIL, PORTER & BRUMFIELD PRD-11AYO-480 OF EQUAL.



FULTON COUNTY STANDARD DETAILS

PUMP STATION
BASIC CONTROL PANEL DETAIL
RTU ALARM INPUTS

NOT TO SCALE

DATE: 02-18-2026

FULTON COUNTY PUBLIC WORKS
141 PRYOR ST.
ATLANTA, GA. 30303
404-612-7400
FAX: 404-224-0498

DETAIL NO. P-021