




NOTES:

- 1. DEADFRONT LAYOUT NEMA TYPE 3R SS ENCLOSURE W/CONTINUOUS HINGE. ALL HARDWARE TYPE 316 SS TYPICAL, ACTUAL MAY VARY WITH HORSEPOWER AND NUMBER OF PUMPS.
- 2. ALL CONTROL WIRE TO BE #16 AWG, MINIMUM.
- 3. CONTROL PANEL SHALL BE UL LISTED AND LABELED.
- 4. PANEL VIEW PLC (HMI) SHALL BE 10-INCH MINIMUM.
- 5. EXTERIOR OF PANEL SHALL BE POWDER COATED WHITE.

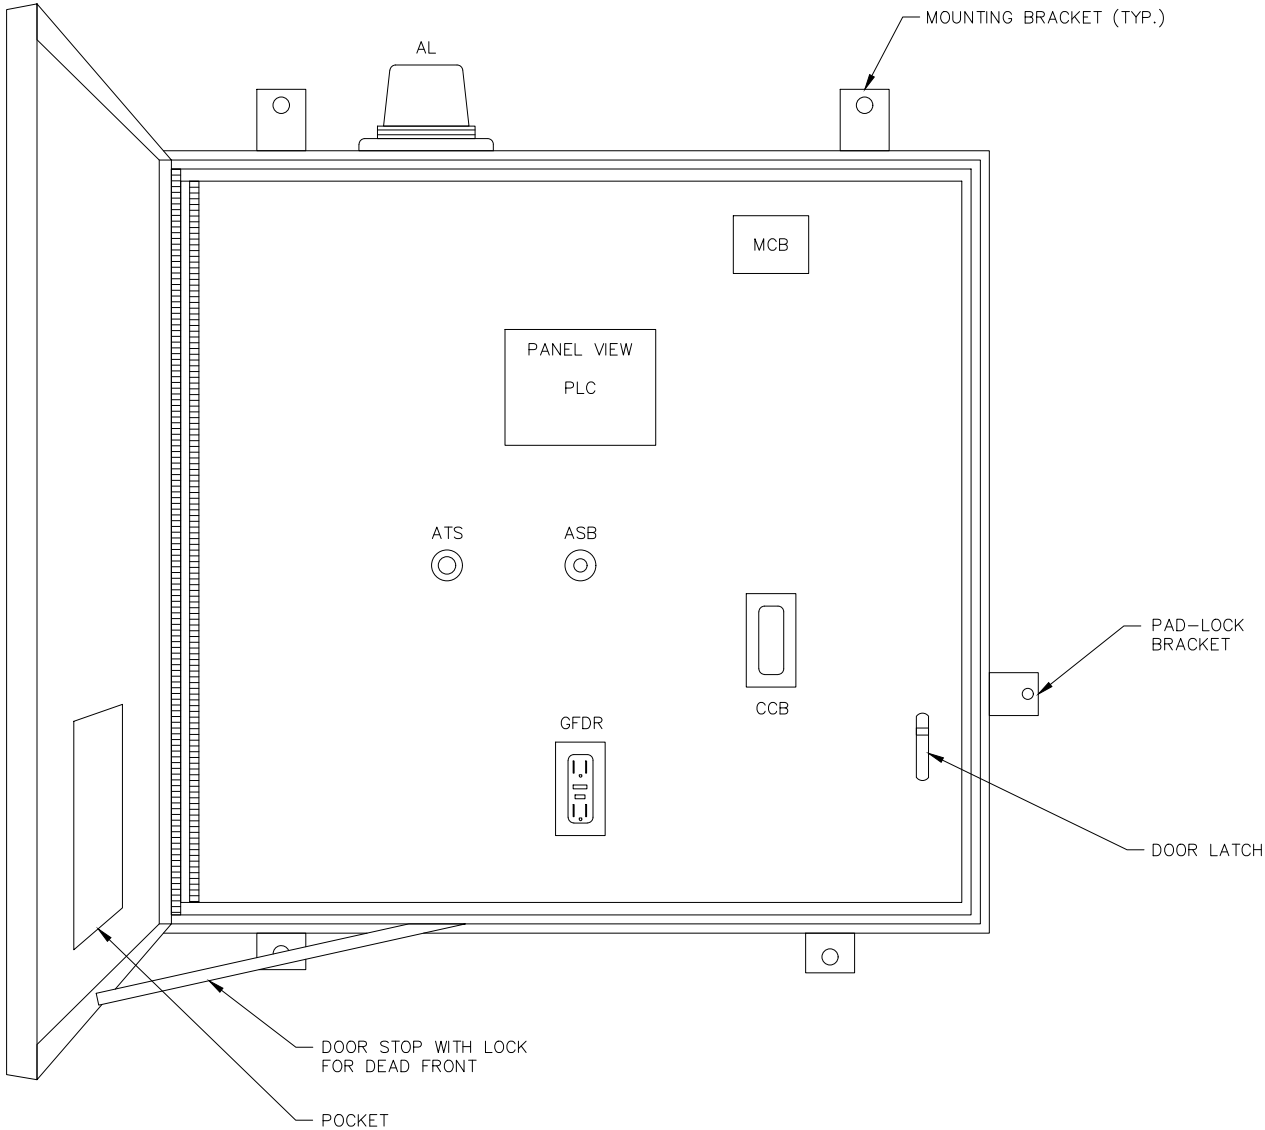

FULTON COUNTY STANDARD DETAILS

PUMP STATION
EXAMPLE DUPLEX CONTROL PANEL
ENCLOSURE DEAD FRONT LAYOUT

NOT TO SCALE

DATE: 02-18-2026

FULTON COUNTY PUBLIC WORKS
141 PRYOR ST.
ATLANTA, GA. 30303
404-612-7400
FAX: 404-224-0498

DETAIL NO. P-027