




NOTES:

1. DETAIL IS EXAMPLE SITE PLAN. SIZES ARE RELATIVE AND BASED ON MINIMUM CRITERIA. LARGER WET WELLS, VALVE VAULTS, ETC. MAY BE REQUIRED BASED ON SITE CONDITIONS.
2. PUMP STATION PAD AND DRIVEWAY SHALL INCLUDE EXPANSION JOINTS AS NEEDED.
3. PUMP STATION PAD, OVERFLOW VAULT TOP SLAB, AND DRIVEWAY REINFORCEMENT SHALL BE DESIGNED TO WITHSTAND 80,000 LB LOAD.
4. THE STATION NAME, UTILITIES I.D. NUMBER AND ADDRESS SHALL BE AFFIXED TO THE FRONT OF THE METER CABINET.
5. ELECTRICAL AND CONTROL PANELS SHALL BE PROVIDED WITH A CANOPY WITH LED LIGHTING. SIZE OF THE CANOPY SHALL BE 5 FT WIDE AND 8 FT HIGH WITH THE LENGTH TO BE DETERMINED BY THE TOTAL COMBINED LENGTH OF ELECTRICAL AND CONTROL PANELS.
6. FOLLOW FLOW METER MANUFACTURER'S RECOMMENDATION FOR MINIMUM UPSTREAM AND DOWNSTREAM STRAIGHT PIPE DISTANCE FROM FLOW METER.
7. 20 FEET EASEMENT ALONG THE FORCE MAIN TO BE DEDICATED TO FULTON COUNTY.

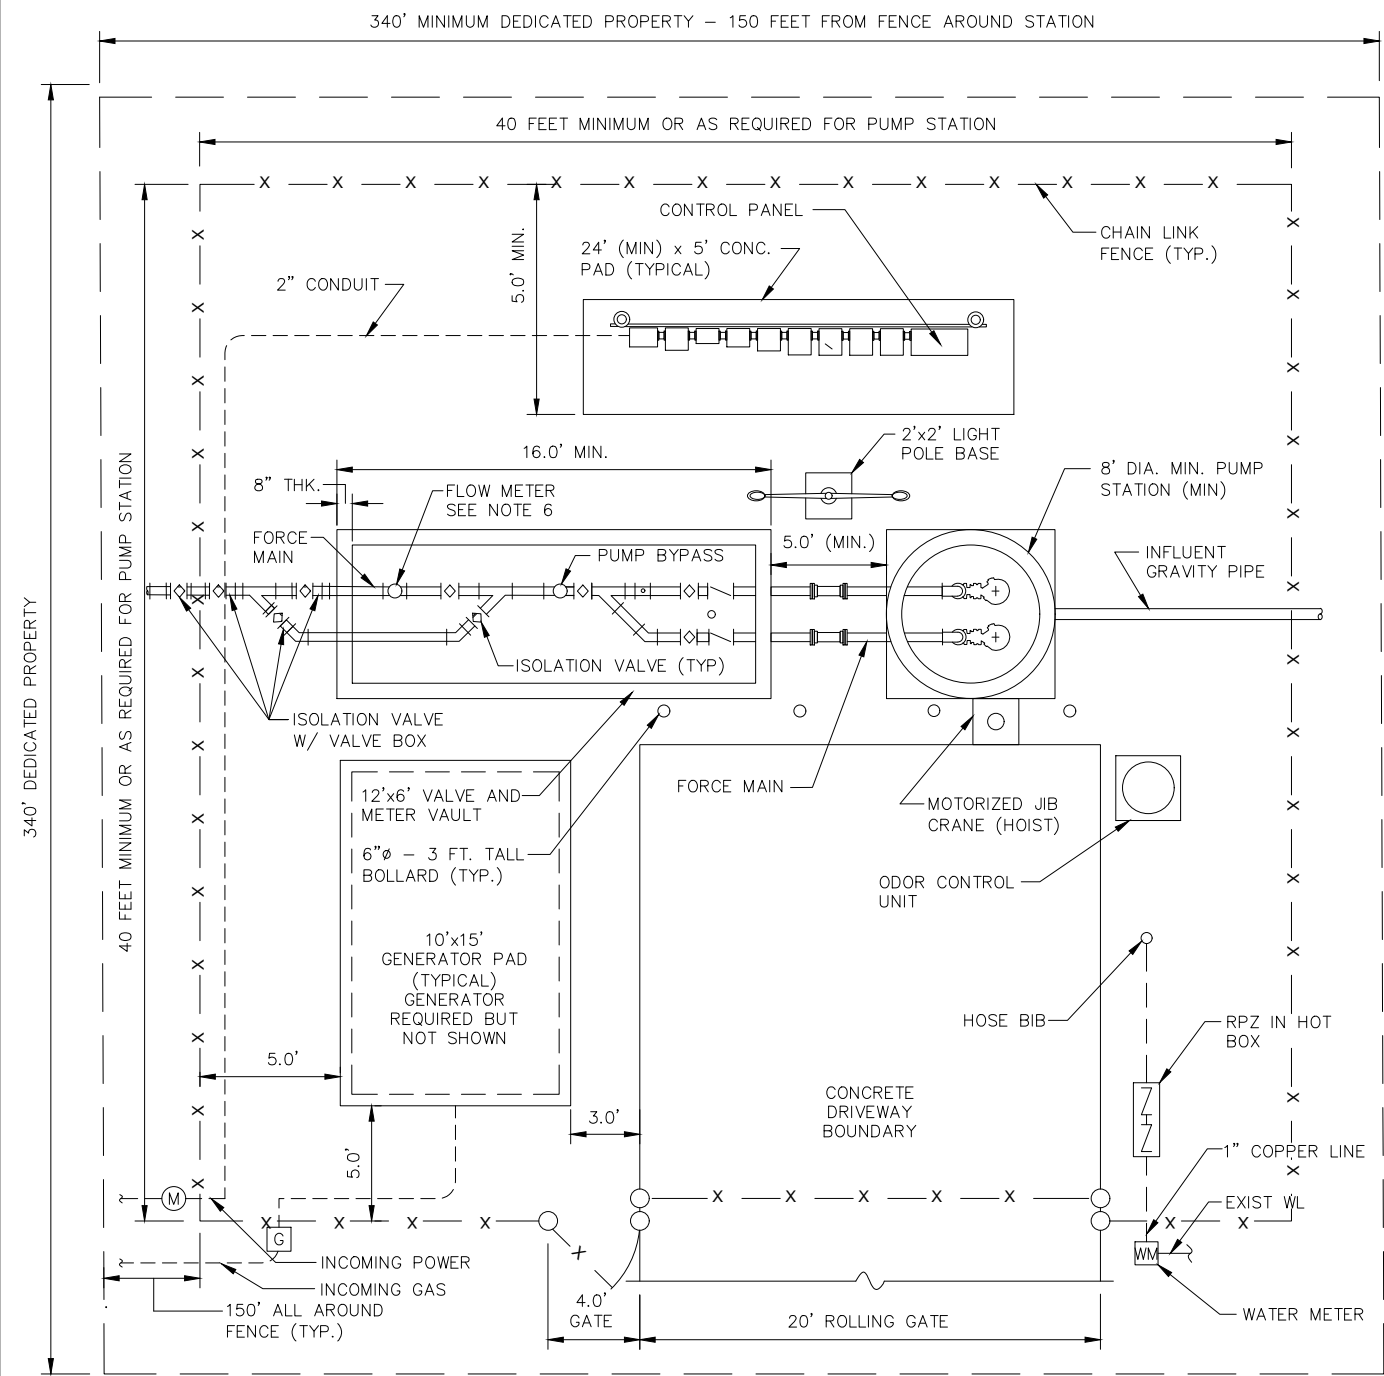

FULTON COUNTY STANDARD DETAILS

PUMP STATION
SITE PLAN
(TYPICAL / EXAMPLE)

NOT TO SCALE

DATE: 02-18-2026

FULTON COUNTY PUBLIC WORKS
141 PRYOR ST.
ATLANTA, GA. 30303
404-612-7400
FAX: 404-224-0498

DETAIL NO. P-001