




NOTES:

- 1. PUMP'S MOISTURE/TEMP RELAYS TO BE MOUNTED AT RESPECTIVE VFDs

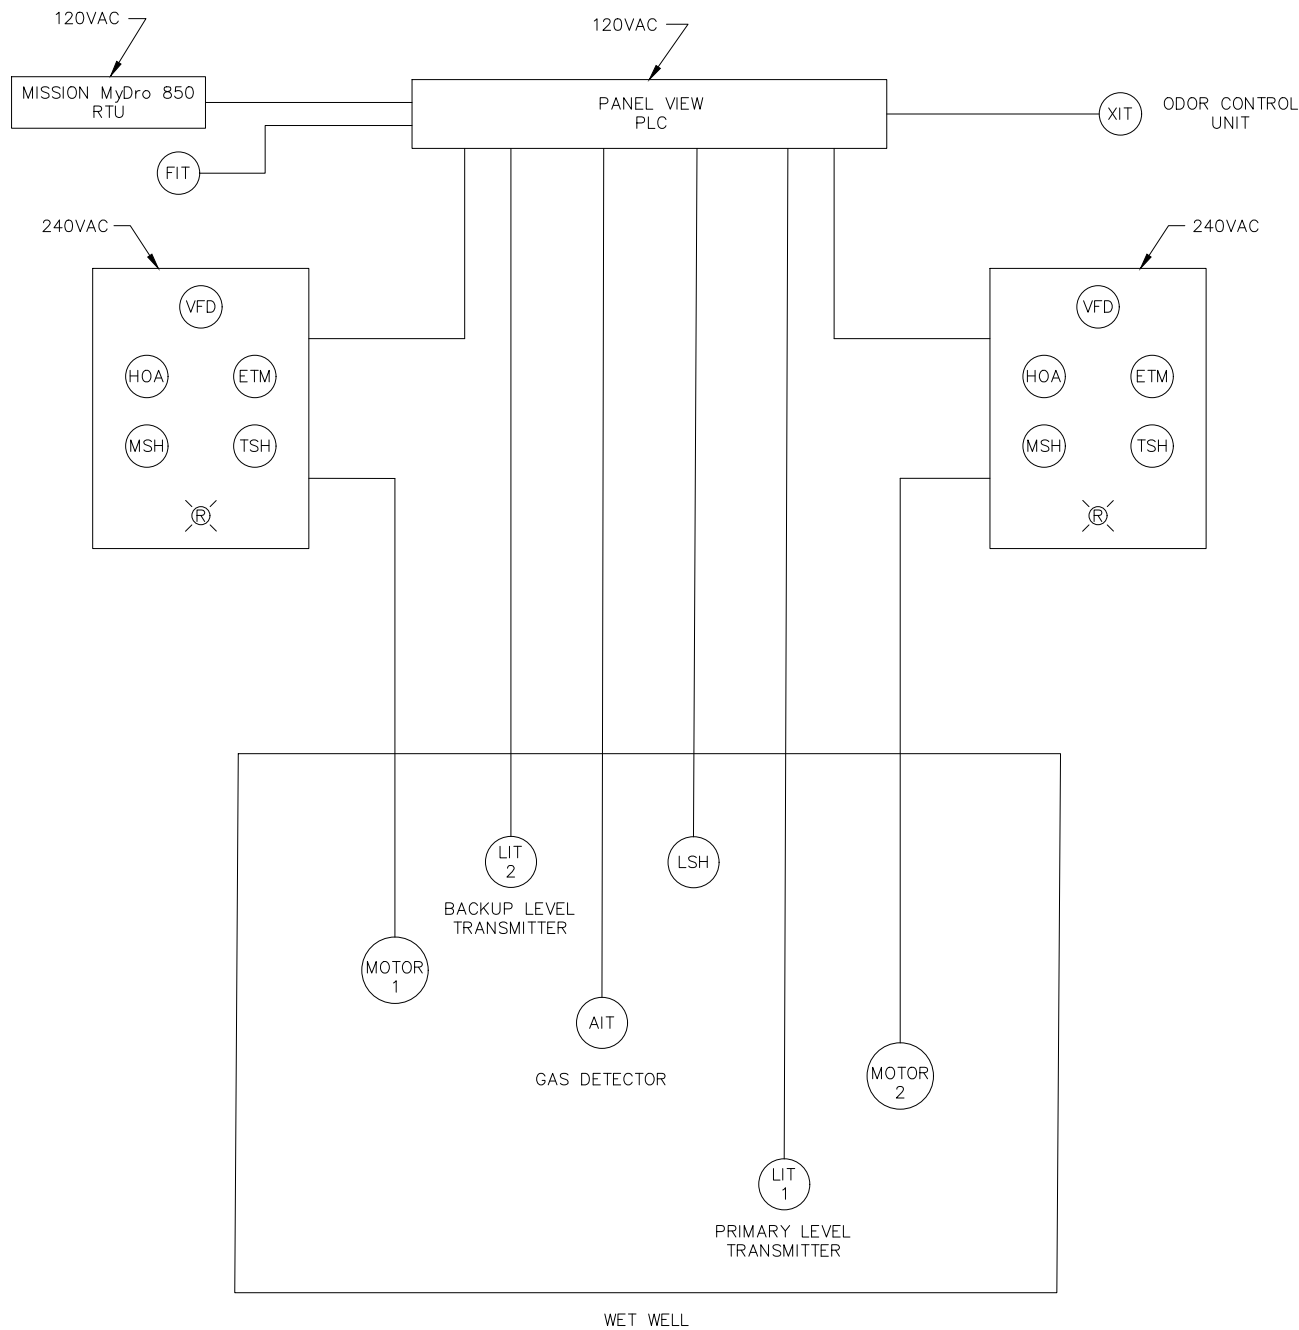

FULTON COUNTY STANDARD DETAILS

PUMP STATION

EXAMPLE DUPLEX PUMP CONTROL

BLOCK DIAGRAM (240V)

NOT TO SCALE

DATE: 02-18-2026

FULTON COUNTY PUBLIC WORKS

141 PRYOR ST.

ATLANTA, GA. 30303

404-612-7400

FAX: 404-224-0498

DETAIL NO. P-024