




NOTES:

1. PUMP'S MOISTURE/TEMP RELAYS TO BE MOUNTED AT RESPECTIVE VFDs

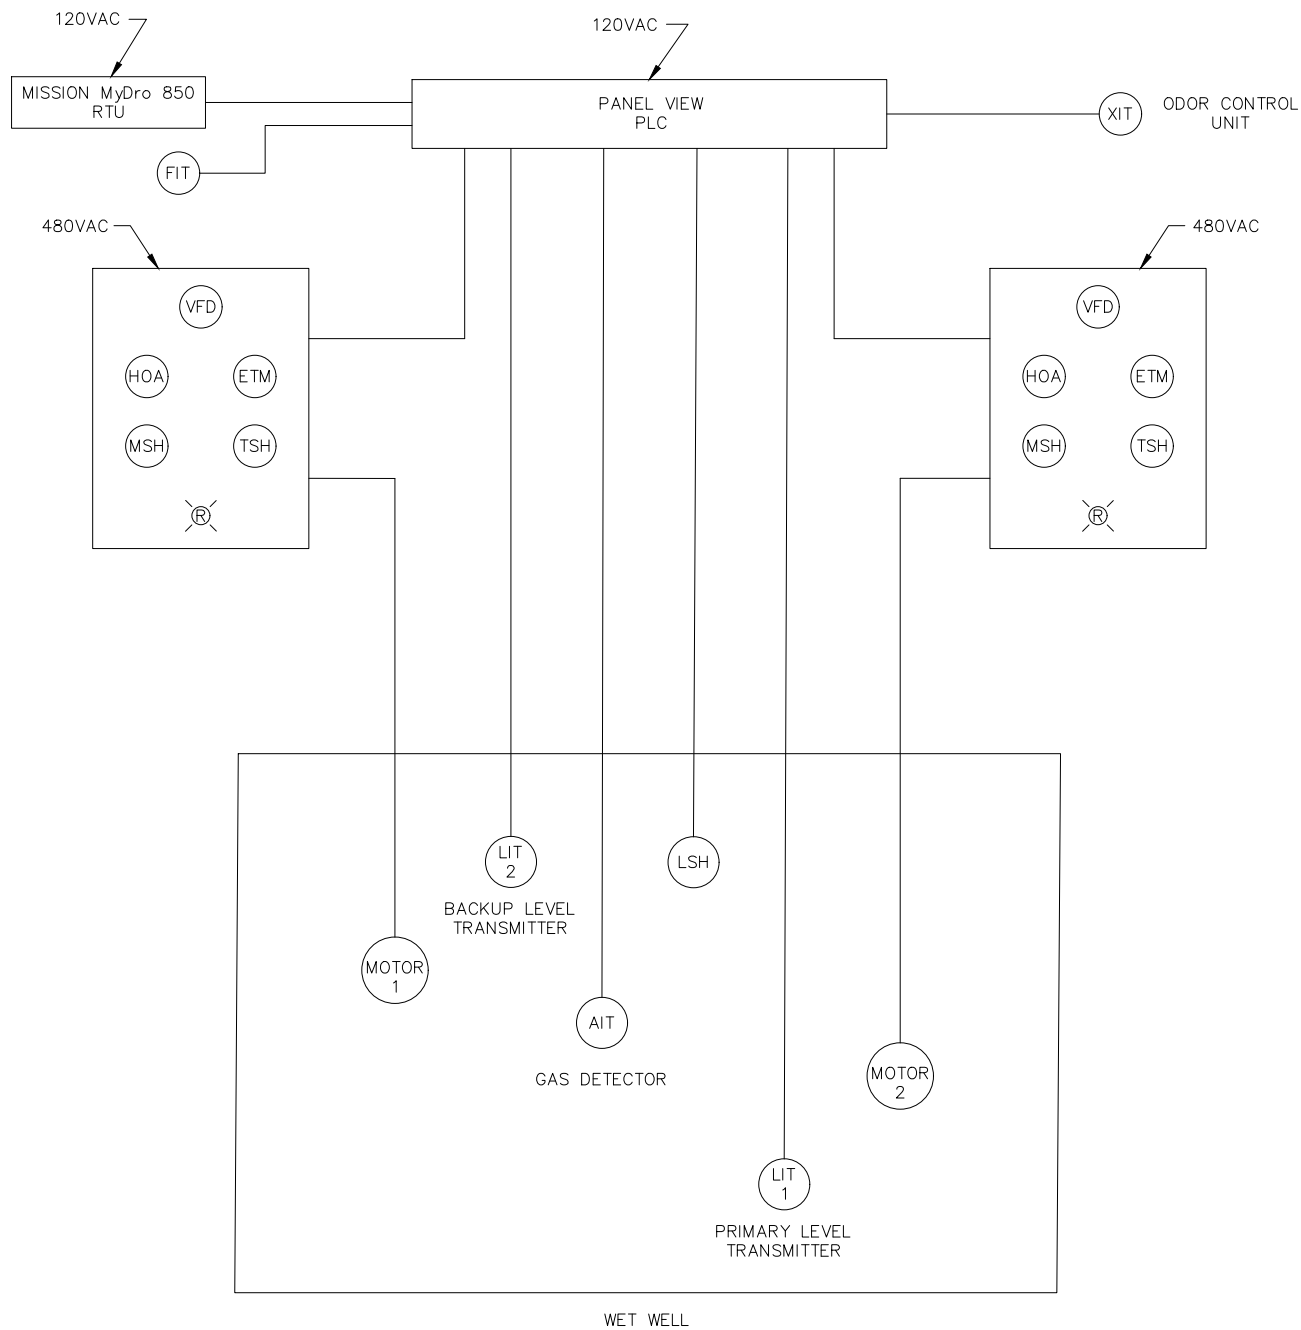

FULTON COUNTY STANDARD DETAILS

**PUMP STATION
EXAMPLE DUPLEX PUMP CONTROL
BLOCK DIAGRAM (480V + 240V)**

NOT TO SCALE

DATE: 02-18-2026

FULTON COUNTY PUBLIC WORKS
141 PRYOR ST.
ATLANTA, GA. 30303
404-612-7400
FAX: 404-224-0498

DETAIL NO. P-030