



GALLON CAPACITY	*OUTSIDE DIMENSIONS			INLET TEE HGT.	OUTLET TEE HGT.
	LENGTH	WIDTH	HEIGHT	*VARIES BASED ON TANK SIZE	
3000	15'-7"	9'-7"	8'-6.5"	5'-2"	5'-0"
1500	11'-0"	6'-0"	4'-7"	3'-10"	4'-0"
1000	8'-6"	5'-3"	4'-6"	3'-10"	4'-0"
750	7'-0"	4'-8"	4'-6"	3'-10"	4'-0"

*DIMENSIONS OF PREFAB CONCRETE TANKS MAY VARY BASED ON MANUFACTURER, HOWEVER THE GALLON CAPACITY MUST BE EQUIVALENT TO THE TANK SIZE SPECIFIED FOR INSTALLATION.

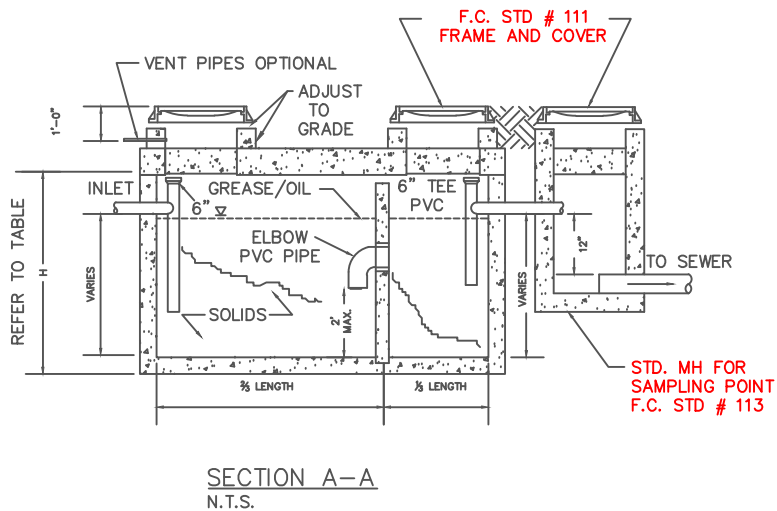

BAFFLE STANDS 50" IN HEIGHT AND IS 2½" IN THICKNESS REINFORCED W/ 6-6-10 WIRE MESH

PIPE DIAMETER MAY VARY STANDARD 3"-5"

PVC PIPE REQ'D ON WALL WITH ELBOW TURNED DOWN MAX. 2' OFF TANK BOTTOM

* BAFFLE WALL OPTIONAL ON SINGLE TANK INSTALLATIONS.

BAFFLE WALL*
N.T.S.

FULTON COUNTY STANDARD DETAIL 702
SINGLE TANKS

DATE	REVISIONS	DATE	REVISIONS
8/08	NRR		
1/15	TPM		

DGS/DRN/CHKD: JM
APPROVED: REW
DATE: 12-2-05



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.
702